

PEDESTRIAN WIND ENVIRONMENT STUDY

2 CHIFLEY SQUARE, SYDNEY

WF349-02F01 (REV0)- WE REPORT

JULY 23, 2021

Prepared for:

Charter Hall

Level 20, 1 Martin Place,
Sydney, NSW 2000

DOCUMENT CONTROL

Date	Revision History	Issued Revision	Prepared By (initials)	Instructed By (initials)	Reviewed & Authorised by (initials)
July 15, 2021	Initial.	0	NR	SWR	JG
July 19, 2021	Updated discussion	1	NR	SWR	JG
July 23, 2021	Updated Exec. Summary and Discussion	2	NR	SWR	JG

The work presented in this document was carried out in accordance with the Windtech Consultants Quality Assurance System, which is based on International Standard ISO 9001.

This document is issued subject to review and authorisation by the Team Leader noted by the initials printed in the last column above. If no initials appear, this document shall be considered as preliminary or draft only and no reliance shall be placed upon it other than for information to be verified later.

This document is prepared for our Client's particular requirements which are based on a specific brief with limitations as agreed to with the Client. It is not intended for and should not be relied upon by a third party and no responsibility is undertaken to any third party without prior consent provided by Windtech Consultants. The information herein should not be reproduced, presented or reviewed except in full. Prior to passing on to a third party, the Client is to fully inform the third party of the specific brief and limitations associated with the commission.

EXECUTIVE SUMMARY

This report presents the results of a detailed investigation into the wind environment impact of the 2 Chifley Square development, located in Sydney. Testing was performed at Windtech's boundary layer wind tunnel facility. The wind tunnel has a 3.0m wide working section and a fetch length of 14m, and measurements were taken from 16 wind directions at 22.5 degree increments. Testing was carried out using a 1:300 detailed scale model of the development. The effects of nearby buildings and land topography have been accounted for through the use of a proximity model which represents an area with a radius of 375m. Several scenarios were tested as follows:

- Case 1: With the existing surrounding buildings. In this report, this test case is referred to as the "Existing Scenario".
- Case 2: With the Base Case building and existing surrounding buildings. In this report, this test case is referred to as the "Base Case".
- Case 3: With the Proposed Envelope building and existing surrounding buildings. In this report, this test case is referred to as the "Proposed Envelope Scenario".

Peak gust and mean wind speeds were measured at selected critical outdoor trafficable locations within and around the subject development. Wind velocity coefficients representing the local wind speeds are derived from the wind tunnel and are combined with a statistical model of the regional wind climate (which accounts for the directional strength and frequency of occurrence of the prevailing regional winds) to provide the equivalent full-scale wind speeds at the site. The wind speed measurements are compared with criteria for pedestrian comfort and safety, based on Gust-Equivalent Mean (GEM) and annual maximum gust winds, respectively.

The model was tested in the wind tunnel without the effect of any forms of wind ameliorating devices such as screens, balustrades, etc., which are not already shown in the architectural drawings. The effect of vegetation was also excluded from the testing.

The results of the study demonstrate that the Proposed Envelope generally exhibits wind conditions in the outdoor trafficable areas suitable for their intended uses particularly towards the south-western aspect of the site. In addition, the results of study demonstrate that the Proposed Envelope outperforms the Base Case when utilising a comparison of the average wind speed of the equivalent 5% exceedance wind speeds for each scenario. It should also be noted that the wind conditions for the Proposed Envelope outperform the Existing Scenario using a comparison of average wind speed of the equivalent 5% exceedance wind speeds.

However, it is also observed that some areas in all three cases experience adverse wind conditions which exceed the relevant criteria for comfort and/or safety. In the areas where the wind conditions of the Proposed Envelope exceed the wind conditions of the Existing Scenario, these concerns will be addressed with wind tunnel testing during the detailed design stage and recommendations of mitigation measures. Given the assessment is currently limited to a sheer massing envelope, the detailed design is also expected to introduce building elements that may further improve the wind conditions within and around the site.

CONTENTS

1	Introduction	1
2	Wind Tunnel Model	2
3	Boundary Layer Wind Profiles at the Site	10
4	Regional Wind Model	13
5	Pedestrian Wind Comfort and Safety	16
5.1	Measured Wind Speeds	16
5.2	Wind Speed Criteria Used for This Study	16
5.3	Layout of Study Points	18
6	Results and Discussion	20
7	References	30

Appendix A Published Environmental Criteria

Appendix B Data Acquisition

Appendix C Directional Plots of Wind Tunnel Results

Appendix D Velocity and Turbulence Intensity Profiles

INTRODUCTION

A wind tunnel study has been undertaken to assess wind speeds at selected critical outdoor trafficable areas within and around the subject development. The test procedures followed for this wind tunnel study were based on the guidelines set out in the Australasian Wind Engineering Society Quality Assurance Manual (AWES-QAM-1-2019), ASCE 7-16 (Chapter C31), and CTBUH (2013).

A scale model of the development was prepared, including the surrounding buildings and land topography. Testing was performed at Windtech's boundary layer wind tunnel facility. The wind tunnel has a 3.0m wide working section and a fetch length of 14m, and measurements were taken from 16 wind directions at 22.5 degree increments. The wind tunnel was configured to the appropriate boundary layer wind profile for each wind direction. Wind speeds were measured using either Dantec hot-wire probe anemometers or pressure-based wind speed sensors, positioned to monitor wind conditions at critical outdoor trafficable areas of the development.

The model was tested in the wind tunnel without the effect of any forms of wind ameliorating devices such as screens, balustrades, etc., which are not already shown in the architectural drawings. The wind speeds measured during testing were combined with a statistical model of the regional wind climate to provide the equivalent full-scale wind speeds at the site. The measured wind speeds were compared against appropriate criteria for pedestrian comfort and safety,

WIND TUNNEL MODEL

Wind tunnel testing was carried out using a 1:300 scale model of the development and surroundings. The study model incorporates all necessary architectural features on the façade of the development to ensure an accurate wind flow is achieved around the model, and was constructed using a Computer Aided Manufacturing (CAM) process to ensure that a high level of detail and accuracy is achieved. The effect of nearby buildings and land topography has been accounted for through the use of a proximity model, which represents a radius of 375m from the development site. Photographs of the wind tunnel model are presented in Figures 1. A plan of the proximity model is provided in Figures 2.



Figure 1a: Photograph of the Wind Tunnel Model
(Existing Scenario, view from the south-east)



Figure 1b: Photograph of the Wind Tunnel Model
(Base Case, view from the north-east)



Figure 1c: Photograph of the Wind Tunnel Model
(Base Case, view from the south-east)

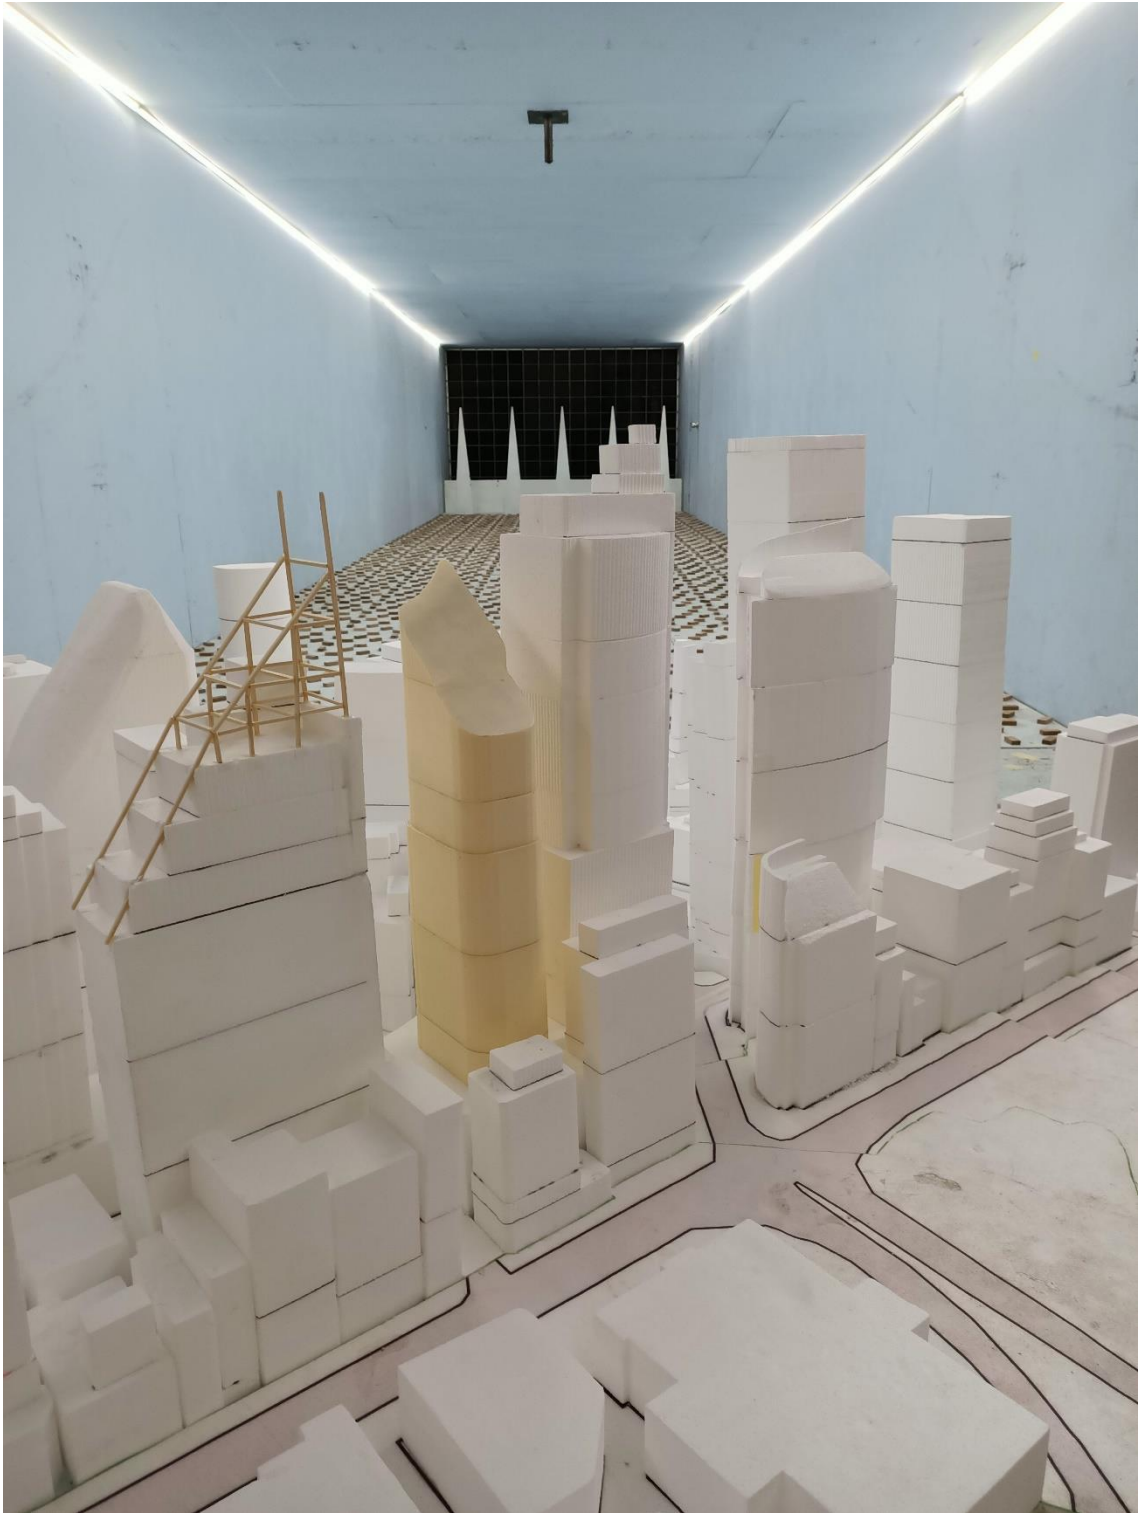


Figure 1d: Photograph of the Wind Tunnel Model
(Base Case, view from the south-east)



Figure 1e: Photograph of the Wind Tunnel Model
(Proposed Envelope, view from the west)



Figure 1f: Photograph of the Wind Tunnel Model
(Proposed Envelope, view from the south-east)

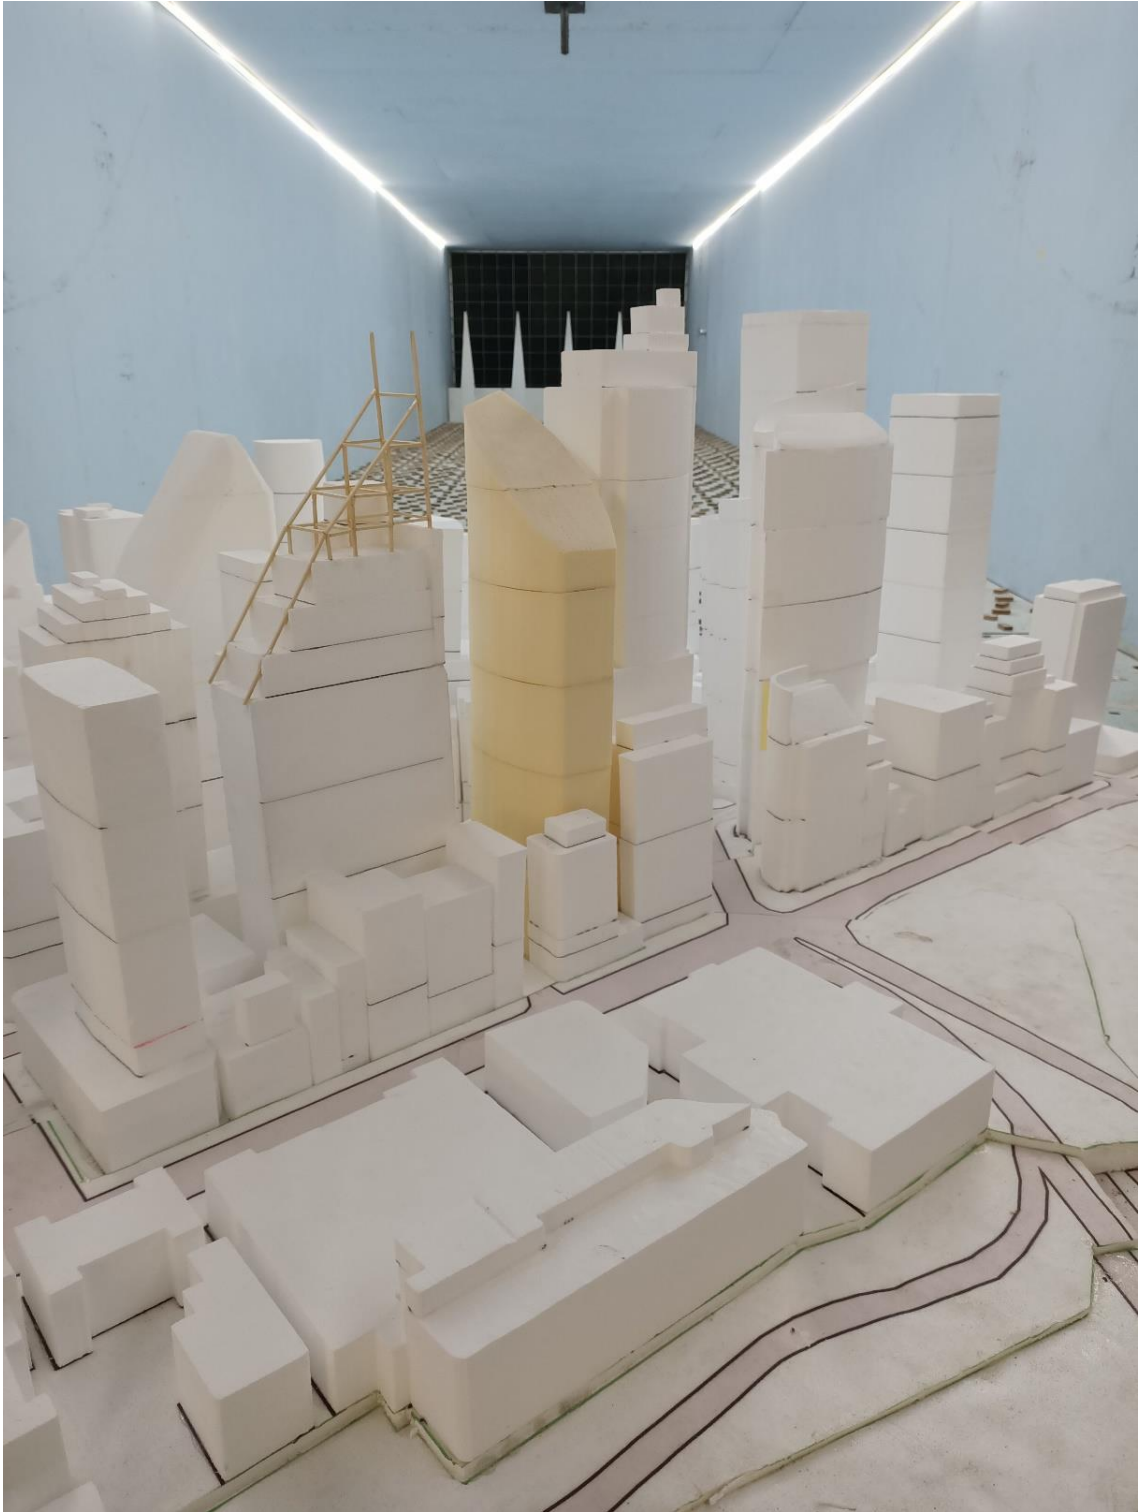


Figure 1g: Photograph of the Wind Tunnel Model
(Proposed Envelope, view from the south-east)



Figure 2a: Proximity Model Plan (Case 1: Existing Scenario)

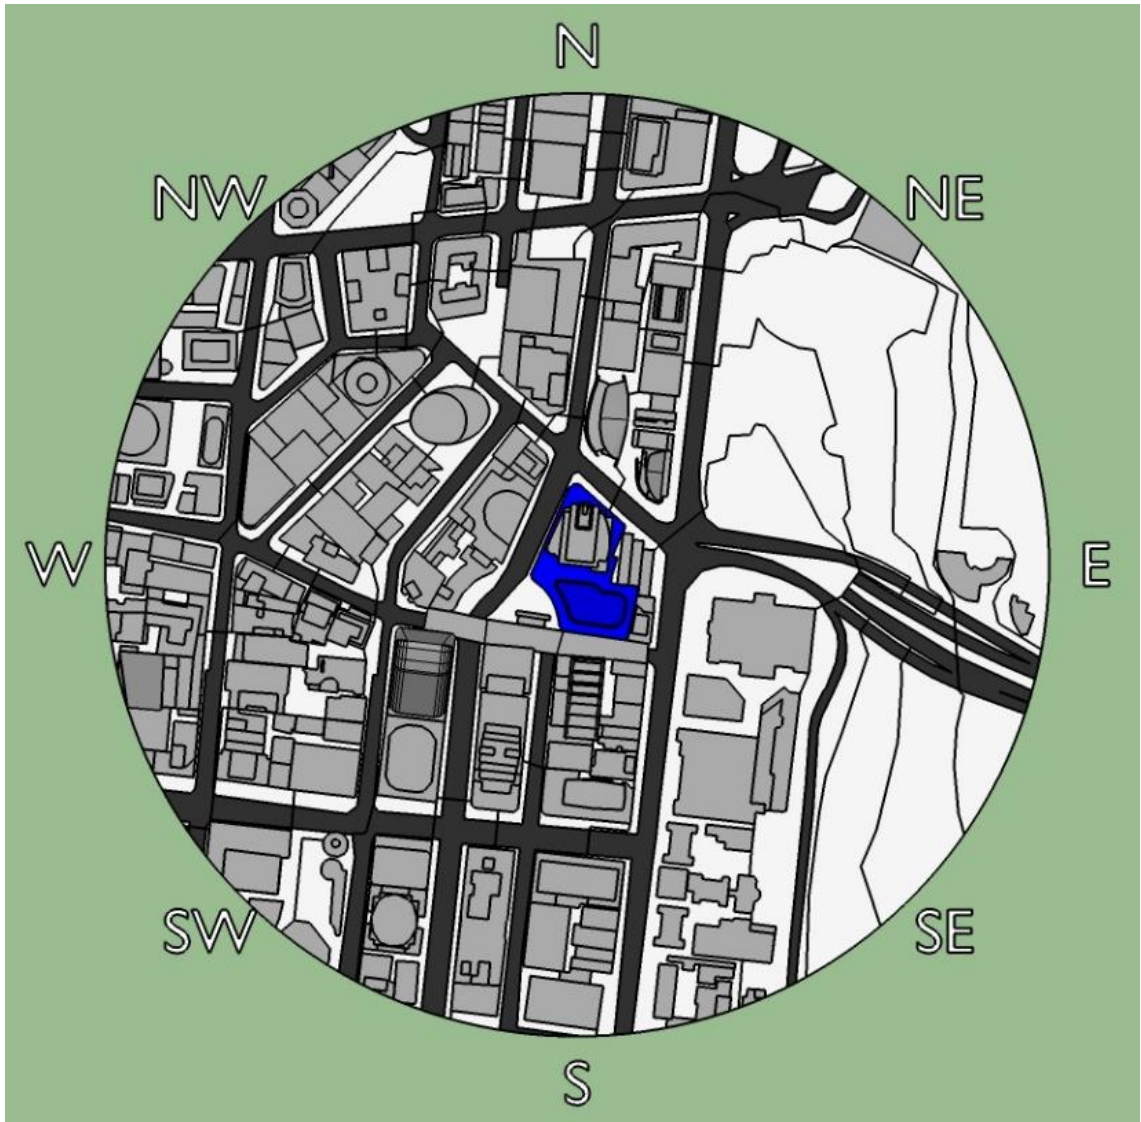


Figure 2b: Proximity Model Plan (Case 2: Base Case)



Figure 2c: Proximity Model Plan (Case 3: Proposed Envelope Scenario)

BOUNDARY LAYER WIND PROFILES AT THE SITE

The roughness of the surface of the earth has the effect of slowing down the wind near the ground. This effect is observed up to the boundary layer height, which can range between 500m to 3km above the earth's surface depending on the roughness of the surface (ie: oceans, open farmland, etc). Within this range the prevailing wind forms a boundary layer wind profile.

Various wind codes and standards and other publications classify various types of boundary layer wind flows depending on the surface roughness z_0 . Descriptions of typical boundary layer wind profiles, based on D.M. Deaves and R.I. Harris (1978), are summarised as follows:

- Flat terrain ($0.002\text{m} < z_0 < 0.003\text{m}$). Examples include inland water bodies such as lakes, dams, rivers, etc, and the open ocean.
- Semi-open terrain ($0.006\text{m} < z_0 < 0.01\text{m}$). Examples include flat deserts and plains.
- Open terrain ($0.02\text{m} < z_0 < 0.03\text{m}$). Examples include grassy fields, semi-flat plains, and open farmland (without buildings or trees).
- Semi-suburban/semi-forest terrain ($0.06\text{m} < z_0 < 0.1\text{m}$). Examples include farmland with scattered trees and buildings and very low-density suburban areas.
- Suburban/forest terrain ($0.2\text{m} < z_0 < 0.3\text{m}$). Examples include suburban areas of towns and areas with dense vegetation such as forests, bushland, etc.
- Semi-urban terrain ($0.6\text{m} < z_0 < 1.0\text{m}$). Examples include centres of small cities, industrial parks, etc.
- Urban terrain ($2.0\text{m} < z_0 < 3.0\text{m}$). Examples include centres of large cities with many high-rise towers, and also areas with many closely-spaced mid-rise buildings.

The boundary layer wind profile does not change instantly due to changes in the terrain roughness. It can take many kilometres (at least 100km) of a constant surface roughness for the boundary layer wind profile to achieve a state of equilibrium. Hence an analysis of the effect of changes in the upwind terrain roughness is necessary to determine an accurate boundary layer wind profile at the development site location.

The proximity model accounts for the effect of the near field topographic effects as well as the influence of the local built forms. To account for further afield effects, an assessment of the upwind terrain roughness has been undertaken based on the method given in AS/NZS1170.2:2011, using a fetch ranging from 20 to 60 times the study reference height (as per the recommendation by AS/NZS1170.2:2011). An aerial image showing the surrounding terrain is presented in Figure 3 for a range of 5.4km from the edge of the proximity model used for the wind tunnel study. The resulting mean and gust terrain and height multipliers at the site location are presented in Table 1, referenced to the study reference height (which is approximately half the height of the subject development since typically we are most interested in the wind effects at the ground plane). Details of the boundary layer wind profiles at the site are combined with the regional wind model (see Section 4) to determine the site wind speeds.

Table 1: Approaching Boundary Layer Wind Profile Analysis Summary (at the study reference height)

Wind Sector (degrees)	Terrain and Height Multiplier			Turbulence Intensity I_v	Equivalent Terrain Category (AS/NZS1170.2:2011 naming convention)
	$k_{tr,T=1hr}$ (hourly)	$k_{tr,T=10min}$ (10min)	$k_{tr,T=3s}$ (3sec)		
0	0.76	0.80	1.20	0.195	3.1
30	0.83	0.87	1.24	0.163	2.6
60	0.94	0.97	1.29	0.125	1.8
90	0.89	0.92	1.27	0.143	2.2
120	0.81	0.85	1.23	0.175	2.8
150	0.77	0.81	1.21	0.189	3.0
180	0.71	0.75	1.18	0.221	3.3
210	0.71	0.76	1.18	0.219	3.3
240	0.78	0.82	1.21	0.186	3.0
270	0.82	0.86	1.23	0.170	2.7
300	0.88	0.92	1.26	0.145	2.3
330	0.84	0.88	1.24	0.162	2.6

NOTE: These terrain and height multipliers are to be applied to a basic regional wind speed averaged over 3-seconds. Divide these values by 1.10 for a basic wind speed averaged over 0.2-seconds, 0.69 for a basic wind speed averaged over 10-minutes, or 0.66 for a basic wind speed averaged over 1-hour.

For each of the 16 wind directions tested in this study, the approaching boundary layer wind profiles modelled in the wind tunnel closely matched the profiles listed in Table 1. Plots of the boundary layer wind profiles used for the wind tunnel testing are presented in Appendix D of this report.

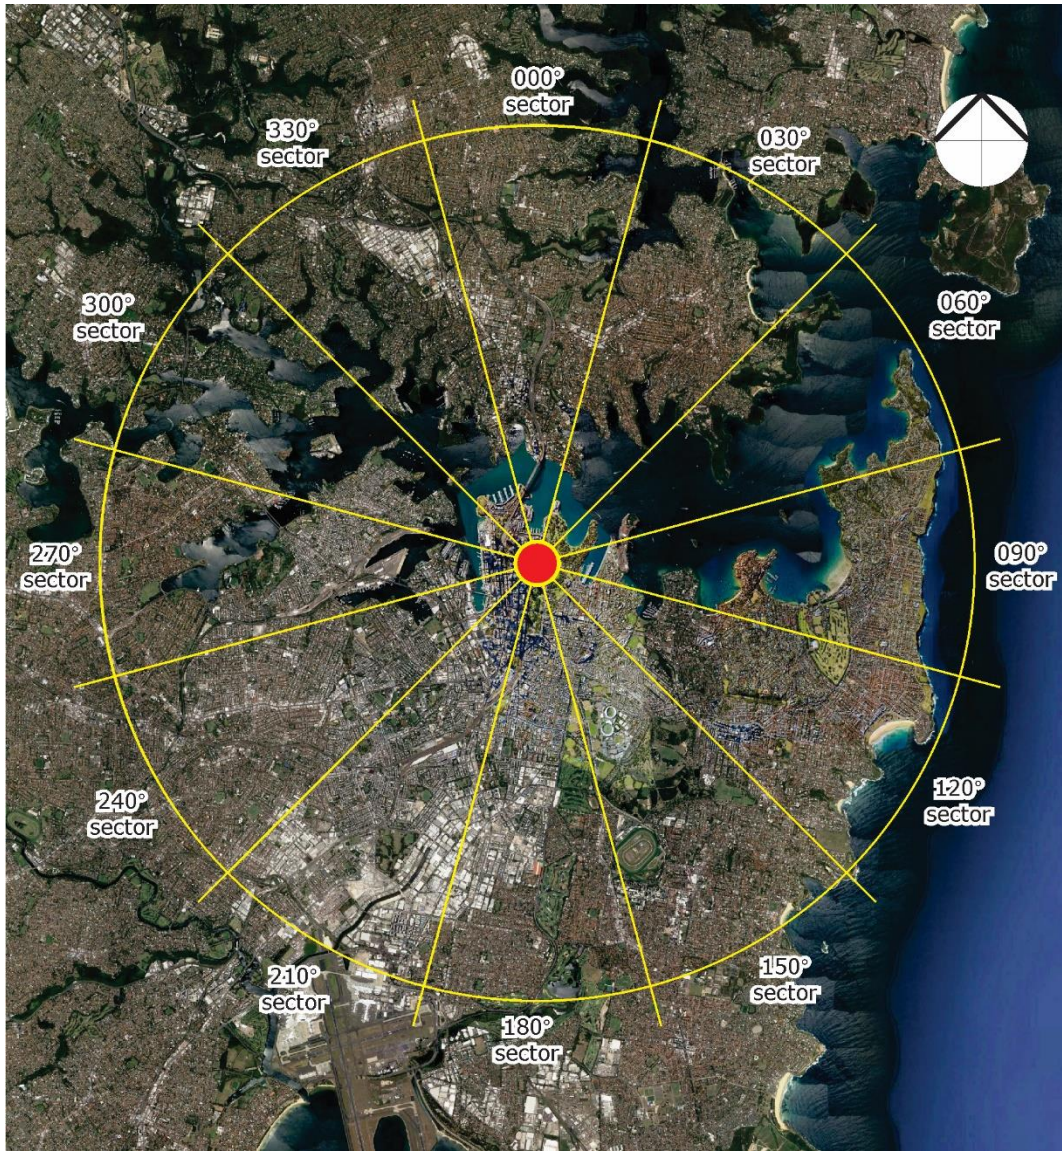


Figure 3: Aerial Image of the Surrounding Terrain (radius of 5.4km from the edge of the proximity model)

4 REGIONAL WIND MODEL

The regional wind model used in this study was determined from an analysis of measured directional mean wind speeds obtained at the meteorological recording station located at Kingsford Smith Airport (Sydney Airport). Data was collected from 1995 to 2016 and corrected so that it represents winds over standard open terrain at a height of 10m above ground for each wind direction. From this analysis, directional probabilities of exceedance and directional wind speeds for the region are determined. The directional wind speeds are summarised in Table 2. The directional wind speeds and corresponding directional frequencies of occurrence are presented in Figure 4.

The data indicates that the southerly winds are by far the most frequent winds for the Sydney region, and are also the strongest. The westerly winds occur most frequently during the winter season for the Sydney region, and although they are typically not as strong as the southerly winds, they are usually a cold wind and hence can be a cause for discomfort for outdoor areas. North-easterly winds occur most frequently occur during the warmer months of the year for the Sydney region, and hence are usually welcomed within outdoor areas since they are typically not as strong as the southerly or westerly winds.

The recurrence intervals examined in this study are for exceedances of 5% (per 90 degree sector) of the pedestrian comfort criteria using Gust-Equivalent Mean (GEM) wind speeds, and annual maximum wind speeds (per 22.5 degree sector) for the pedestrian safety criterion. Note that the 5% probability wind speeds presented in Table 2 are only used for the directional plot presented in Figure 4 and are not used for the integration of the probabilities.

Table 2: Regional Directional Wind Speeds (hourly means, at 10m height in standard open terrain) (m/s)

Wind Direction	5% Exceedance	Annual Maximum
N	5.9	9.9
NNE	9.9	12.9
NE	9.7	12.3
ENE	7.5	10.0
E	6.3	9.3
ESE	6.2	9.1
SE	7.0	10.1
SSE	8.5	12.2
S	10.3	13.9
SSW	10.0	14.1
SW	6.9	11.9
WSW	9.3	13.6
W	9.8	14.4
WNW	8.8	14.3
NW	6.7	12.6
NNW	5.5	10.7

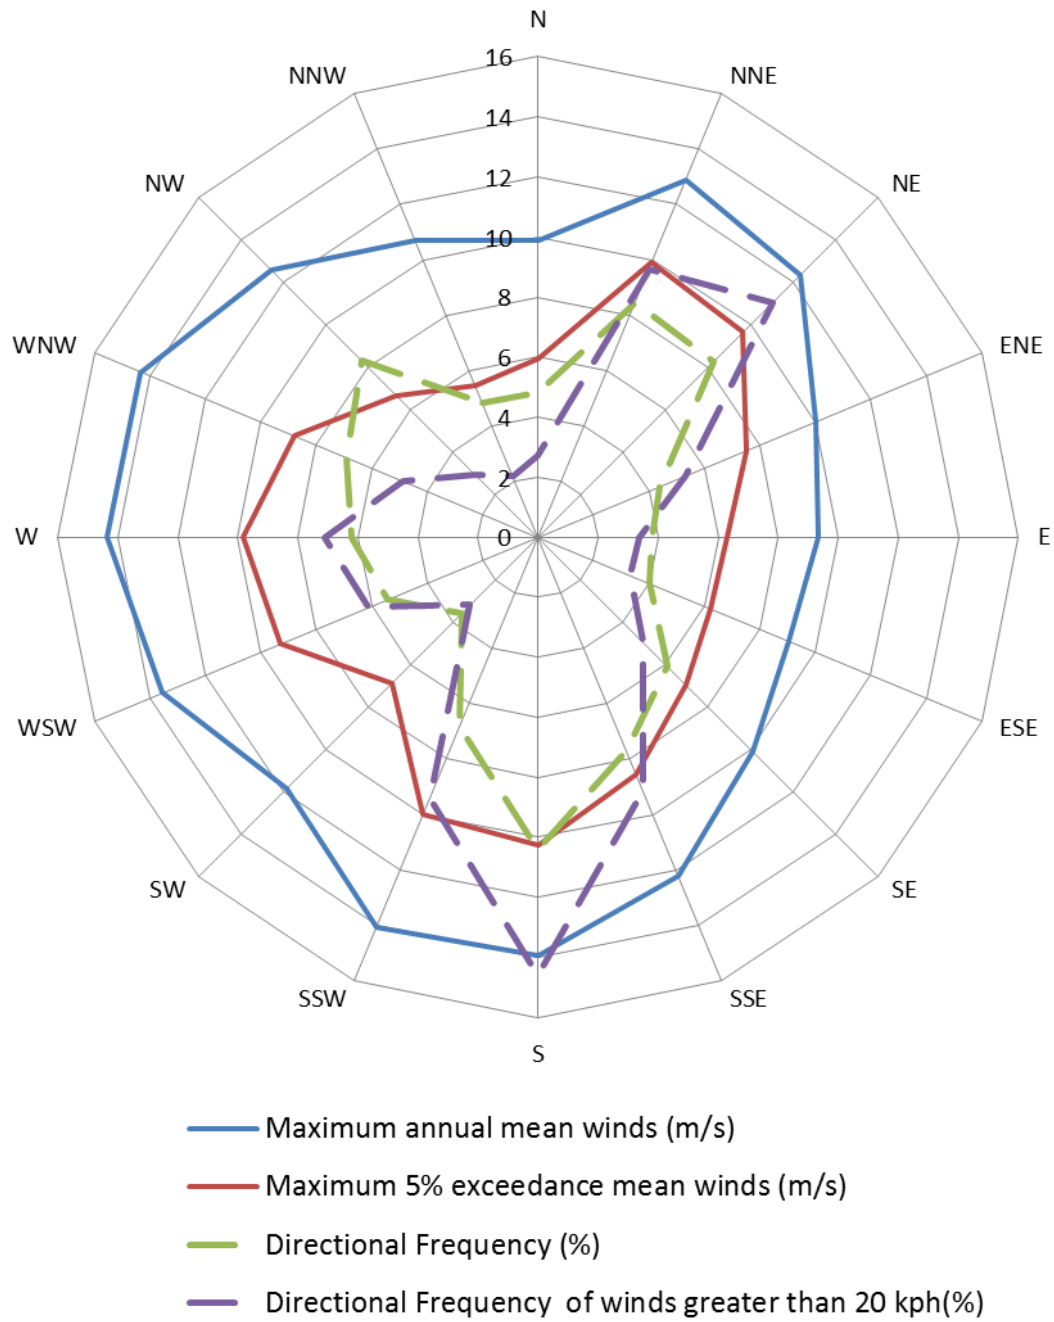


Figure 4: Annual and 5% Exceedance Hourly Mean Wind Speeds, and Frequencies of Occurrence, for the Sydney Region (at 10m height in standard open terrain)

PEDESTRIAN WIND COMFORT AND SAFETY

The acceptability of wind conditions for an area is determined by comparing the measured wind speeds against an appropriate criteria. This section outlines how the measured wind speeds were obtained, the criteria considered for the development, as well as the critical trafficable areas that were assessed and their corresponding criteria designation.

5.1 Measured Wind Speeds

Wind speeds were measured using either Dantec hot-wire probe anemometers or pressure-based wind speed sensors, positioned to monitor wind conditions at critical outdoor trafficable areas of the development. The reference mean free-stream wind speed measured in the wind tunnel, which is at a full-scale height of 200m and measured 3m upstream of the study model.

Measurements were acquired for 16 wind directions at 22.5 degree increments using a sample rate of 1,024Hz. The full methodology of determining the wind speed measurements at the site from either the Dantec Hot-wire probe anemometers or pressure-based wind speed sensors is provided in Appendix B. Based on the results of the analysis of the boundary layer wind profiles at the site (see Section 3), and incorporating the regional wind model (see Section 4), the data sampling length of the wind tunnel test for each wind direction corresponds to a full-scale sample length ranging between 30 minutes and 1 hour. Research by A.W. Rofail and K.C.S. Kwok (1991) has shown that, in addition to the mean and standard deviation of the wind being stable for sample lengths of 15 minutes or more (full-scale), the peak value determined using the upcrossing method is stable for sample lengths of 30 minutes or more.

5.2 Wind Speed Criteria Used for This Study

For this study, the measured wind conditions for the various critical outdoor trafficable areas around the subject development are compared against the criteria presented in the Draft Sydney Development Control Plan 2012 - Central Sydney Planning Review Amendment, which supersedes the criteria detailed in the City of Sydney Development Control Plan 2012 (SDCP2012).

For pedestrian comfort, the Draft Sydney DCP 2012 requires that the hourly mean wind speed, or Gust-Equivalent Mean (GEM) wind speed (whichever is greater for each wind direction), must not exceed 8m/s for walking, 6m/s for standing, and 4m/s for sitting. These are based on a 5% probability of exceedance.

For pedestrian safety, the Draft Sydney DCP 2012 defines a safety limit criterion of 24m/s, based on an annual maximum 0.5 second gust wind speed, which applies to all areas.

Furthermore, in accordance with the provisions of the Draft Sydney DCP 2012, the existing conditions for the pedestrian footpaths around the site are also analysed as part of this study to determine the impact of the subject development. If it is found that the existing conditions exceed the relevant criteria, then the target wind speed for that area with the inclusion of the proposed development is to at least match the existing site conditions.

In accordance with the provisions of the Draft Sydney DCP 2012, the wind speed assessment is undertaken for winds occurring between 6am and 10pm (AEST).

A more detailed comparison of published criteria for pedestrian wind comfort and safety is provided in Appendix A.

For this study the measured wind conditions of the selected critical outdoor trafficable areas are compared against two sets of criteria; one for pedestrian safety, and one for pedestrian comfort. The safety criterion is applied to the annual maximum gust winds, and the comfort criteria is applied to Gust Equivalent Mean (GEM) winds. In accordance with ASCE (2003), the GEM wind speed is defined as follows:

$$GEM = \max\left(\bar{V}, \frac{\hat{V}}{1.85}\right) \quad (5.1)$$

where:

\bar{V} is the mean wind speed.

\hat{V} is the gust wind speed.

The criteria considered in this study are summarised in Tables 3 and 4 for pedestrian comfort and safety, respectively. The results of the wind tunnel study are presented in the form of directional plots attached in Appendix C of this report. For each study point there is a plot of the GEM wind speeds using the comfort criteria, and a plot for the annual maximum gust wind speeds using the safety criterion.

Table 3: Pedestrian Comfort Criteria (Draft Sydney DCP 2012)

Classification	Description	Maximum 5% Exceedance GEM Wind Speed (m/s)
Sitting	Outdoor areas that involve seating such as parks, dining areas in restaurants, amphitheatres, etc.	4
Standing	Short duration stationary activities (generally less than 1 hour), including window shopping, waiting areas, etc.	6
Walking	For pedestrian thoroughfares, private swimming pools, most communal areas, private balconies and terraces, etc.	8

Table 4: Pedestrian Safety Criterion (Draft Sydney DCP 2012)

Classification	Description	Annual Maximum Gust Wind Speed (m/s)
Safety	Safety criterion applies to all trafficable areas.	24

5.3 Layout of Study Points

For this study a total of 23 study point locations were selected for analysis in the wind tunnel. This includes the following:


- 23 study points on Ground floor along the pedestrian footpaths, and around the Chifley Square area.

The locations of the various study points tested for this study, as well as the target wind speed criteria for the various outdoor trafficable areas of the development, are presented in Figure 5 in the form of a marked-up plan. It should be noted that only the most critical outdoor locations of the development have been selected for analysis.

Target Criteria

- City of Sydney DCP in accordance with Sydney DCP 2012 - Central Sydney Planning Review Amendment:
 - Wind Comfort Standard for Walking criterion of 8m/s (5% exceedance) for walking
 - Safety criterion of 24m/s (gust - 0.1% exceedance) for safety

- City of Sydney DCP in accordance with Sydney DCP 2012 - Central Sydney Planning Review Amendment:
 - Wind Comfort Standard for Standing criterion of 6m/s (5% exceedance) for standing
 - Safety criterion of 24m/s (gust - 0.1% exceedance) for safety

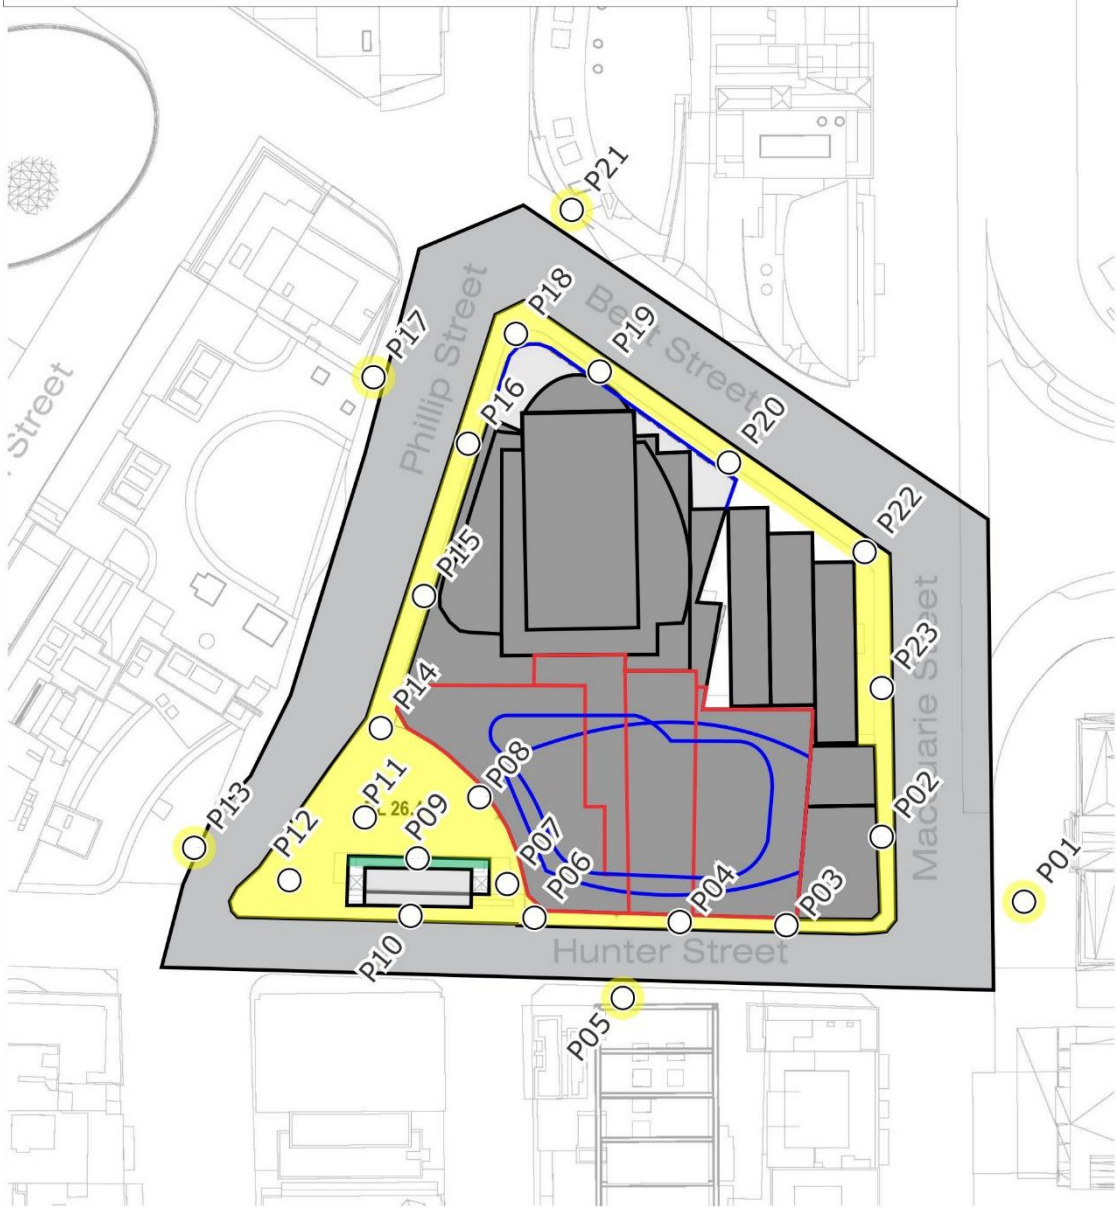

Ground Level

Figure 5: Study Point Locations and Target Wind Speed Criteria – Ground Floor Plan

6 RESULTS AND DISCUSSION

The results of the wind tunnel study are presented in the form of directional plots in Appendix C for all study points locations, summarised in Tables 9, and shown on marked-up plans in Figures 6.

Several scenarios were tested as follows:

- Case 1: With the existing surrounding buildings. In this report, this test case is referred to as the "Existing Scenario".
- Case 2: With the Base Case building and existing surrounding buildings. In this report, this test case is referred to as the "Base Case".
- Case 3: With the Proposed Envelope building and existing surrounding buildings. In this report, this test case is referred to as the "Proposed Envelope Scenario".

The wind speed criteria that the wind conditions should achieve are also listed in Tables 5 to 9 for each study point location, as well as in Figure 5.

The site is predominantly impacted by the prevailing north-easterly winds due to the exposure of the CBD from the east, whereas the prevailing westerly and southerly winds are relatively shielded due the neighbouring high-rise developments. For the Base Case and Proposed Envelope Scenarios, the prevailing winds are shown to interact with the tower façade and consequently impact the surrounding areas at ground level. Additionally, the results indicate that the existing site is exposed to adverse wind conditions at localised areas along Macquarie Street, Hunter Street, Phillip Street and Bent Street that exceed the recommended wind comfort criteria and safety criteria. For the existing case, the eastern edge of the CBD along Macquarie Street is subject to adverse wind conditions from the east and south due a lack of shielding provided by a tower envelope. Similarly, conditions for the existing case along Hunter Street are subject to stronger downwash effects from the north-easterly winds impacting buildings on the opposite side of the street. Conditions within the Proposed Envelope are shown to have improved wind conditions within these areas which can be attributed to the tower envelope capturing the north-easterly winds and funnelling them towards the western end of the site through the channel created by the existing Chifley Tower.

The results of the study also demonstrate that the Proposed Envelope exhibits comfortable wind conditions relative to the Base Case, utilising a comparison of the average wind speed of the equivalent 5% exceedance wind speeds listed in Table 6 for each scenario.

We have noted that there are some areas of the Proposed Envelope that experience adverse wind conditions which exceed the relevant criteria for comfort and/or safety. However, these exceedances are shown to be present in the Existing Scenario and can be therefore considered a pre-existing condition. In addition, the Proposed Envelope demonstrates improved comfort and safety wind conditions relative to the Existing Scenario utilising a comparison of the average wind speed of the equivalent 5% exceedance wind speeds listed in Table 6.

However, it is also observed that some areas in all three cases experience adverse wind conditions which exceed the relevant criteria for comfort and/or safety. In the areas where the wind conditions of the Proposed Envelope exceed the wind conditions of the Existing Scenario, these concerns will be addressed with wind

tunnel testing during the detailed design stage and recommendations of mitigation measures. Given the assessment is currently limited to a sheer massing envelope, the detailed design is also expected to introduce building elements that may further improve the wind conditions within and around the site. As a general note, the use of loose glass-tops and light-weight sheets or covers (including loose BBQ lids) is not appropriate on high-rise outdoor terraces and balconies. Furthermore, lightweight furniture is not recommended unless it is securely attached to the balcony or terrace floor slab.

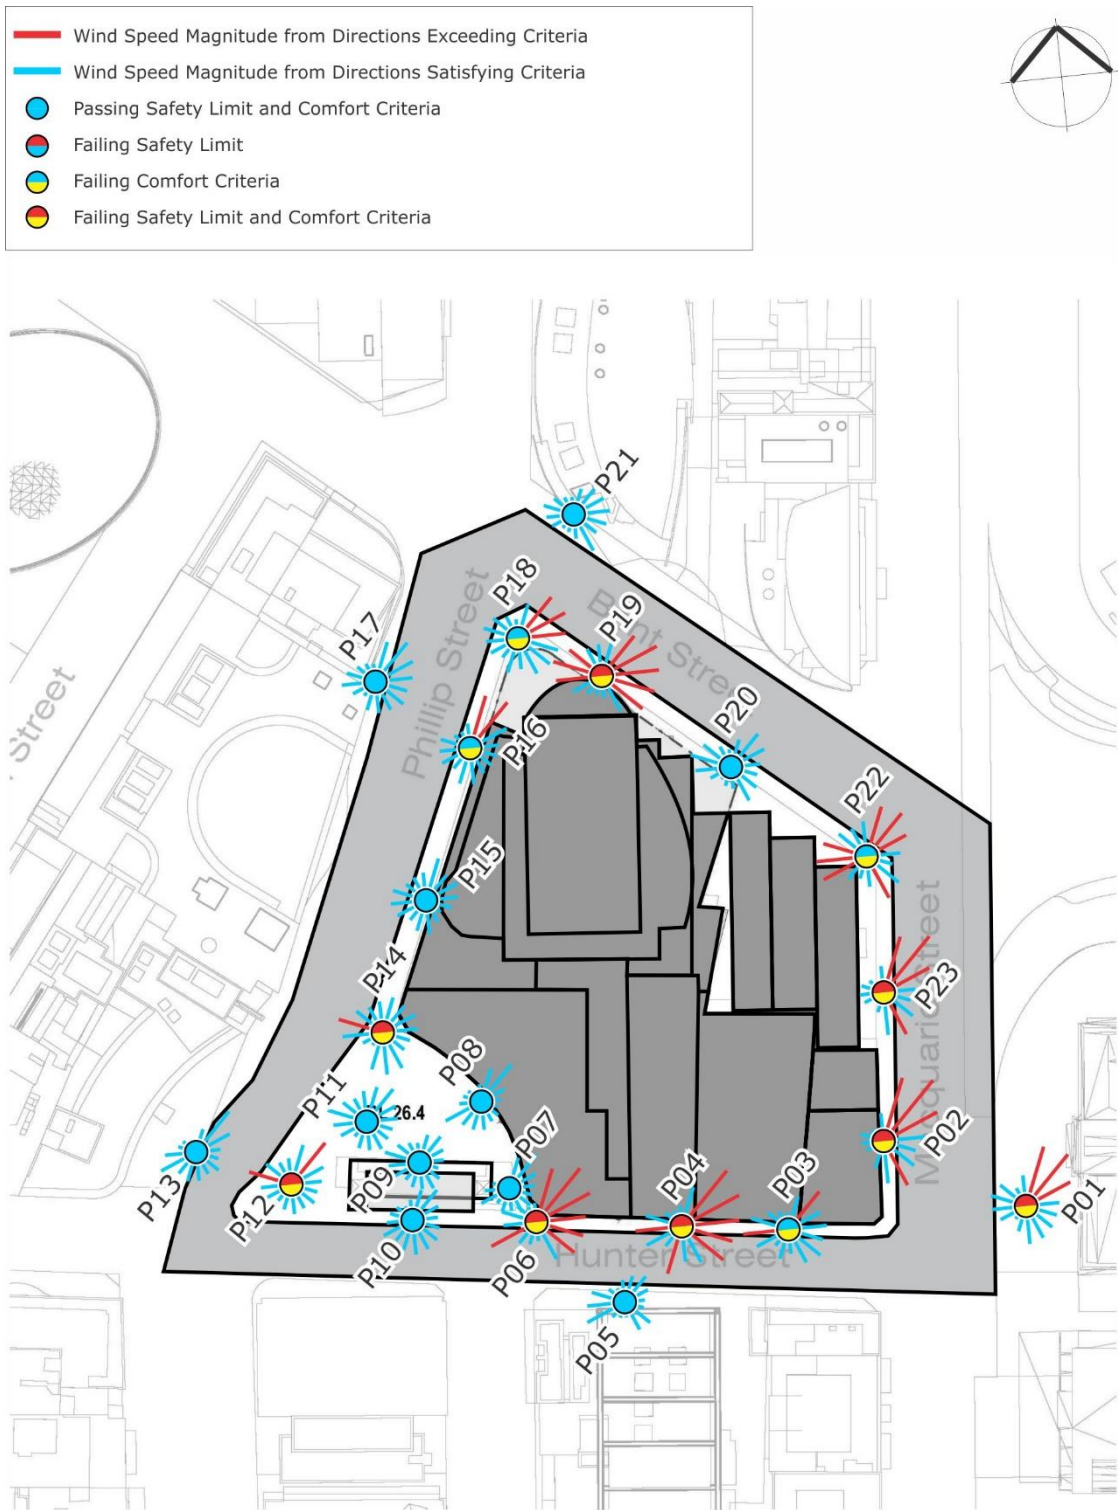


Figure 6a: Wind Tunnel Results – Case 1: Existing Scenario
(results shown without treatments applied)

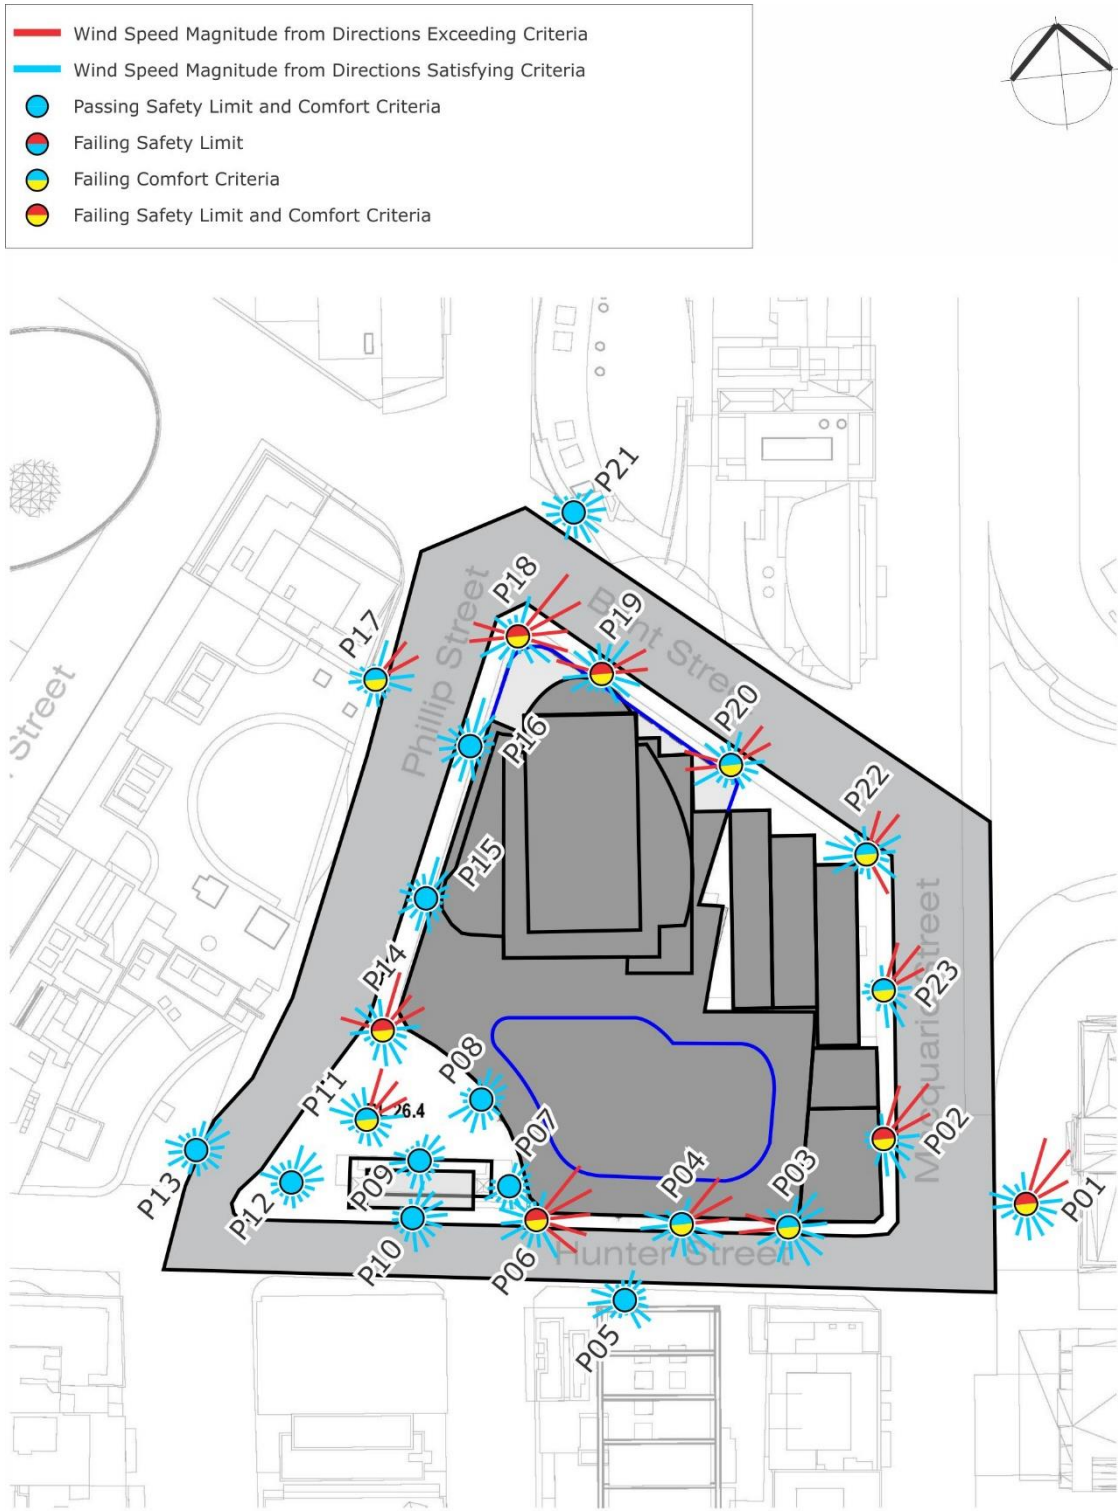


Figure 6b: Wind Tunnel Results – Case 2: Base Case
(results shown without treatments applied)

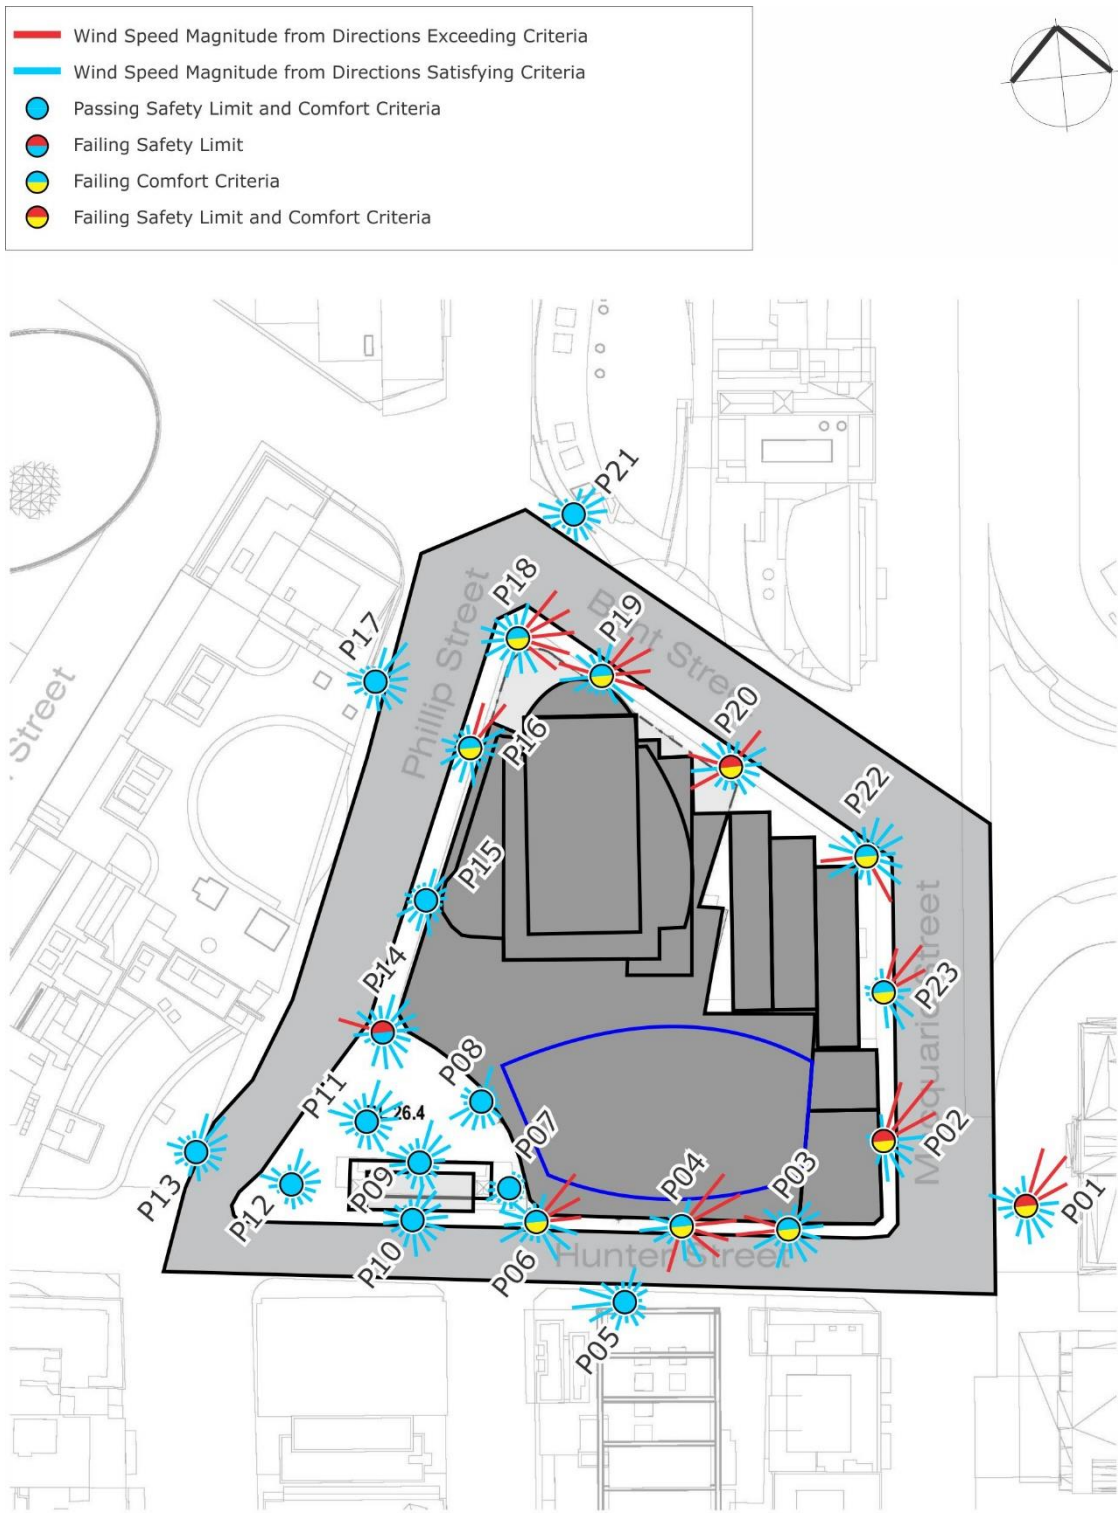


Figure 6c: Wind Tunnel Results – Case 3: Proposed Envelope Scenario
(results shown without treatments applied)

Table 5: Target Wind Speed Comfort Criteria

Legend	
Comfort Criteria	Wind Speed range (m/s)
Pedestrian Sitting	2 - 4
Pedestrian Standing	4 - 6
Pedestrian Walking	6 - 8
Uncomfortable	> 8

Table 6: Equivalent 5% Exceedance Wind Speeds and Target Criteria

Equivalent 5% exceedance wind speeds (m/s)				
Test Location	Criteria	Existing Scenario	Base Case	Proposed Envelope Scenario
P01	6 - 8	10.4	11.1	10.0
P02	6 - 8	12.0	10.7	11.6
P03	6 - 8	8.2	8.6	8.3
P04	6 - 8	11.7	9.8	11.2
P05	6 - 8	6.7	6.4	7.9
P06	6 - 8	11.1	11.2	9.7
P07	6 - 8	6.5	5.0	4.1
P08	6 - 8	7.3	6.2	6.1
P09	4 - 6	4.6	4.2	5.1
P10	6 - 8	6.6	6.6	7.0
P11	6 - 8	7.2	8.6	7.4
P12	6 - 8	8.3	6.6	6.0
P13	6 - 8	7.8	6.6	7.1
P14	6 - 8	8.0	9.3	7.9
P15	6 - 8	7.2	6.7	6.0
P16	6 - 8	9.2	7.7	8.6
P17	6 - 8	8.0	8.1	7.6
P18	6 - 8	9.2	12.4	10.6
P19	6 - 8	10.8	8.7	9.4
P20	6 - 8	7.4	8.5	8.2
P21	6 - 8	6.9	6.4	6.3
P22	6 - 8	9.8	8.6	8.9
P23	6 - 8	10.9	8.9	9.2
Average		8.5	8.1	8.0

Table 7: Target Wind Speed Safety Criteria

Legend	
Safety Criteria (m/s)	Result
<24	Pass
≥24	Fail

Table 8: Annual Gust Wind Speed and Safety Criteria

Safety - Annual Gust Speed				
Test Location	Criteria	Existing Scenario	Base Case	Proposed Envelope Scenario
P01	24	25	26	25
P02	24	28	25	28
P03	24	21	21	21
P04	24	27	23	23
P05	24	18	18	23
P06	24	27	28	24
P07	24	20	14	13
P08	24	22	19	18
P09	24	16	12	15
P10	24	17	17	18
P11	24	23	22	23
P12	24	25	19	19
P13	24	24	18	18
P14	24	25	25	26
P15	24	20	17	17
P16	24	23	20	23
P17	24	22	21	22
P18	24	22	28	24
P19	24	25	26	23
P20	24	20	24	26
P21	24	19	18	21
P22	24	24	21	22
P23	24	26	24	24
Average		23	21	21

Table 9a: Wind Tunnel Results Summary – Case 1: Existing Scenario

Study Point	GEM (5% exceedance)			Annual Gust			Final Result	Description of Treatment
	Criterion (m/s)	Results (%)	Grade	Criterion (m/s)	Results (m/s)	Grade		
P01	8.0	16%	Fail	24	25	Fail	Fail	
P02	8.0	20%	Fail	24	28	Fail	Fail	
P03	8.0	7%	Fail	24	21	Pass	Fail	
P04	8.0	23%	Fail	24	27	Fail	Fail	
P05	8.0	2%	Pass	24	18	Pass	Pass	
P06	8.0	23%	Fail	24	27	Fail	Fail	
P07	8.0	1%	Pass	24	20	Pass	Pass	
P08	8.0	3%	Pass	24	22	Pass	Pass	
P09	6.0	1%	Pass	24	15	Pass	Pass	
P10	8.0	1%	Pass	24	17	Pass	Pass	
P11	8.0	3%	Pass	24	23	Pass	Pass	
P12	8.0	7%	Fail	24	25	Fail	Fail	
P13	8.0	5%	Pass	24	24	Pass	Pass	
P14	8.0	6%	Fail	24	25	Fail	Fail	
P15	8.0	3%	Pass	24	20	Pass	Pass	
P16	8.0	12%	Fail	24	23	Pass	Fail	
P17	8.0	5%	Pass	24	22	Pass	Pass	
P18	8.0	13%	Fail	24	22	Pass	Fail	
P19	8.0	19%	Fail	24	25	Fail	Fail	
P20	8.0	3%	Pass	24	20	Pass	Pass	
P21	8.0	2%	Pass	24	19	Pass	Pass	
P22	8.0	18%	Fail	24	24	Pass	Fail	
P23	8.0	18%	Fail	24	26	Fail	Fail	

The test results shown in Tables 2749 are without any treatments applied. Green indicates where the relevant criteria has passed and red indicates where the relevant criteria has failed.

Table 9b: Wind Tunnel Results Summary – Case 2: Base Case

Study Point	GEM (5% exceedance)			Annual Gust			Final Result	Description of Treatment
	Criterion (m/s)	Results (%)	Grade	Criterion (m/s)	Results (m/s)	Grade		
P01	8.0	16%	Fail	24	26	Fail	Fail	
P02	8.0	17%	Fail	24	25	Fail	Fail	
P03	8.0	9%	Fail	24	21	Pass	Fail	
P04	8.0	15%	Fail	24	23	Pass	Fail	
P05	8.0	2%	Pass	24	18	Pass	Pass	
P06	8.0	20%	Fail	24	28	Fail	Fail	
P07	8.0	< 1%	Pass	24	14	Pass	Pass	
P08	8.0	1%	Pass	24	19	Pass	Pass	
P09	6.0	< 1%	Pass	24	12	Pass	Pass	
P10	8.0	1%	Pass	24	17	Pass	Pass	
P11	8.0	9%	Fail	24	22	Pass	Fail	
P12	8.0	1%	Pass	24	18	Pass	Pass	
P13	8.0	1%	Pass	24	18	Pass	Pass	
P14	8.0	11%	Fail	24	25	Fail	Fail	
P15	8.0	2%	Pass	24	17	Pass	Pass	
P16	8.0	4%	Pass	24	20	Pass	Pass	
P17	8.0	6%	Fail	24	21	Pass	Fail	
P18	8.0	21%	Fail	24	28	Fail	Fail	
P19	8.0	9%	Fail	24	26	Fail	Fail	
P20	8.0	8%	Fail	24	24	Pass	Fail	
P21	8.0	1%	Pass	24	18	Pass	Pass	
P22	8.0	9%	Fail	24	21	Pass	Fail	
P23	8.0	11%	Fail	24	24	Pass	Fail	

The test results shown in Tables 2749 are without any treatments applied. Green indicates where the relevant criteria has passed and red indicates where the relevant criteria has failed.

Table 9c: Wind Tunnel Results Summary – Case 3: Proposed Envelope Scenario

Study Point	GEM (5% exceedance)			Annual Gust			Final Result	Description of Treatment
	Criterion (m/s)	Results (%)	Grade	Criterion (m/s)	Results (m/s)	Grade		
P01	8.0	15%	Fail	24	25	Fail	Fail	
P02	8.0	18%	Fail	24	26	Fail	Fail	
P03	8.0	7%	Fail	24	21	Pass	Fail	
P04	8.0	19%	Fail	24	23	Pass	Fail	
P05	8.0	5%	Pass	24	23	Pass	Pass	
P06	8.0	15%	Fail	24	24	Pass	Fail	
P07	8.0	< 1%	Pass	24	13	Pass	Pass	
P08	8.0	1%	Pass	24	18	Pass	Pass	
P09	6.0	2%	Pass	24	15	Pass	Pass	
P10	8.0	2%	Pass	24	18	Pass	Pass	
P11	8.0	3%	Pass	24	23	Pass	Pass	
P12	8.0	1%	Pass	24	18	Pass	Pass	
P13	8.0	2%	Pass	24	18	Pass	Pass	
P14	8.0	5%	Pass	24	26	Fail	Fail	
P15	8.0	1%	Pass	24	17	Pass	Pass	
P16	8.0	9%	Fail	24	23	Pass	Fail	
P17	8.0	4%	Pass	24	22	Pass	Pass	
P18	8.0	20%	Fail	24	24	Pass	Fail	
P19	8.0	13%	Fail	24	22	Pass	Fail	
P20	8.0	6%	Fail	24	26	Fail	Fail	
P21	8.0	1%	Pass	24	21	Pass	Pass	
P22	8.0	11%	Fail	24	22	Pass	Fail	
P23	8.0	11%	Fail	24	24	Pass	Fail	

The test results shown in Tables 2749 are without any treatments applied. Green indicates where the relevant criteria has passed and red indicates where the relevant criteria has failed.

American Society of Civil Engineers (ASCE), 2003, "Outdoor Human Comfort and its Assessment – State of the Art".

American Society of Civil Engineers (ASCE), ASCE-7-16, 2016, "Minimum Design Loads for Buildings and Other Structures".

Australasian Wind Engineering Society, QAM-1, 2019, "Quality Assurance Manual: Wind Engineering Studies of Buildings", edited by Rofail A.W., et al.

Australasian Wind Engineering Society (AWES), 2014, "Guidelines for Pedestrian Wind Effects Criteria".

Council on Tall Buildings and Urban Habitat (CTBUH), 2013, "Wind tunnel testing of high-rise buildings", CTBUH Technical Guides.

Davenport, A.G., 1972, "An approach to human comfort criteria for environmental conditions". Colloquium on Building Climatology, Stockholm.

Deaves, D.M. and Harris, R.I., 1978, "A mathematical model of the structure of strong winds." Construction Industry and Research Association (U.K), Report 76.

Engineering Science Data Unit, 1982, London, ESDU82026, "Strong Winds in the Atmospheric Boundary Layer, Part 1: Hourly Mean Wind Speeds", with Amendments A to E (issued in 2002).

Melbourne, W.H., 1978, "Criteria for Environmental Wind Conditions". Journal of Wind Engineering and Industrial Aerodynamics, vol. 3, pp241-249.

Rofail, A.W., and Kwok, K.C.S., 1991, "A Reliability Study of Wind Tunnel Results of Cladding Pressures". Proceedings of the 8th International Conference on Wind Engineering, Canada.

Rofail, A.W., 2007, "Comparison of Wind Environment Criteria against Field Observations". 12th International Conference of Wind Engineering, Cairns, Australia.

Standards Australia and Standards New Zealand, AS/NZS 1170.2, 2011, "SAA Wind Loading Standard, Part 2: Wind Actions".

APPENDIX A PUBLISHED ENVIRONMENTAL CRITERIA

A.1 Wind Effects on People

The acceptability of wind in an area is dependent upon the use of the area. For example, people walking or window-shopping will tolerate higher wind speeds than those seated at an outdoor restaurant. Quantifying wind comfort has been the subject of much research and many researchers, such as A.G. Davenport, T.V. Lawson, W.H. Melbourne, and A.D. Penwarden, have published criteria for pedestrian comfort for pedestrians in outdoor spaces for various types of activities. This section discusses and compares the various published criteria.

A.2 A.D. Penwarden (1973) Criteria for Mean Wind Speeds

A.D. Penwarden (1973) developed a modified version of the Beaufort scale which describes the effects of various wind intensities on people. Table A.1 presents the modified Beaufort scale. Note that the effects listed in this table refers to wind conditions occurring frequently over the averaging time (a probability of occurrence exceeding 5%). Higher ranges of wind speeds can be tolerated for rarer events.

Table A.1: Summary of Wind Effects on People (A.D. Penwarden, 1973)

Type of Winds	Beaufort Number	Hourly Mean Wind Speed (m/s)	Effects
Calm	0	0 - 0.3	
Calm, light air	1	0.3 - 1.6	No noticeable wind
Light breeze	2	1.6 - 3.4	Wind felt on face
Gentle breeze	3	3.4 - 5.5	Hair is disturbed, clothing flaps, newspapers difficult to read
Moderate breeze	4	5.5 - 8.0	Raises dust, dry soil and loose paper, hair disarranged
Fresh breeze	5	8.0 - 10.8	Force of wind felt on body, danger of stumbling
Strong breeze	6	10.8 - 13.9	Umbrellas used with difficulty, hair blown straight, difficult to walk steadily, wind noise on ears unpleasant
Near gale	7	13.9 - 17.2	Inconvenience felt when walking
Gale	8	17.2 - 20.8	Generally impedes progress, difficulty balancing in gusts
Strong gale	9	20.8 - 24.5	People blown over

A.3 A.G. Davenport (1972) Criteria for Mean Wind Speeds

A.G. Davenport (1972) also determined a set of criteria in terms of the Beaufort scale and for various return periods. Table A.2 presents a summary of the criteria based on a probability of exceedance of 5%.

Table A.2: Criteria by A.G. Davenport (1972)

Classification	Activities	5% exceedance Mean Wind Speed (m/s)
Walking Fast	Acceptable for walking, main public accessways.	7.5 - 10.0
Strolling, Skating	Slow walking, etc.	5.5 - 7.5
Short Exposure Activities	Generally acceptable for walking & short duration stationary activities such as window-shopping, standing or sitting in plazas.	3.5 - 5.5
Long Exposure Activities	Generally acceptable for long duration stationary activities such as in outdoor restaurants & theatres and in parks.	0 - 3.5

A.4 T.V. Lawson (1975) Criteria for Mean Wind Speeds

In 1973, T.V. Lawson, while referring to the Beaufort wind speeds of A.D. Penwarden (1973) (as listed in Table A.1), quoted that a Beaufort 4 wind speed would be acceptable if it is not exceeded for more than 4% of the time, and that a Beaufort 6 wind speed would be unacceptable if it is exceeded more than 2% of the time. Later, in 1975, T.V. Lawson presented a set of criteria very similar to those presented in A.G. Davenport (1972) (as listed in Table A.2). These criteria are presented in Table A.3 and Table A.4 for safety and comfort respectively.

Table A.3: Safety Criteria by T.V. Lawson (1975)

Classification	Activities	Annual Mean Wind Speed (m/s)
Safety (all weather areas)	Accessible by the general public.	0 – 15
Safety (fair weather areas)	Private areas, balconies/terraces, etc.	0 – 20

Table A.4: Comfort Criteria by T.V. Lawson (1975)

Classification	Activities	5% exceedance Mean Wind Speed (m/s)
Business Walking	Objective Walking from A to B.	8 - 10
Pedestrian Walking	Slow walking, etc.	6 - 8
Short Exposure Activities	Pedestrian standing or sitting for short times.	4 – 6
Long Exposure Activities	Pedestrian sitting for a long duration.	0 - 4

A.5 W.H. Melbourne (1978) Criteria for Gust Wind Speeds

W.H. Melbourne (1978) introduced a set of criteria for the assessment of environmental wind conditions that were developed for a temperature range of 10°C to 30°C and for people suitably dressed for outdoor conditions. These criteria are presented in Table A.5, and are based on maximum gust wind speeds with a probability of exceedance of once per year.

Table A.5: Criteria by W.H. Melbourne (1978)

Classification	Activities	Annual Gust Wind Speed (m/s)
Limit for Safety	Completely unacceptable: people likely to get blown over.	23
Marginal	Unacceptable as main public accessways.	16 - 23
Comfortable Walking	Acceptable for walking, main public accessways	13 - 16
Short Exposure Activities	Generally acceptable for walking & short duration stationary activities such as window-shopping, standing or sitting in plazas.	10 - 13
Long Exposure Activities	Generally acceptable for long duration stationary activities such as in outdoor restaurants & theatres and in parks.	0 - 10

A.6 Comparison of the Published Wind Speed Criteria

W.H. Melbourne (1978) presented a comparison of the criteria of various researchers on a probabilistic basis. Figure A.1 presents the results of this comparison, and indicates that the criteria of W.H. Melbourne (1978) are comparatively quite conservative. This conclusion was also observed by A.W. Rofail (2007) when undertaking on-site remedial studies. The results of A.W. Rofail (2007) concluded that the criteria by W.H. Melbourne (1978) generally overstates the wind effects in a typical urban setting due to the assumption of a fixed 15% turbulence intensity for all areas. It was observed in A.W. Rofail (2007) that the 15% turbulence intensity assumption is not real and that the turbulence intensities at 1.5m above ground is at least 20% and in a suburban or urban setting is generally in the range of 30% to 60%.

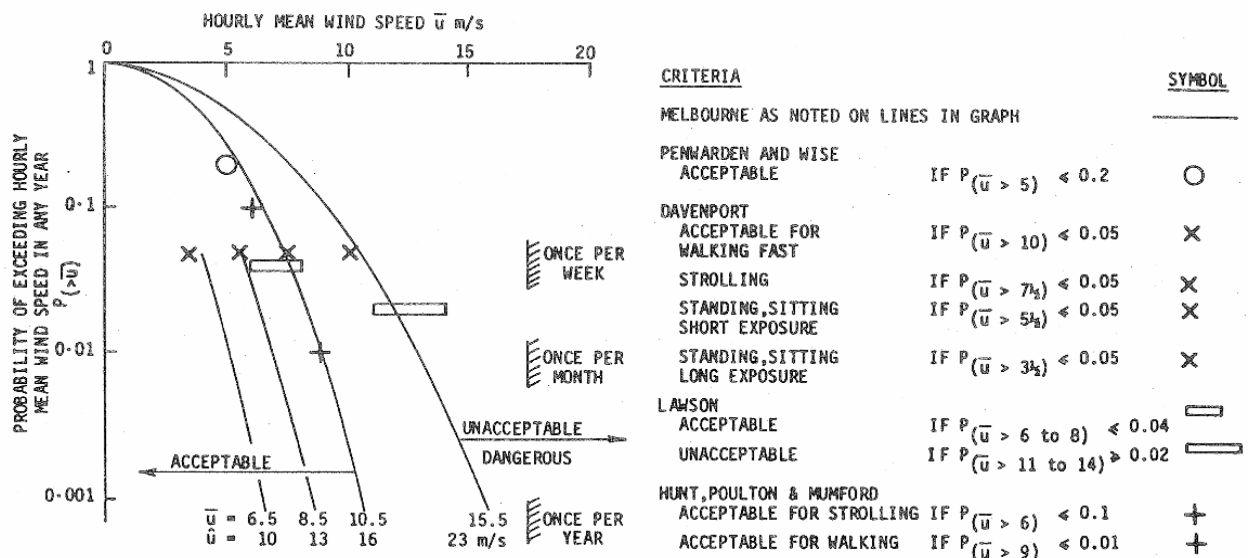


Figure A.1: Comparison of Various Mean and Gust Wind Environment Criteria, assuming 15% turbulence and a Gust Factor of 1.5 (W.H. Melbourne, 1978)

A.7 References relating to Pedestrian Comfort Criteria

Davenport, A.G., 1972, "An approach to human comfort criteria for environmental conditions". Colloquium on Building Climatology, Stockholm.

Davenport, A.G., 1977, "The prediction of risk under wind loading", 2nd International Conference on Structural Safety and Reliability, Munich, Germany, pp511-538.

Lawson, T.V., 1973, "The wind environment of buildings: a logical approach to the establishment of criteria". Bristol University, Department of Aeronautical Engineering.

Lawson, T.V., 1975, "The determination of the wind environment of a building complex before construction". Bristol University, Department of Aeronautical Engineering.

Melbourne, W.H., 1978, "Criteria for Environmental Wind Conditions". Journal of Wind Engineering and Industrial Aerodynamics, vol. 3, pp241-249.

Penwarden, A.D. (1973). "Acceptable Wind Speeds in Towns", Building Science, vol. 8: pp259-267.

Penwarden, A.D., Wise A.F.E., 1975, "Wind Environment Around Buildings". Building Research Establishment Report, London.

Rofail, A.W., 2007, "Comparison of Wind Environment Criteria against Field Observations". 12th International Conference of Wind Engineering, Cairns, Australia.

APPENDIX B DATA ACQUISITION

The wind tunnel testing procedures utilised for this study were based on the guidelines set out in the Australasian Wind Engineering Society Quality Assurance Manual (AWES-QAM-1-2019), ASCE 7-16 (Chapter C31), and CTBUH (2013). The wind speed measurements for the wind tunnel study were determined as coefficients using data acquired by either Dantec hot-wire probe anemometers or pressure-based wind speed sensors and converted to full-scale wind speeds using details of the regional wind climate obtained from an analysis of directional wind speed recordings from the local meteorological recording station(s).

B.1 Measurement of the Velocity Coefficients

The study model and proximity model were setup within the wind tunnel which was configured to the appropriate boundary layer profile, and the wind velocity measurements were monitored using either Dantec hot-wire probe anemometers or pressure-based wind speed sensors at selected critical outdoor locations. The wind velocity results presented in this study for each study point are representative of wind at a full-scale height of approximately 1.5m above ground/slab level. In the case of the Dantec hot-wire probe anemometers, the support of the probe is mounted such that the probe wire is vertical as much as possible to ensure that the measured wind speeds are independent of wind direction along the horizontal plane. In addition, care was taken in the alignment of the hot-wire probe wire and in avoiding wall-heating effects.

Wind speed measurements were made in the wind tunnel for 16 wind directions, at 22.5° increments. Data was acquired for each wind direction using a sample rate of 1024Hz. The sample length was determined to produce a full-scale sample time that is sufficient for this type of study. In the case of the pressure-based wind speed sensors, the phase lag between the various channels where data is acquired simultaneously is within 10% of a typical pressure cycle, and the signal is low-pass filtered at 500Hz and then digital filtering is applied over this range to provide an unbiased response from the pressure measurement system (A.W. Rofail, 2004).

The mean, gust and standard deviation velocity coefficients were determined from the data acquired in the wind tunnel. The gust velocity coefficients were also derived for each wind direction from by the following relation:

$$\hat{C}_V = \bar{C}_V + g \cdot \sigma_{C_V} \quad \text{B.1}$$

where:

\hat{C}_V is the gust velocity coefficient.

\bar{C}_V is the mean velocity coefficient.

g is the peak factor, taken as 3.0 for a 3-sec gust and 3.4 for a 0.5-sec gust.

σ_{C_V} is the standard deviation of the velocity coefficient measurement.

In the case of a Dantec hot-wire probe anemometer, the velocity coefficient is obtained as follows:

$$C_V = \frac{C_{V,study}}{C_{V,200m}} \quad \text{B.2}$$

where:

$C_{V,study}$ is the velocity coefficient measurement obtained from the Dantec hot-wire probe anemometer at the study point location.

$C_{V,200m}$ is the velocity coefficient measurement obtained from the Dantec hot-wire probe anemometer at the free-stream reference location at 200m height upwind of the model in the wind tunnel.

However, in the case of the pressure-based wind speed sensors, these are determined from the measured differential mean, standard deviation and maximum pressure coefficients obtained from the wind speed sensor. For this analysis all calculations are performed on the square root of the differential pressure measurements. The velocity coefficient at the pressure-based wind speed sensor location is then calculated as follows:

$$C_V = \frac{\alpha + \beta\sqrt{\Delta p}}{V_{200m}} \quad \text{B.3}$$

where:

C_V is the velocity coefficient measurement at the study point location.

α is a calibration coefficient for the pressure-based wind speed sensor.

β is a calibration coefficient for the pressure-based wind speed sensor.

Δp is the differential pressure obtained from the pressure-based wind speed sensor at the study point location.

V_{200m} is the wind speed at the free-stream reference location of 200m height (full-scale) in the wind tunnel, which is determined directly in the wind tunnel using a pitot static probe.

B.2 Calculation of the Full-Scale Results

The full-scale results determine if the wind conditions at a study location satisfy the designated criteria of that location. More specifically, the full-scale results need to determine the probability of exceedance of a given wind speed at a study location. To determine the probability of exceedance, the measured velocity coefficients were combined with a statistical model of the local wind climate that relates wind speed to a probability of exceedance. Details of the wind climate model are outlined in Section 4 of the main report.

The statistical model of the wind climate includes the impact of wind directionality as any local variations in wind speed or frequency with wind direction. This is important as the wind directions that produce the highest wind speed events for a region may not coincide with the most wind exposed direction at the site.

The methodology adopted for the derivation of the full-scale results for the maximum gust and the GEM wind speeds are outlined in the following sub-sections.

B.3 Maximum Gust Wind Speeds

The full-scale maximum gust wind speed at each study point location is derived from the measured coefficient using the following relationship:

$$V_{study} = V_{ref,RH} \left(\frac{k_{200m,tr,T=1hr}}{k_{RH,tr,T=1hr}} \right) C_V \quad B.4$$

where:

V_{study} is the full-scale wind speed at the study point location.

$V_{ref,RH}$ is the full-scale reference wind speed at the study reference height. This value is determined by combining the directional wind speed data for the region (detailed in Section 4) and the upwind terrain and height multipliers for the site (detailed in Section 3).

$k_{200m,tr,T=1hr}$ is the hourly mean terrain and height multiplier at the free-stream reference location of 200m height.

$k_{RH,tr,T=1hr}$ is the hourly mean terrain and height multiplier at the study reference height (Section 3).

C_V is the velocity coefficient, obtained from either Equation B.2 (in the case of Dantec hot-wire probe anemometers) or Equation B.3 (in the case of pressure-based wind speed sensors).

The value of $V_{ref,RH}$ varies with each prevailing wind direction. Wind directions where there is a high probability that a strong wind will occur have a higher directional wind speed than other directions. To determine the directional wind speeds, a probability level must be assigned for each wind direction. These probability levels are set following the approach used in AS/NZS1170.2:2011, which assumes that the major contributions to the combined probability of exceedance of a typical load effect comes from only two 45 degree sectors.

B.4 Maximum Gust-Equivalent Mean Wind Speeds

The contribution to the probability of exceedance of a specified wind speed (ie: the desired wind speed for pedestrian comfort, as per the criteria) was calculated for each wind direction. These contributions are then combined over all wind directions to calculate the total probability of exceedance of the specified wind speed. To calculate the probability of exceedance for a specified wind speed a statistical wind climate model was used to describe the relationship between directional wind speeds and the probability of exceedance. A detailed description of the methodology is given by T.V. Lawson (1980).

The criteria used in this study is referenced to a probability of exceedance of 5% of a specified wind speed.

B.5 References relating to Data Acquisition

American Society of Civil Engineers (ASCE), ASCE-7-16, 2016, "Minimum Design Loads for Buildings and Other Structures".

Australasian Wind Engineering Society, QAM-1, 2019, "Quality Assurance Manual: Wind Engineering Studies of Buildings", edited by Rofail A.W., et al.

Council on Tall Buildings and Urban Habitat (CTBUH), 2013, "Wind tunnel testing of high-rise buildings", CTBUH Technical Guides.

Lawson, T.V., 1980, "Wind Effects on Buildings - Volume 1, Design Applications". Applied Science Publishers Ltd, Ripple Road, Barking, Essex, England.

Rofail A.W., Tonin, R., and Hanafi, D., 2004, "Sensitivity of frequency response to type of tubing", Australasian Wind Engineering Workshop, Darwin.

Standards Australia and Standards New Zealand, AS/NZS 1170.2, 2011, "SAA Wind Loading Standard, Part 2: Wind Actions".





APPENDIX C DIRECTIONAL PLOTS OF WIND TUNNEL RESULTS

Results for P01

Gust Equivalent Mean (m/s)

Maximum Gust (m/s)

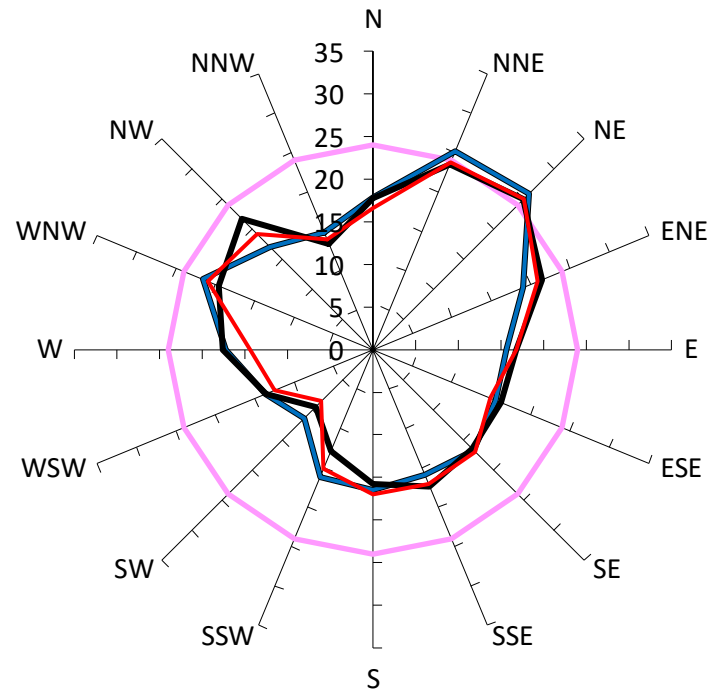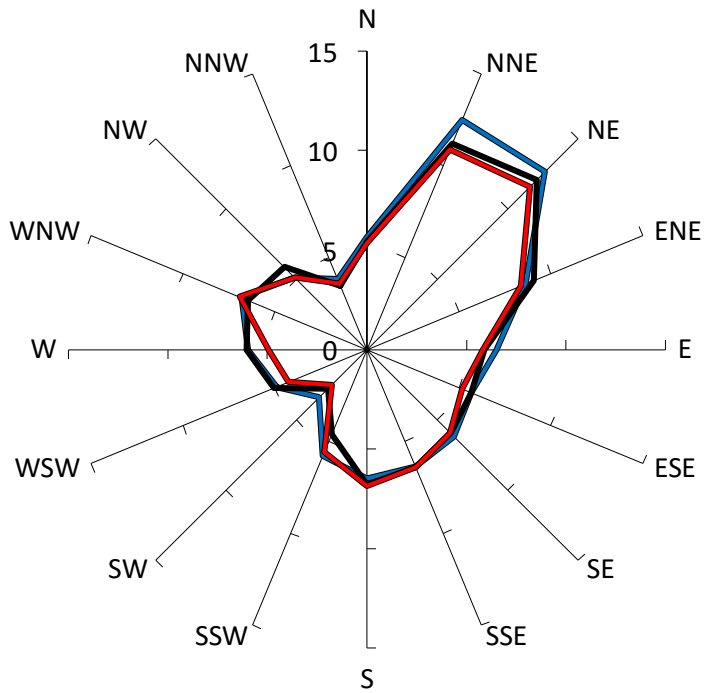

Comfort Criteria: 8m/s with 5% probability of exceedence



Safety Limit: 24m/s

Description	GEM Prob of Exceed %	Peak Gust m/s
— Criterion: Wind Comfort Standard for Walking Criterion (8m/s). Safety Limit (24m/s).	5%	24
— Base Case	16%	26
— Existing Scenario	16%	25
— Proposed Envelope Scenario	15%	25
—		
—		
—		
—		
—		

Results for P02

Gust Equivalent Mean (m/s)

Maximum Gust (m/s)

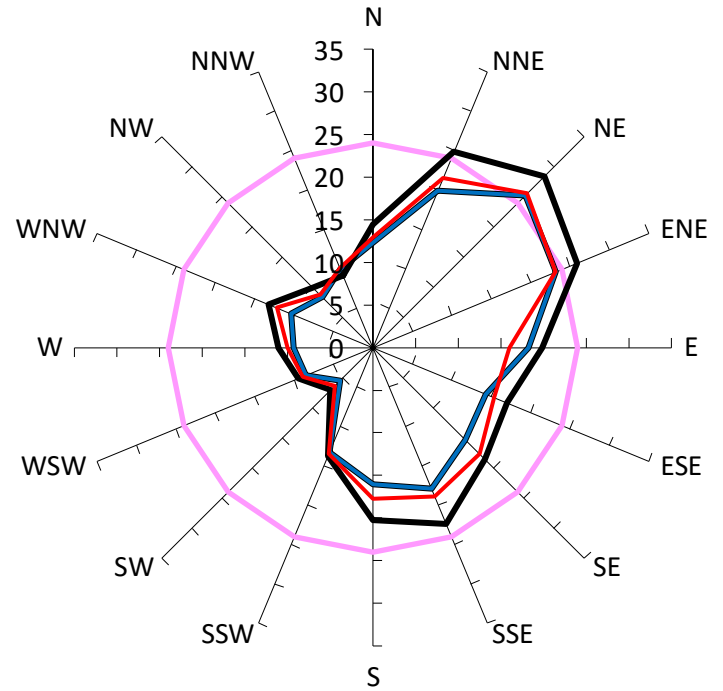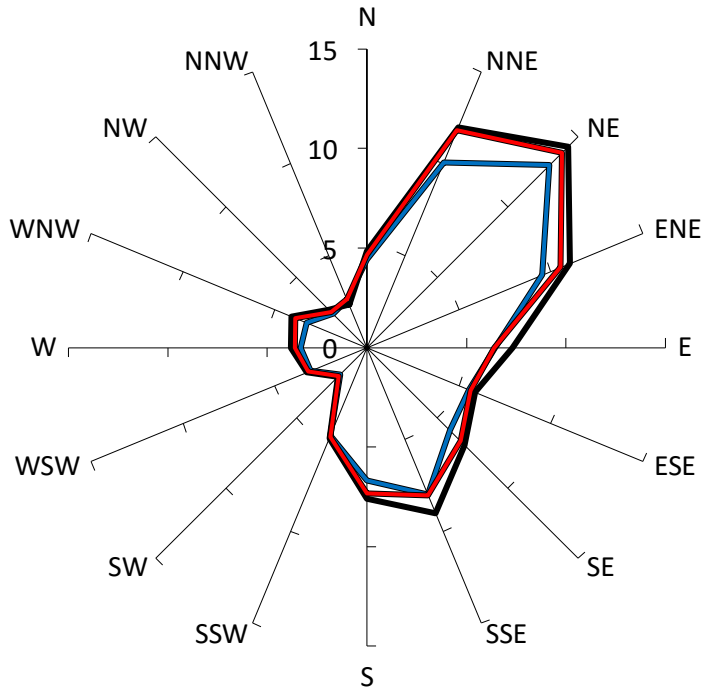

Comfort Criteria: 8m/s with 5% probability of exceedence



Safety Limit: 24m/s

Description	GEM Prob of Exceed %	Peak Gust m/s
— Criterion: Wind Comfort Standard for Walking Criterion (8m/s). Safety Limit (24m/s).	5%	24
— Base Case	17%	25
— Existing Scenario	20%	28
— Proposed Envelope Scenario	18%	26
—		
—		
—		
—		
—		

Results for P03

Gust Equivalent Mean (m/s)

Maximum Gust (m/s)

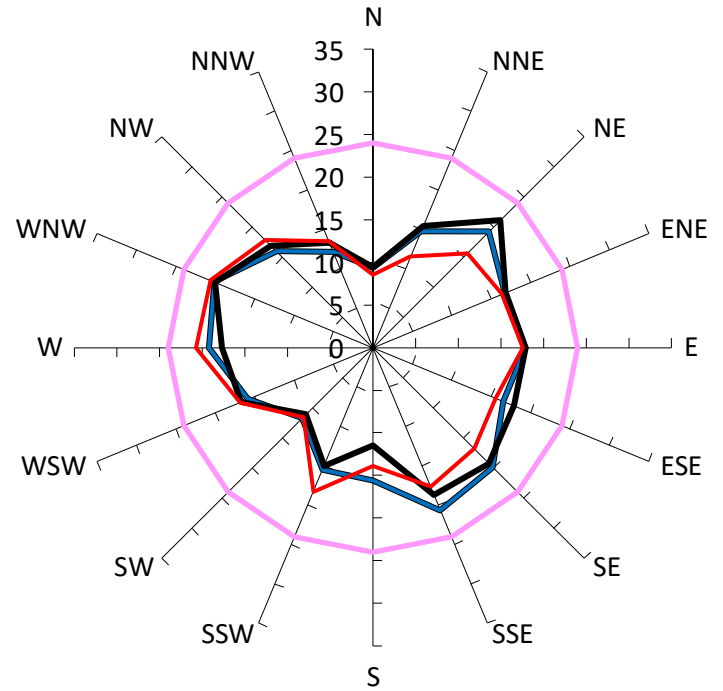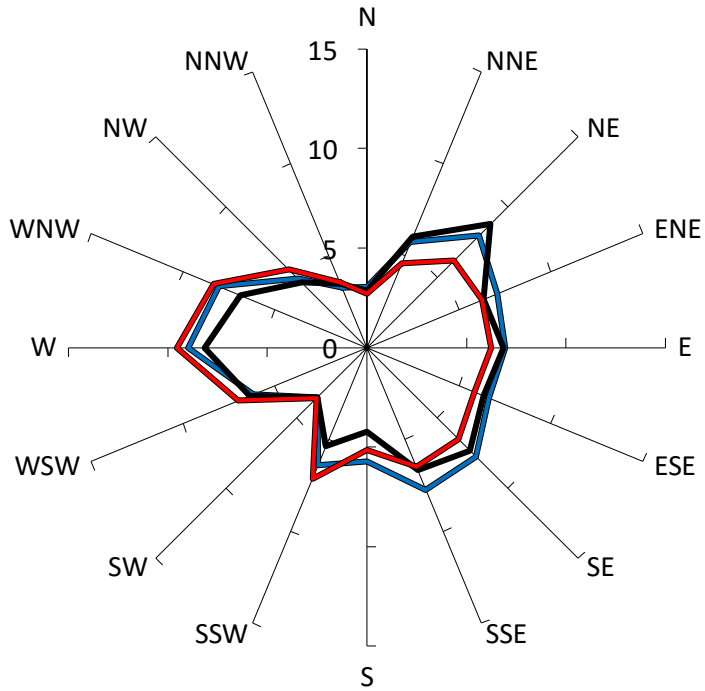

Comfort Criteria: 8m/s with 5% probability of exceedence



Safety Limit: 24m/s

Description	GEM Prob of Exceed %	Peak Gust m/s
— Criterion: Wind Comfort Standard for Walking Criterion (8m/s). Safety Limit (24m/s).	5%	24
— Base Case	9%	21
— Existing Scenario	7%	21
— Proposed Envelope Scenario	7%	21
—		
—		
—		
—		
—		

Results for P04

Gust Equivalent Mean (m/s)

Maximum Gust (m/s)

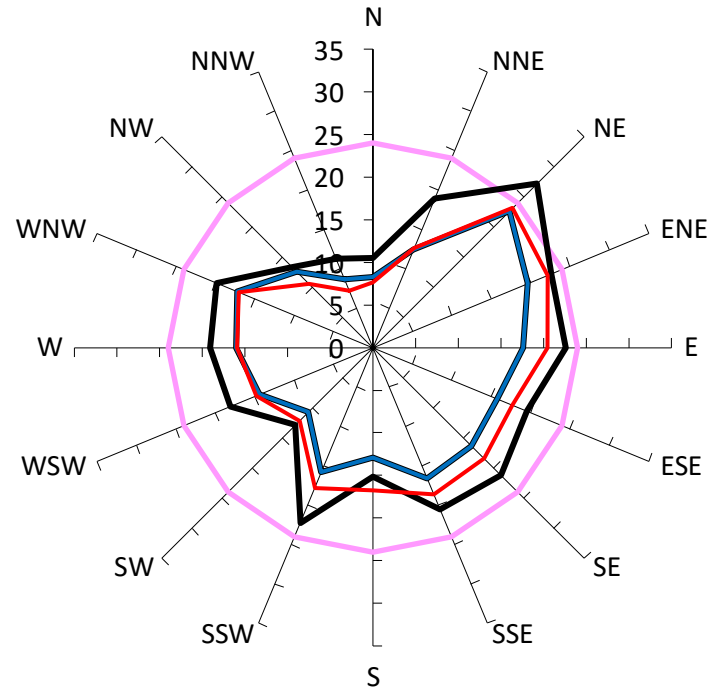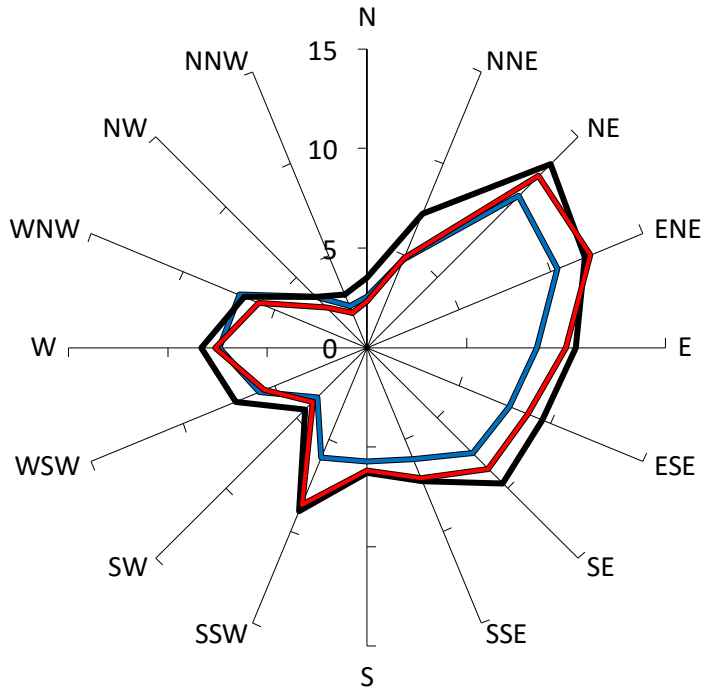

Comfort Criteria: 8m/s with 5% probability of exceedence



Safety Limit: 24m/s

Description	GEM Prob of Exceed %	Peak Gust m/s
— Criterion: Wind Comfort Standard for Walking Criterion (8m/s). Safety Limit (24m/s).	5%	24
— Base Case	15%	23
— Existing Scenario	23%	27
— Proposed Envelope Scenario	19%	23
—		
—		
—		
—		
—		

Results for P05

Gust Equivalent Mean (m/s)

Maximum Gust (m/s)

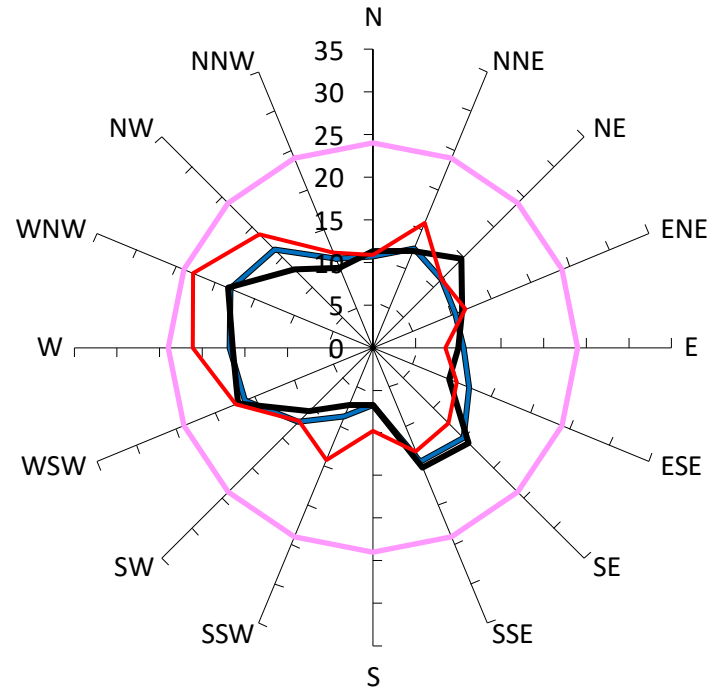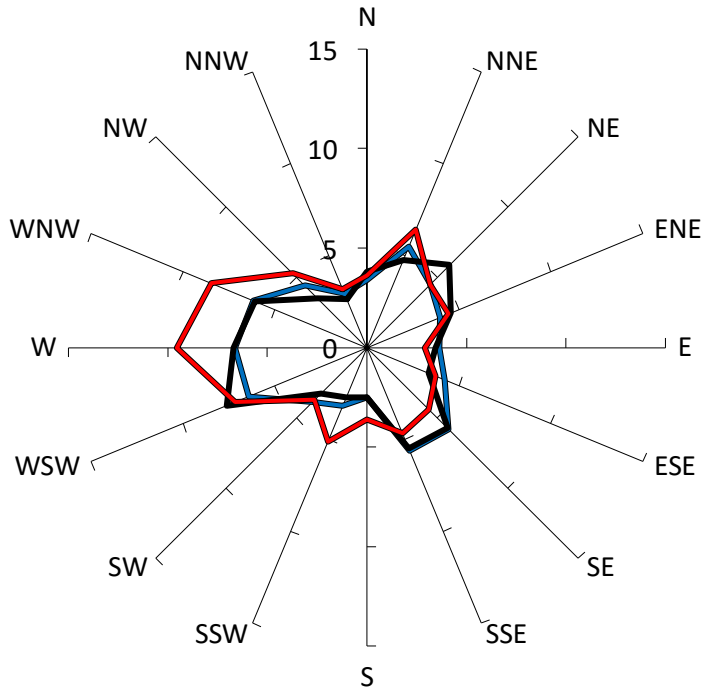

Comfort Criteria: 8m/s with 5% probability of exceedence



Safety Limit: 24m/s

Description	GEM Prob of Exceed %	Peak Gust m/s
— Criterion: Wind Comfort Standard for Walking Criterion (8m/s). Safety Limit (24m/s).	5%	24
— Base Case	2%	18
— Existing Scenario	2%	18
— Proposed Envelope Scenario	5%	23
—		
—		
—		
—		
—		

Results for P06

Gust Equivalent Mean (m/s)

Maximum Gust (m/s)

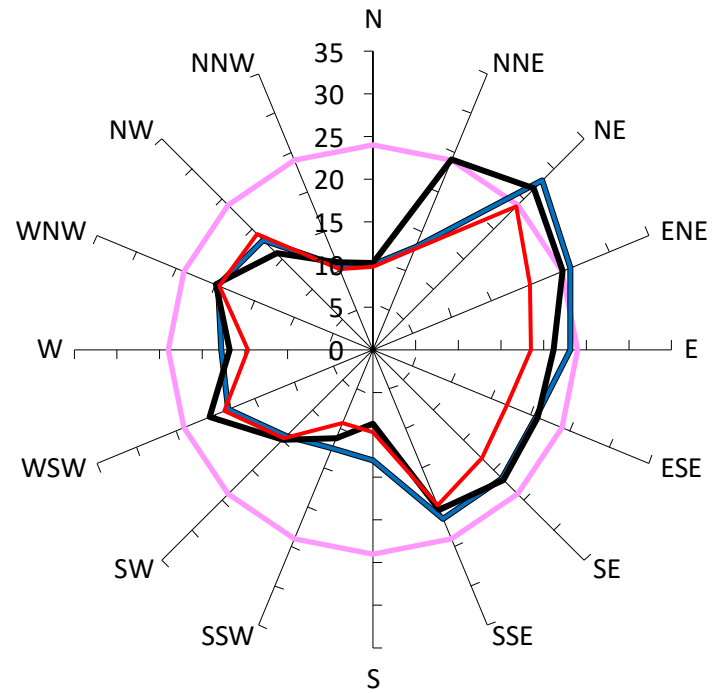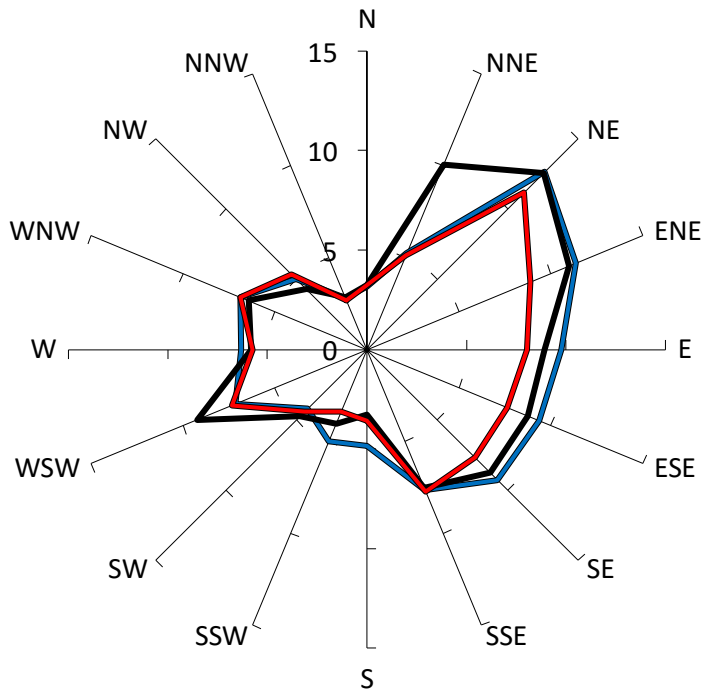

Comfort Criteria: 8m/s with 5% probability of exceedence



Safety Limit: 24m/s

Description	GEM Prob of Exceed %	Peak Gust m/s
— Criterion: Wind Comfort Standard for Walking Criterion (8m/s). Safety Limit (24m/s).	5%	24
— Base Case	20%	28
— Existing Scenario	23%	27
— Proposed Envelope Scenario	15%	24
—		
—		
—		
—		
—		

Results for P07

Gust Equivalent Mean (m/s)

Maximum Gust (m/s)

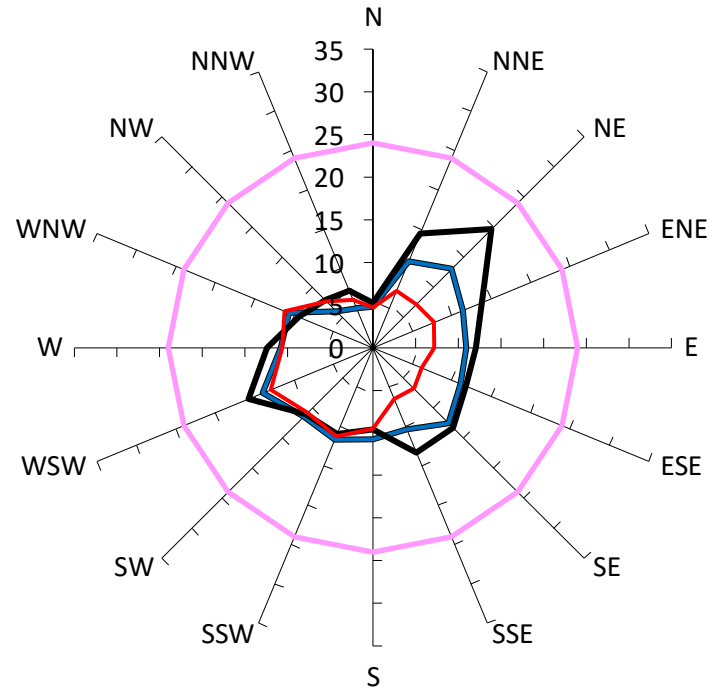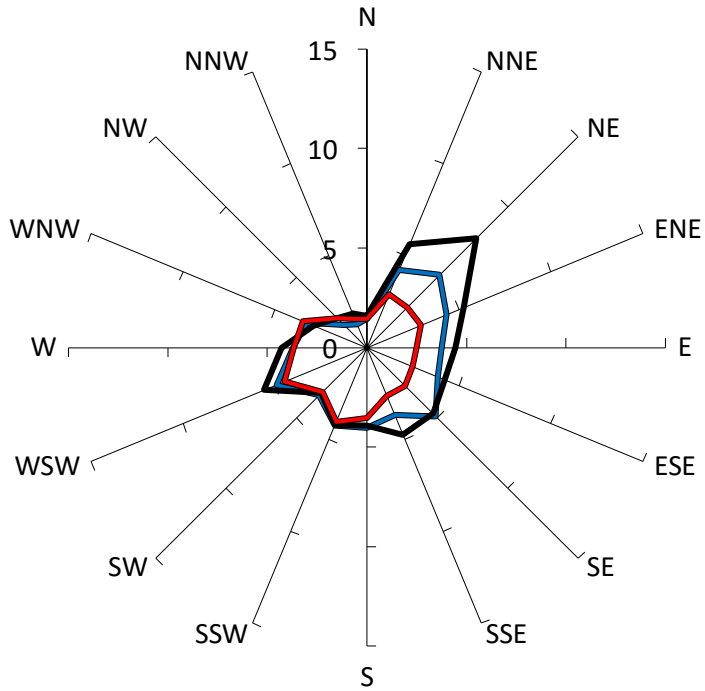

Comfort Criteria: 8m/s with 5% probability of exceedence



Safety Limit: 24m/s

Description	GEM Prob of Exceed %	Peak Gust m/s
— Criterion: Wind Comfort Standard for Walking Criterion (8m/s). Safety Limit (24m/s).	5%	24
— Base Case	< 1%	14
— Existing Scenario	1%	20
— Proposed Envelope Scenario	< 1%	13
—		
—		
—		
—		
—		

Results for P08

Gust Equivalent Mean (m/s)

Maximum Gust (m/s)

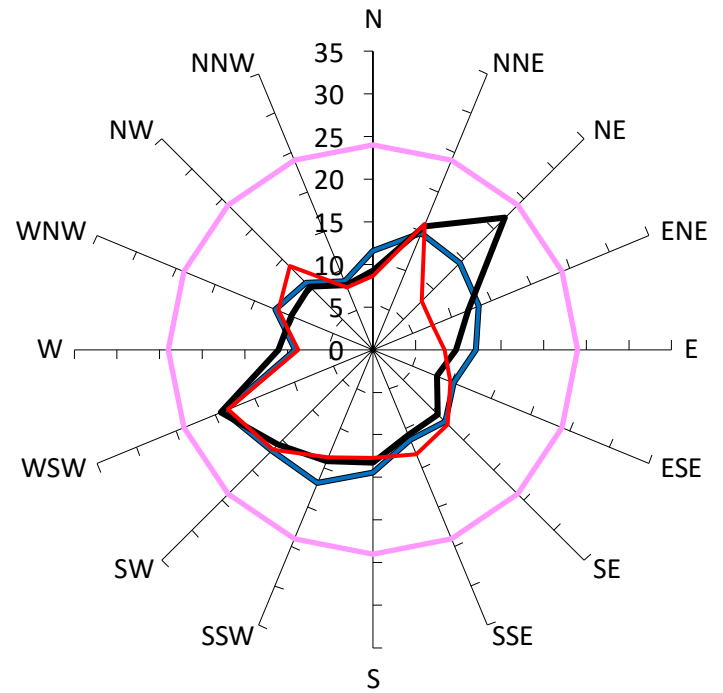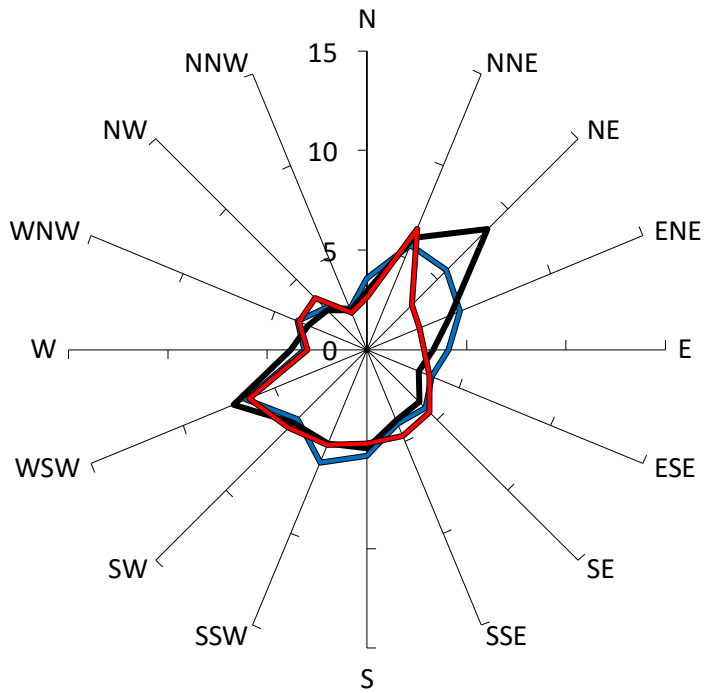

Comfort Criteria: 8m/s with 5% probability of exceedence



Safety Limit: 24m/s

Description	GEM Prob of Exceed %	Peak Gust m/s
— Criterion: Wind Comfort Standard for Walking Criterion (8m/s). Safety Limit (24m/s).	5%	24
— Base Case	1%	19
— Existing Scenario	3%	22
— Proposed Envelope Scenario	1%	18
—		
—		
—		
—		
—		

Results for P09

Gust Equivalent Mean (m/s)

Maximum Gust (m/s)

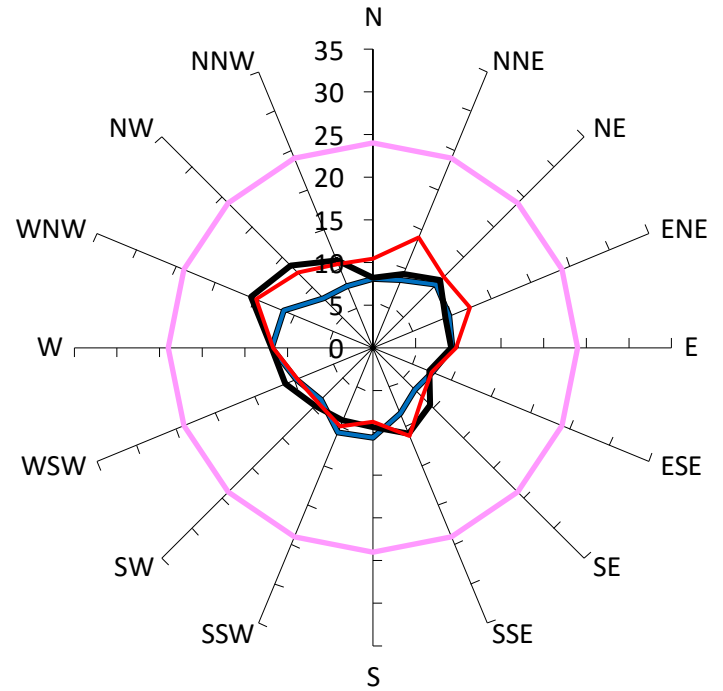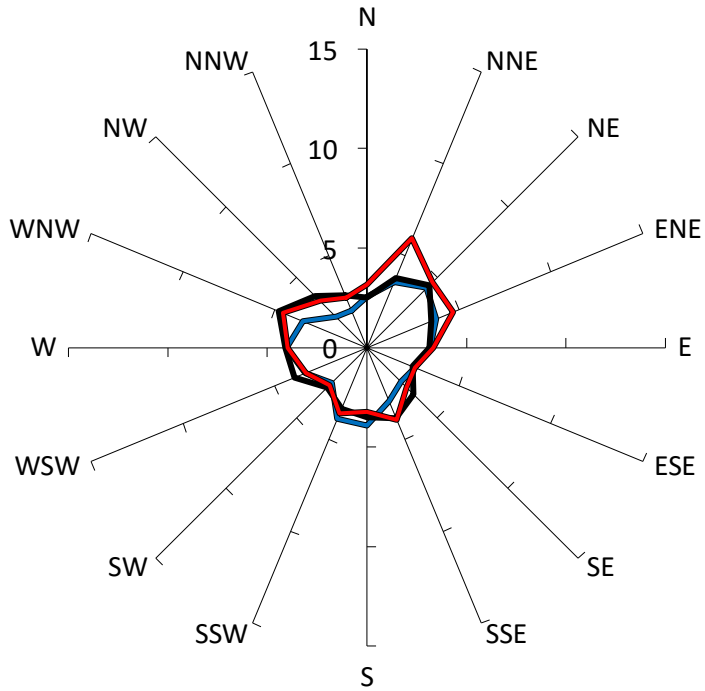

Comfort Criteria: 6m/s with 5% probability of exceedence



Safety Limit: 24m/s

Description	GEM Prob of Exceed %	Peak Gust m/s
— Criterion: Wind Comfort Standard for Standing Criterion (6m/s). Safety Limit (24m/s).	5%	24
— Base Case	< 1%	12
— Existing Scenario	1%	15
— Proposed Envelope Scenario	2%	15
—		
—		
—		
—		
—		

Results for P10

Gust Equivalent Mean (m/s)

Maximum Gust (m/s)

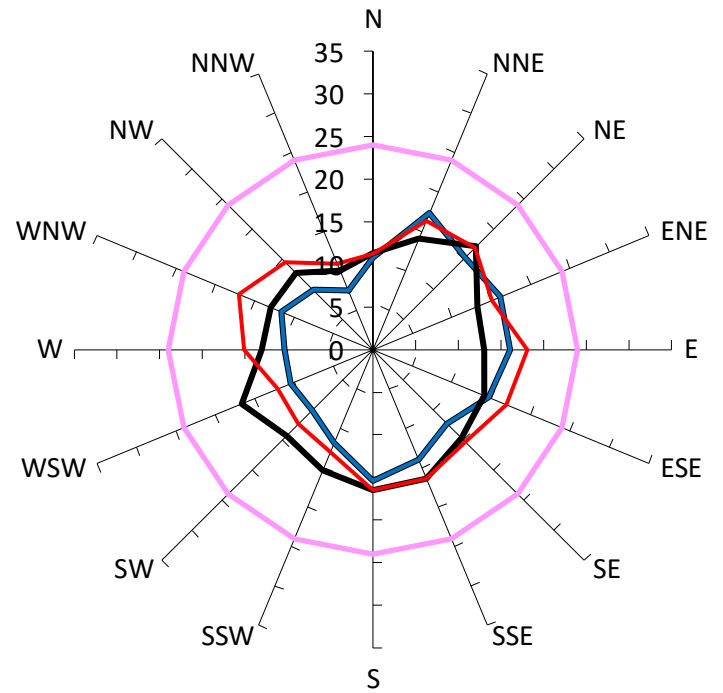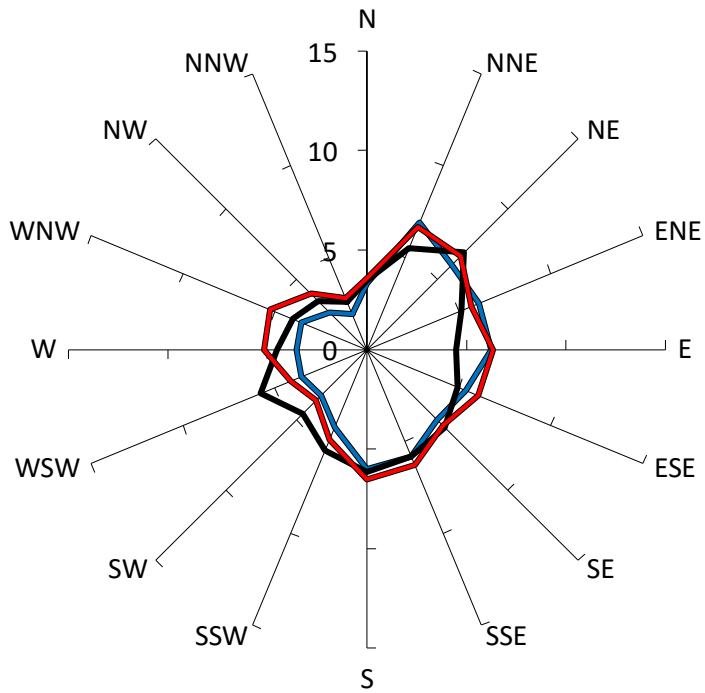

Comfort Criteria: 8m/s with 5% probability of exceedence



Safety Limit: 24m/s

Description	GEM Prob of Exceed %	Peak Gust m/s
Criterion: Wind Comfort Standard for Walking Criterion (8m/s). Safety Limit (24m/s).	5%	24
Base Case	1%	17
Existing Scenario	1%	17
Proposed Envelope Scenario	2%	18

Results for P11

Gust Equivalent Mean (m/s)

Maximum Gust (m/s)

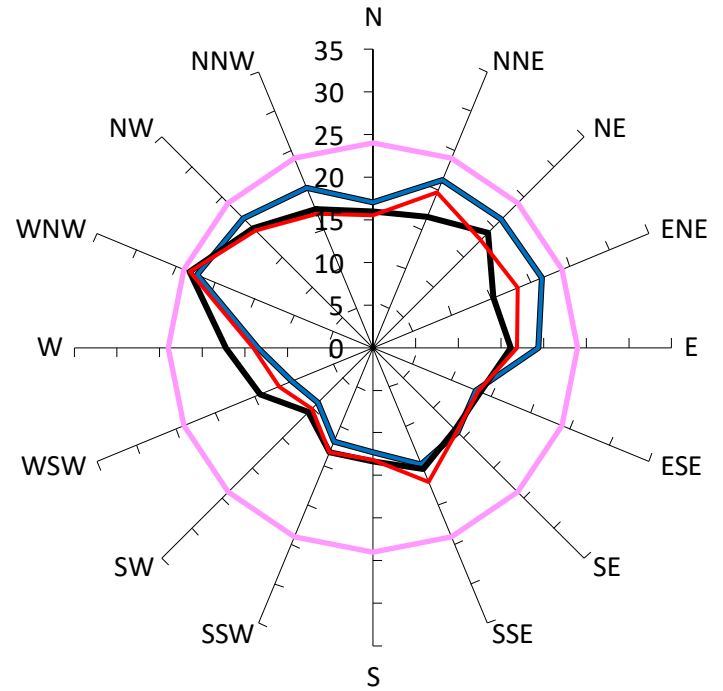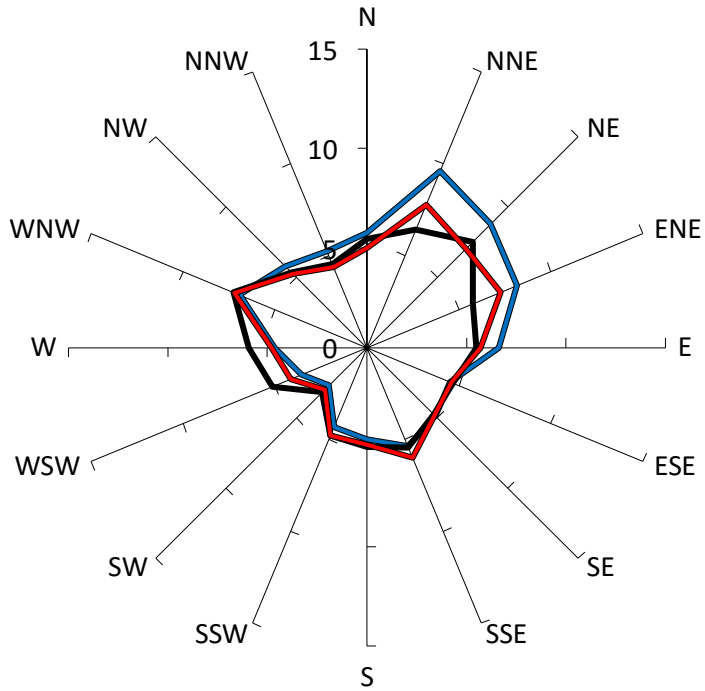

Comfort Criteria: 8m/s with 5% probability of exceedence



Safety Limit: 24m/s

Description	GEM Prob of Exceed %	Peak Gust m/s
— Criterion: Wind Comfort Standard for Walking Criterion (8m/s). Safety Limit (24m/s).	5%	24
— Base Case	9%	22
— Existing Scenario	3%	23
— Proposed Envelope Scenario	3%	23
—		
—		
—		
—		
—		

Results for P12

Gust Equivalent Mean (m/s)

Maximum Gust (m/s)

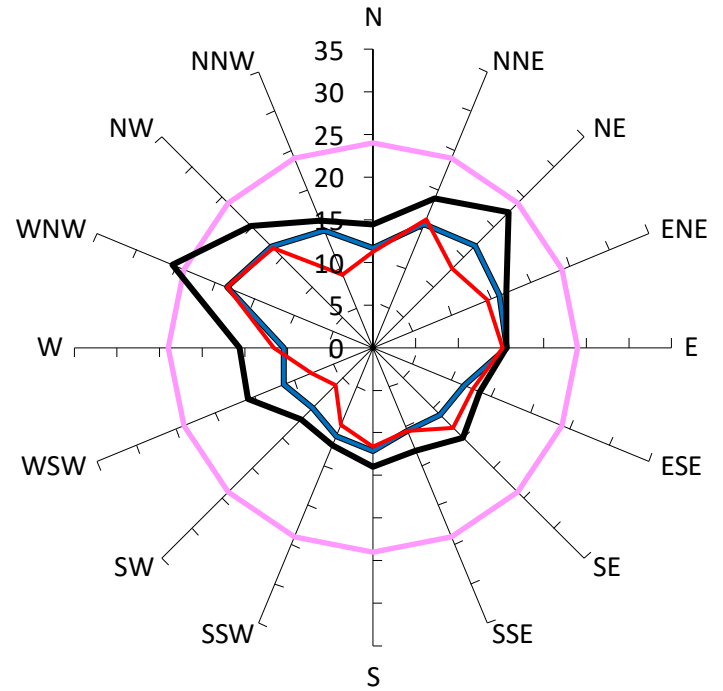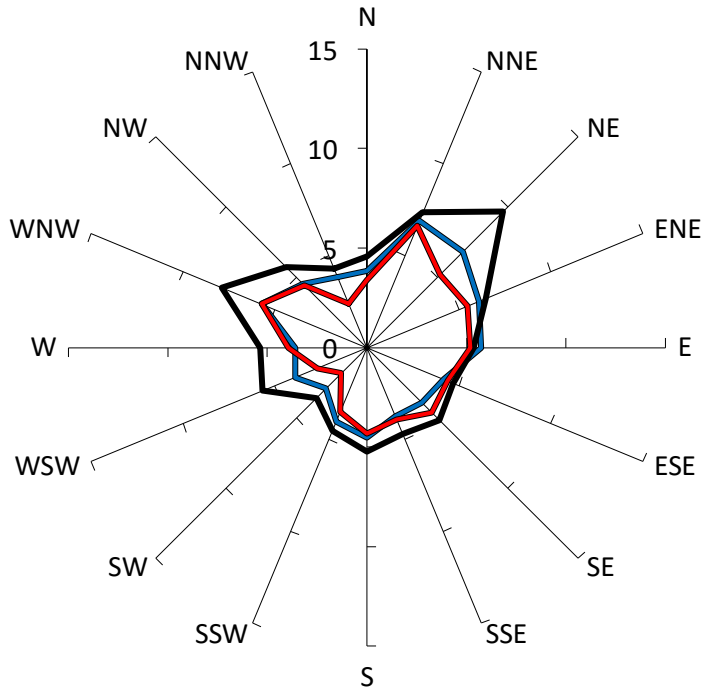

Comfort Criteria: 8m/s with 5% probability of exceedence



Safety Limit: 24m/s

Description	GEM Prob of Exceed %	Peak Gust m/s
Criterion: Wind Comfort Standard for Walking Criterion (8m/s). Safety Limit (24m/s).	5%	24
Base Case	1%	18
Existing Scenario	7%	25
Proposed Envelope Scenario	1%	18

Results for P13

Gust Equivalent Mean (m/s)

Maximum Gust (m/s)

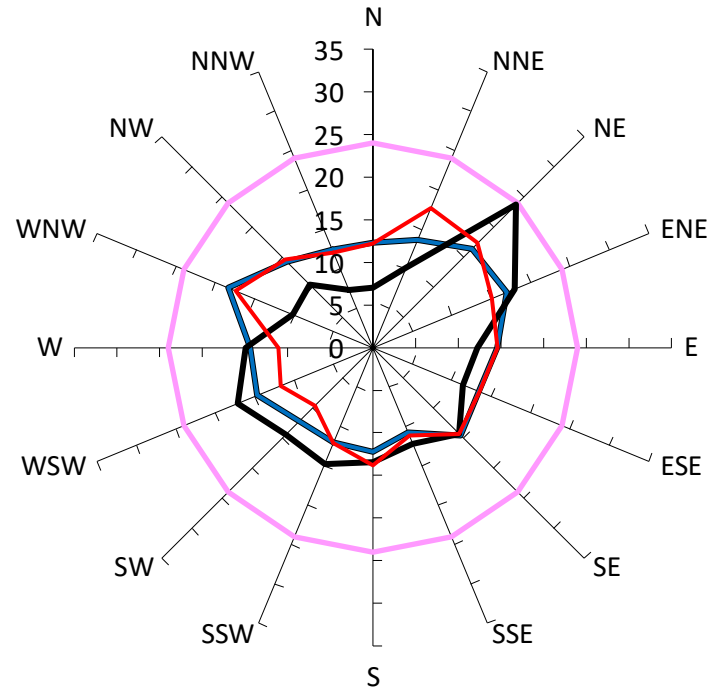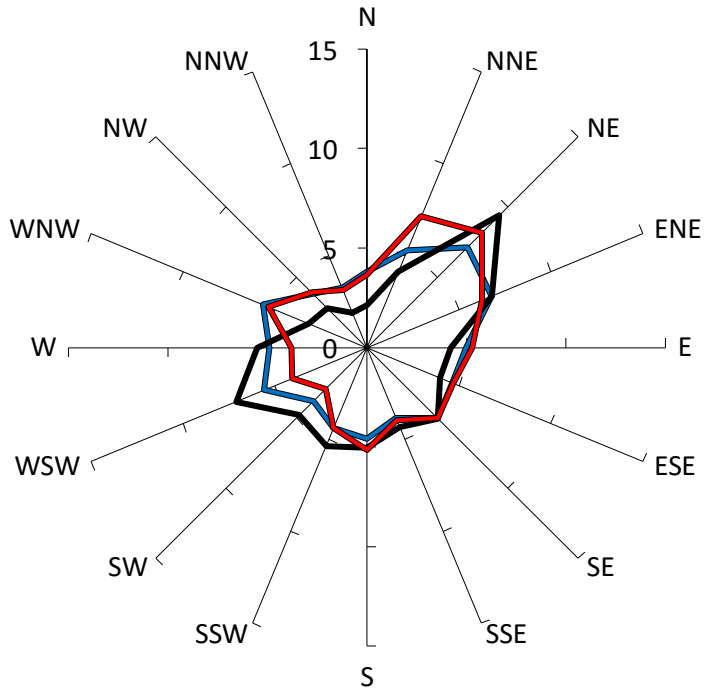

Comfort Criteria: 8m/s with 5% probability of exceedence



Safety Limit: 24m/s

Description	GEM Prob of Exceed %	Peak Gust m/s
Criterion: Wind Comfort Standard for Walking Criterion (8m/s). Safety Limit (24m/s).	5%	24
Base Case	1%	18
Existing Scenario	5%	24
Proposed Envelope Scenario	2%	18

Results for P14

Gust Equivalent Mean (m/s)

Maximum Gust (m/s)

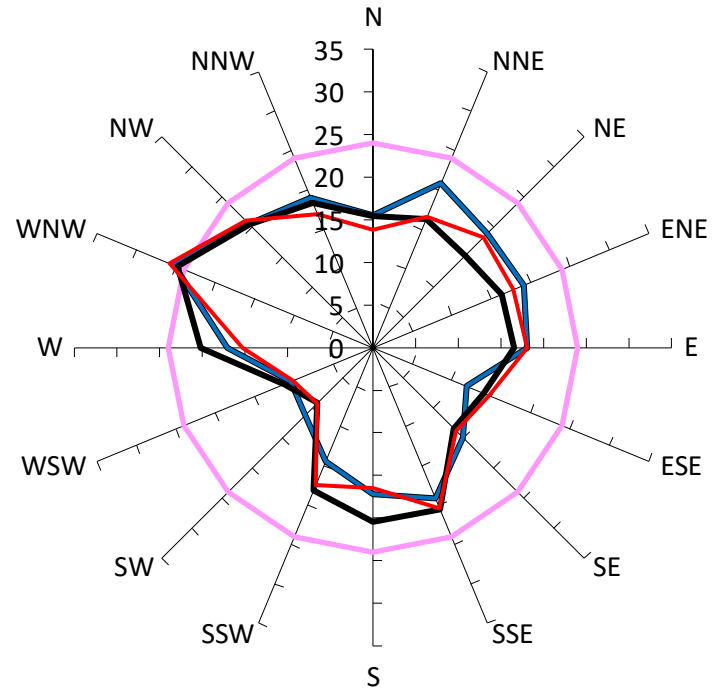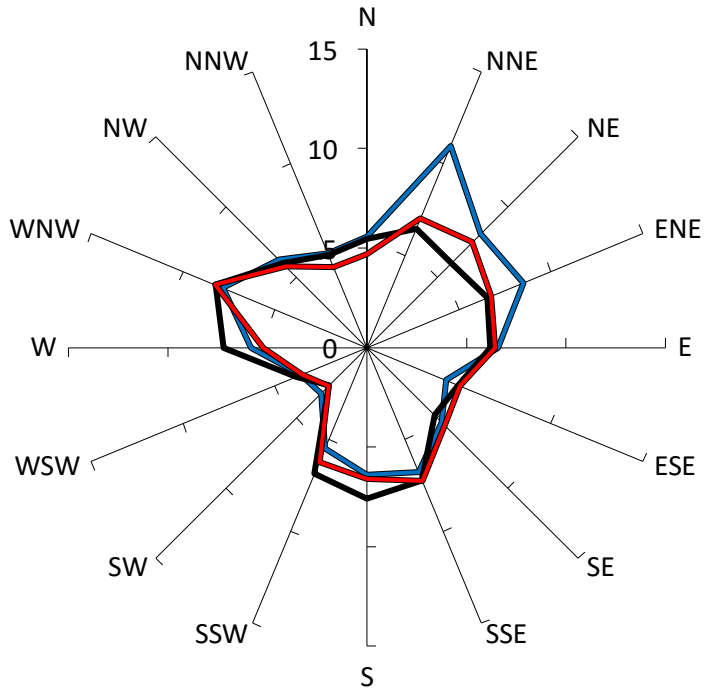

Comfort Criteria: 8m/s with 5% probability of exceedence



Safety Limit: 24m/s

Description	GEM Prob of Exceed %	Peak Gust m/s
Criterion: Wind Comfort Standard for Walking Criterion (8m/s). Safety Limit (24m/s).	5%	24
Base Case	11%	25
Existing Scenario	6%	25
Proposed Envelope Scenario	5%	26

Results for P15

Gust Equivalent Mean (m/s)

Maximum Gust (m/s)

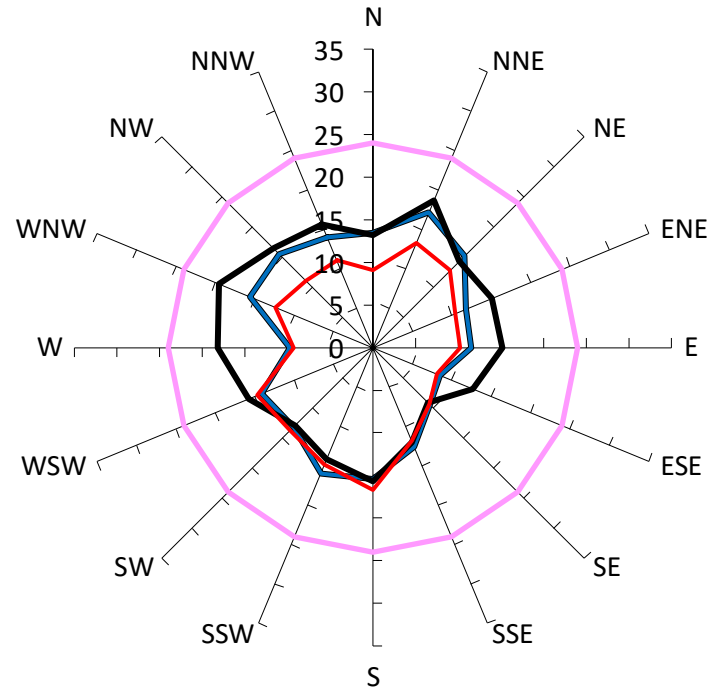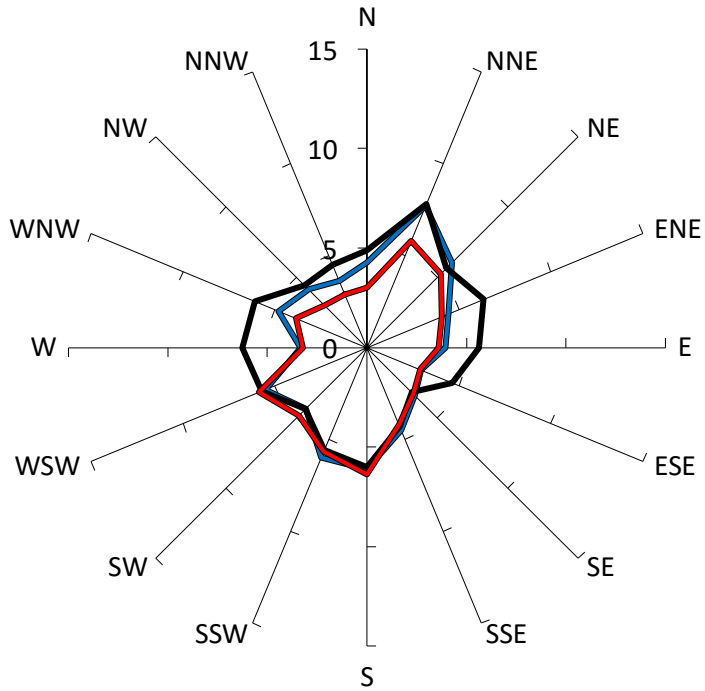

Comfort Criteria: 8m/s with 5% probability of exceedence



Safety Limit: 24m/s

Description	GEM Prob of Exceed %	Peak Gust m/s
Criterion: Wind Comfort Standard for Walking Criterion (8m/s). Safety Limit (24m/s).	5%	24
Base Case	2%	17
Existing Scenario	3%	20
Proposed Envelope Scenario	1%	17

Results for P16

Gust Equivalent Mean (m/s)

Maximum Gust (m/s)

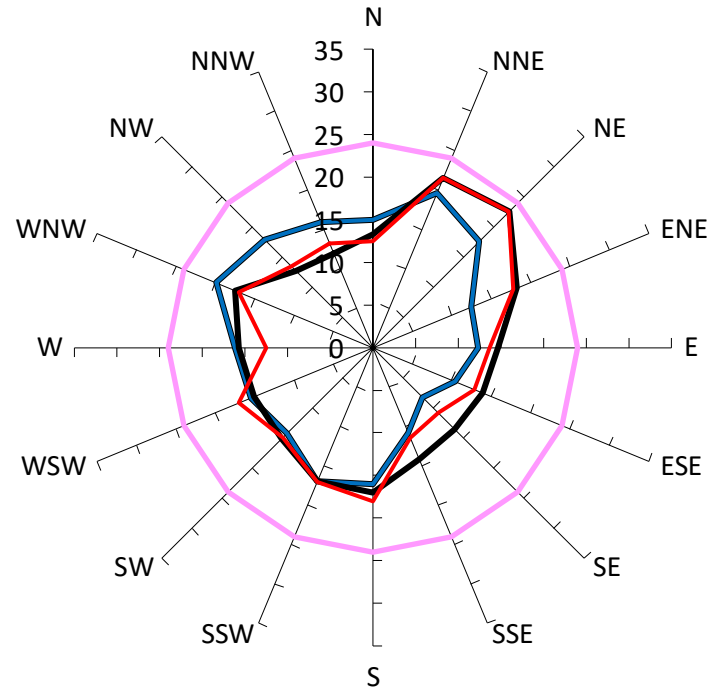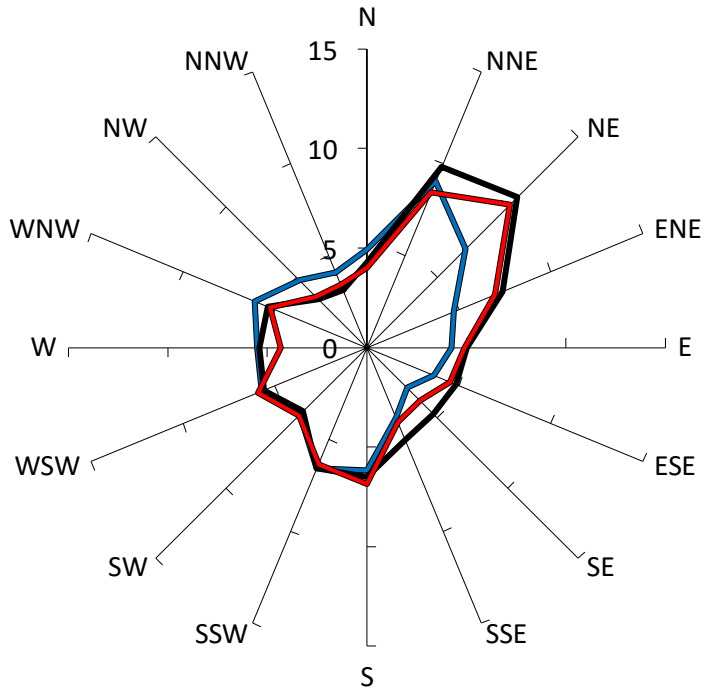

Comfort Criteria: 8m/s with 5% probability of exceedence



Safety Limit: 24m/s

Description	GEM Prob of Exceed %	Peak Gust m/s
— Criterion: Wind Comfort Standard for Walking Criterion (8m/s). Safety Limit (24m/s).	5%	24
— Base Case	4%	20
— Existing Scenario	12%	23
— Proposed Envelope Scenario	9%	23
—		
—		
—		
—		
—		

Results for P17

Gust Equivalent Mean (m/s)

Maximum Gust (m/s)

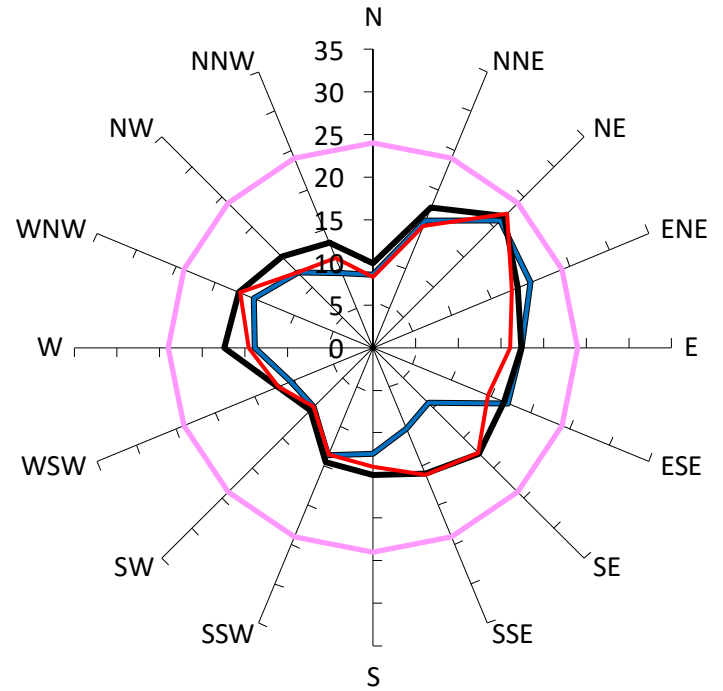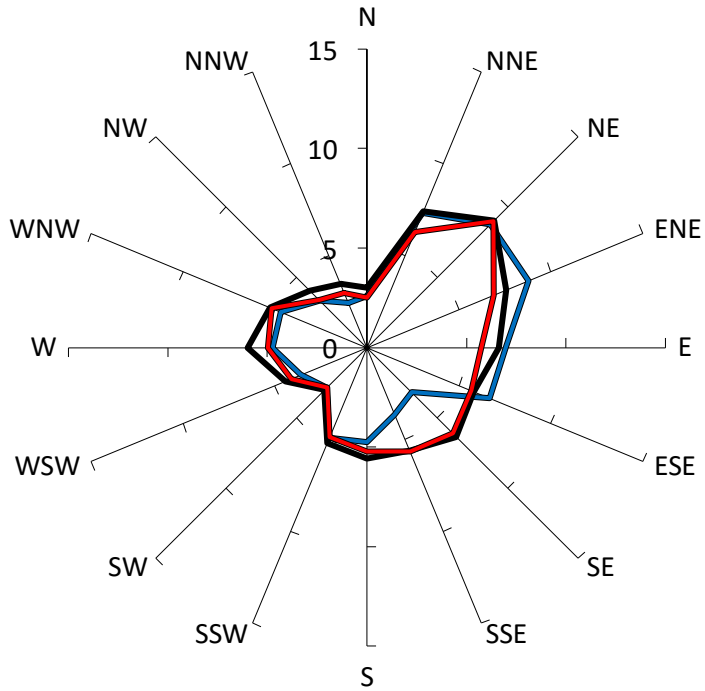

Comfort Criteria: 8m/s with 5% probability of exceedence



Safety Limit: 24m/s

Description	GEM Prob of Exceed %	Peak Gust m/s
— Criterion: Wind Comfort Standard for Walking Criterion (8m/s). Safety Limit (24m/s).	5%	24
— Base Case	6%	21
— Existing Scenario	5%	22
— Proposed Envelope Scenario	4%	22
—		
—		
—		
—		
—		

Results for P18

Gust Equivalent Mean (m/s)

Maximum Gust (m/s)

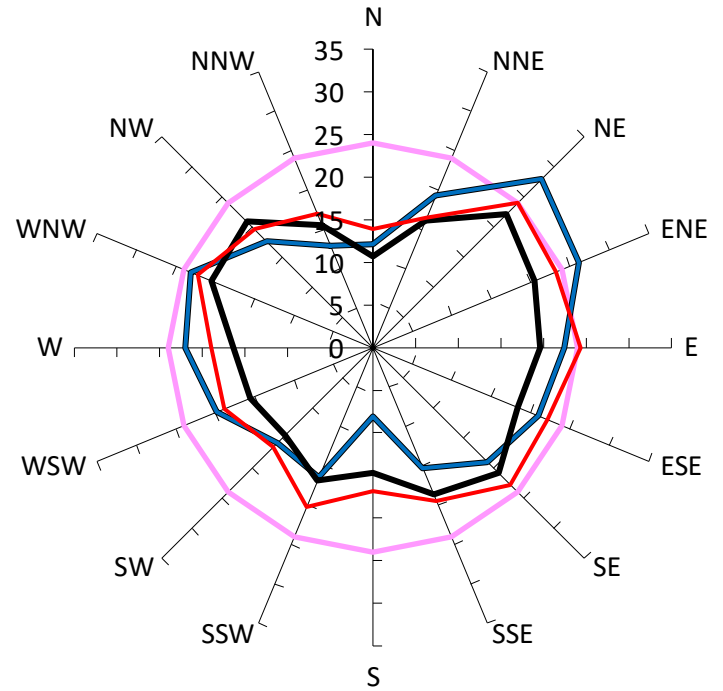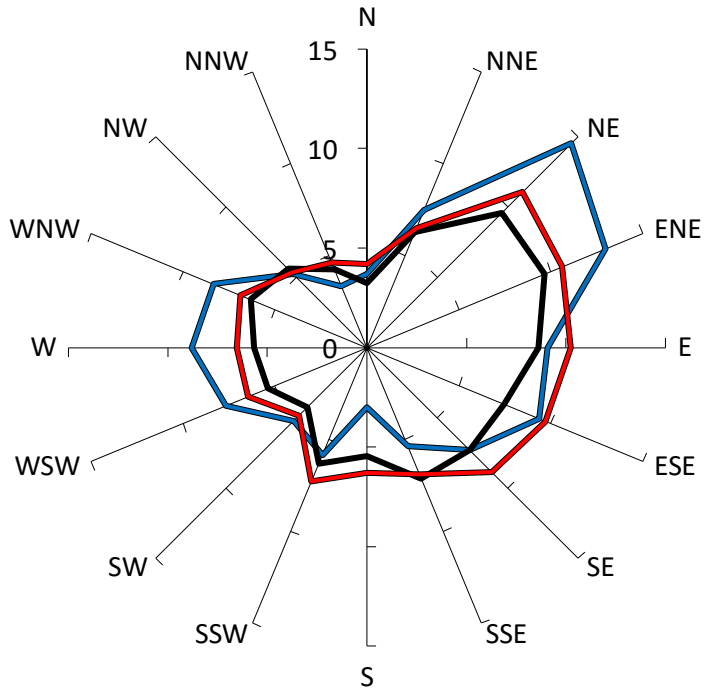

Comfort Criteria: 8m/s with 5% probability of exceedence



Safety Limit: 24m/s

Description	GEM Prob of Exceed %	Peak Gust m/s
Criterion: Wind Comfort Standard for Walking Criterion (8m/s). Safety Limit (24m/s).	5%	24
Base Case	21%	28
Existing Scenario	13%	22
Proposed Envelope Scenario	20%	24

Results for P19

Gust Equivalent Mean (m/s)

Maximum Gust (m/s)

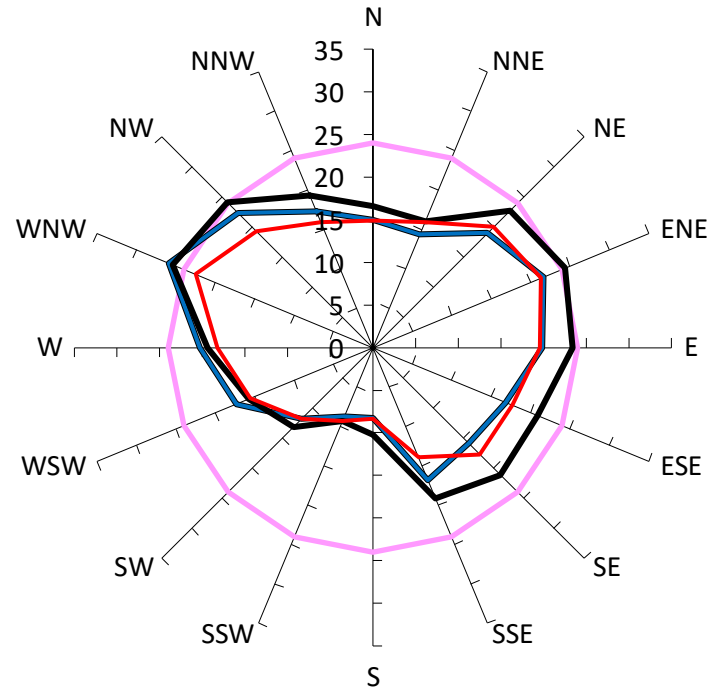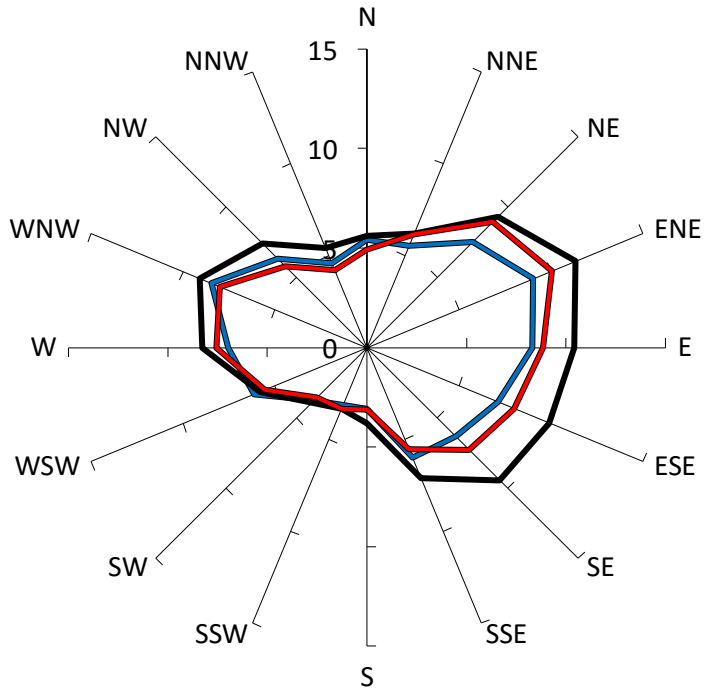


Comfort Criteria: 8m/s with 5% probability of exceedence

Safety Limit: 24m/s

Description	GEM Prob of Exceed %	Peak Gust m/s
— Criterion: Wind Comfort Standard for Walking Criterion (8m/s). Safety Limit (24m/s).	5%	24
— Base Case	9%	26
— Existing Scenario	19%	25
— Proposed Envelope Scenario	13%	22
—		
—		
—		
—		
—		


Results for P20

Gust Equivalent Mean (m/s)

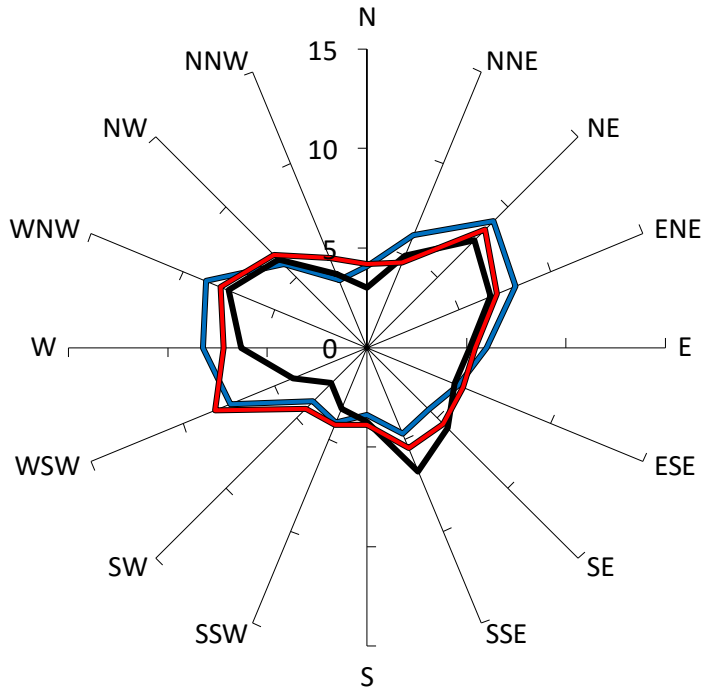

Comfort Criteria: 8m/s with 5% probability of exceedence

Maximum Gust (m/s)

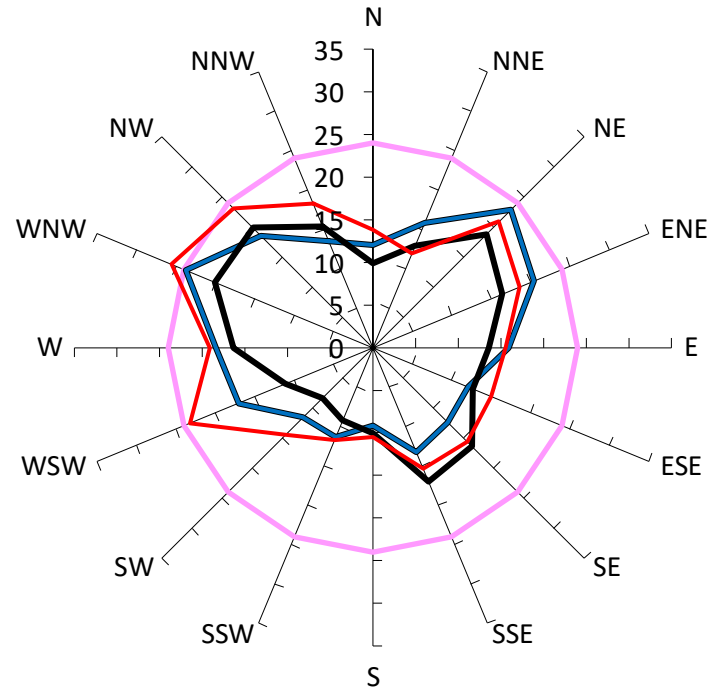



Safety Limit: 24m/s

Description	GEM Prob of Exceed %	Peak Gust m/s
— Criterion: Wind Comfort Standard for Walking Criterion (8m/s). Safety Limit (24m/s).	5%	24
— Base Case	8%	24
— Existing Scenario	3%	20
— Proposed Envelope Scenario	6%	26
—		
—		
—		
—		
—		

Results for P21

Gust Equivalent Mean (m/s)

Maximum Gust (m/s)

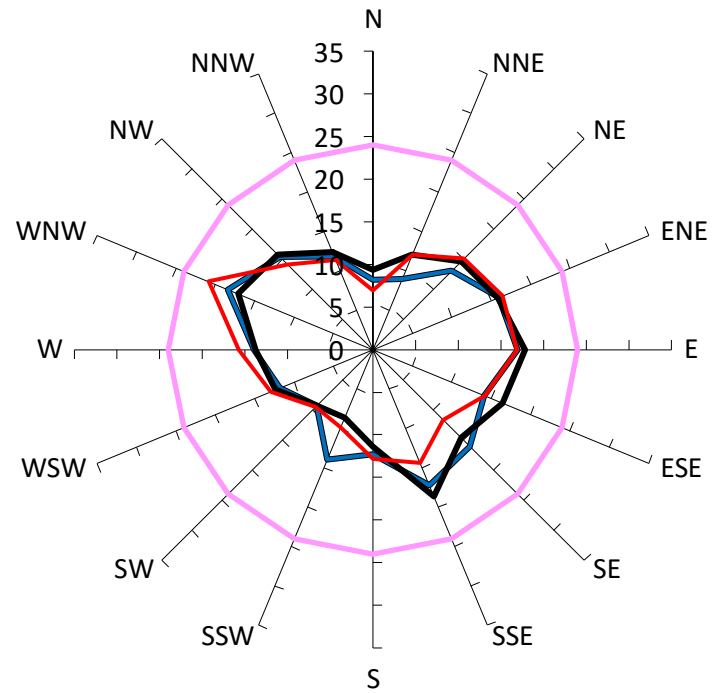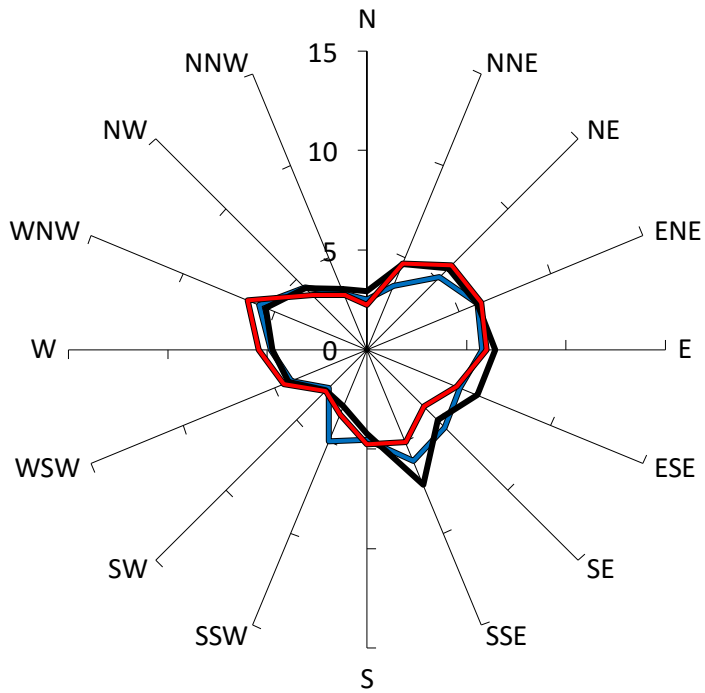

Comfort Criteria: 8m/s with 5% probability of exceedence



Safety Limit: 24m/s

Description	GEM Prob of Exceed %	Peak Gust m/s
Criterion: Wind Comfort Standard for Walking Criterion (8m/s). Safety Limit (24m/s).	5%	24
Base Case	1%	18
Existing Scenario	2%	19
Proposed Envelope Scenario	1%	21

Results for P22

Gust Equivalent Mean (m/s)

Maximum Gust (m/s)

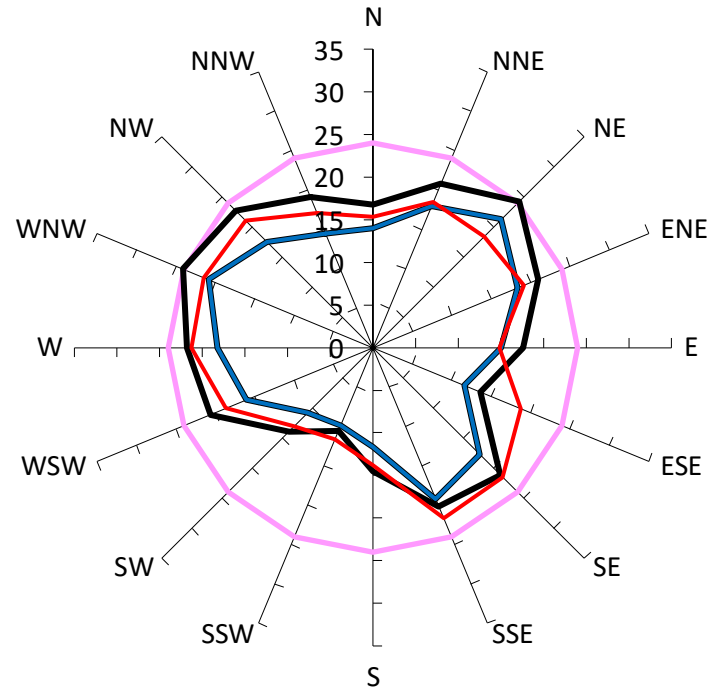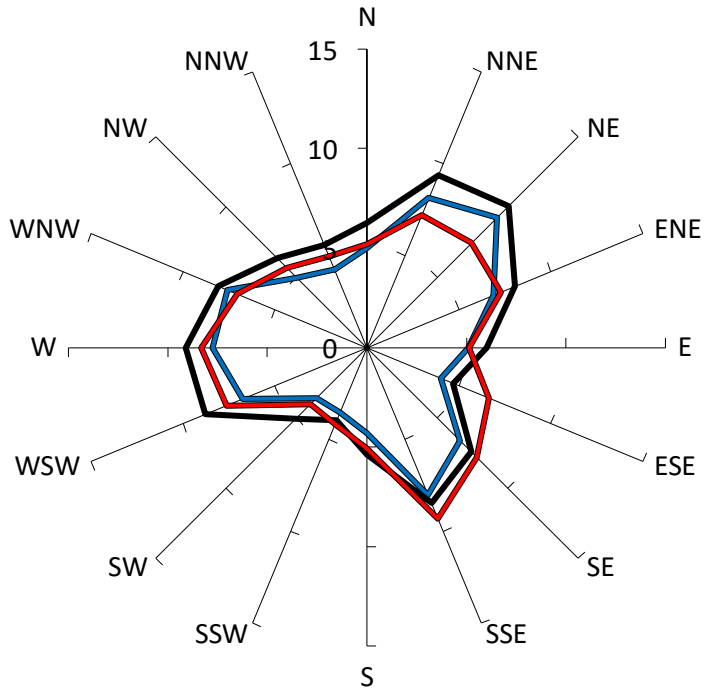

Comfort Criteria: 8m/s with 5% probability of exceedence



Safety Limit: 24m/s

Description	GEM Prob of Exceed %	Peak Gust m/s
Criterion: Wind Comfort Standard for Walking Criterion (8m/s). Safety Limit (24m/s).	5%	24
Base Case	9%	21
Existing Scenario	18%	24
Proposed Envelope Scenario	11%	22

Results for P23

Gust Equivalent Mean (m/s)

Maximum Gust (m/s)

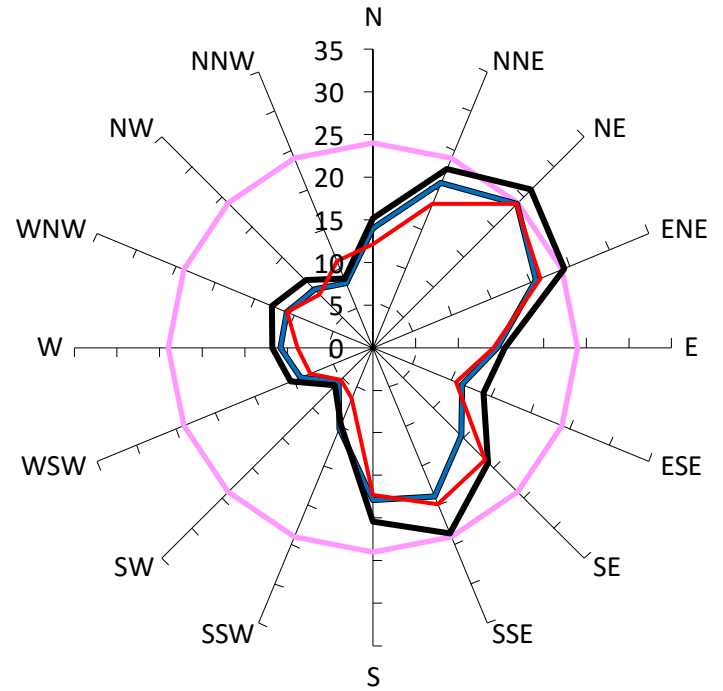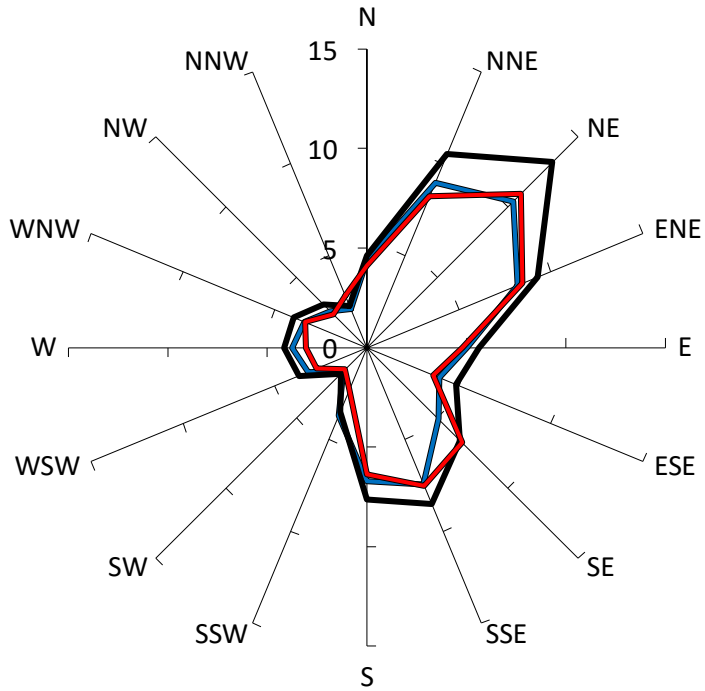

Comfort Criteria: 8m/s with 5% probability of exceedence


Safety Limit: 24m/s

Description	GEM Prob of Exceed %	Peak Gust m/s
— Criterion: Wind Comfort Standard for Walking Criterion (8m/s). Safety Limit (24m/s).	5%	24
— Base Case	11%	24
— Existing Scenario	18%	26
— Proposed Envelope Scenario	11%	24
—		
—		
—		
—		
—		



APPENDIX D VELOCITY AND TURBULENCE INTENSITY PROFILES

Mean Velocity and Turbulence Intensity for Suburban/Forest Terrain ($0.2\text{m} < z_0 < 0.3\text{m}$) (TC3) at a 1:300 Scale

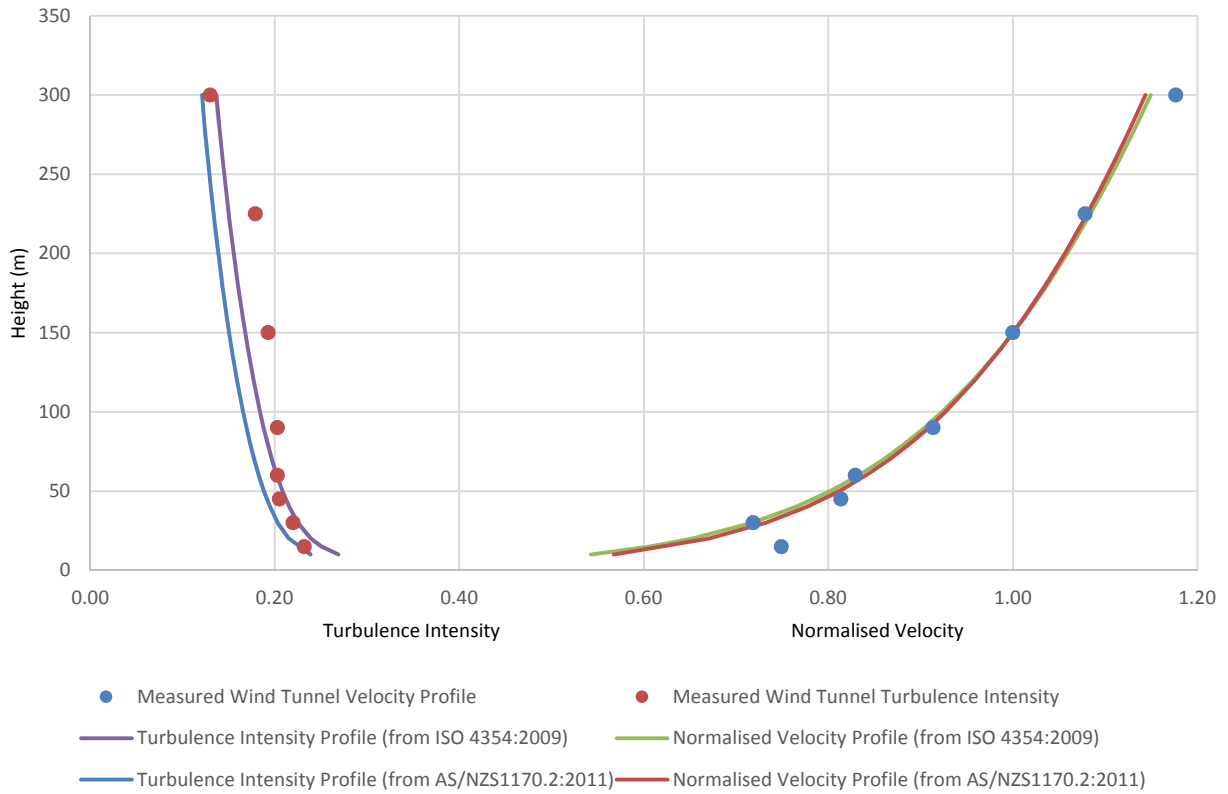

Longitudinal Spectra Density for Suburban/Forest Terrain ($0.2\text{m} < z_0 < 0.3\text{m}$) (TC3) at a 1:300 Scale

