

CONCRETE PIPE TRENCH BACKFILL DETAIL
≤ 900mm DIA.

EXISTING SURFACE LEVEL

FOOTPATH/ROAD TO SUIT
(REFER TO PAVEMENT DETAILS)


BACKFILL ZONE

OVERLAY ZONE

SIDE ZONES

HAUNCH ZONES

BED ZONE

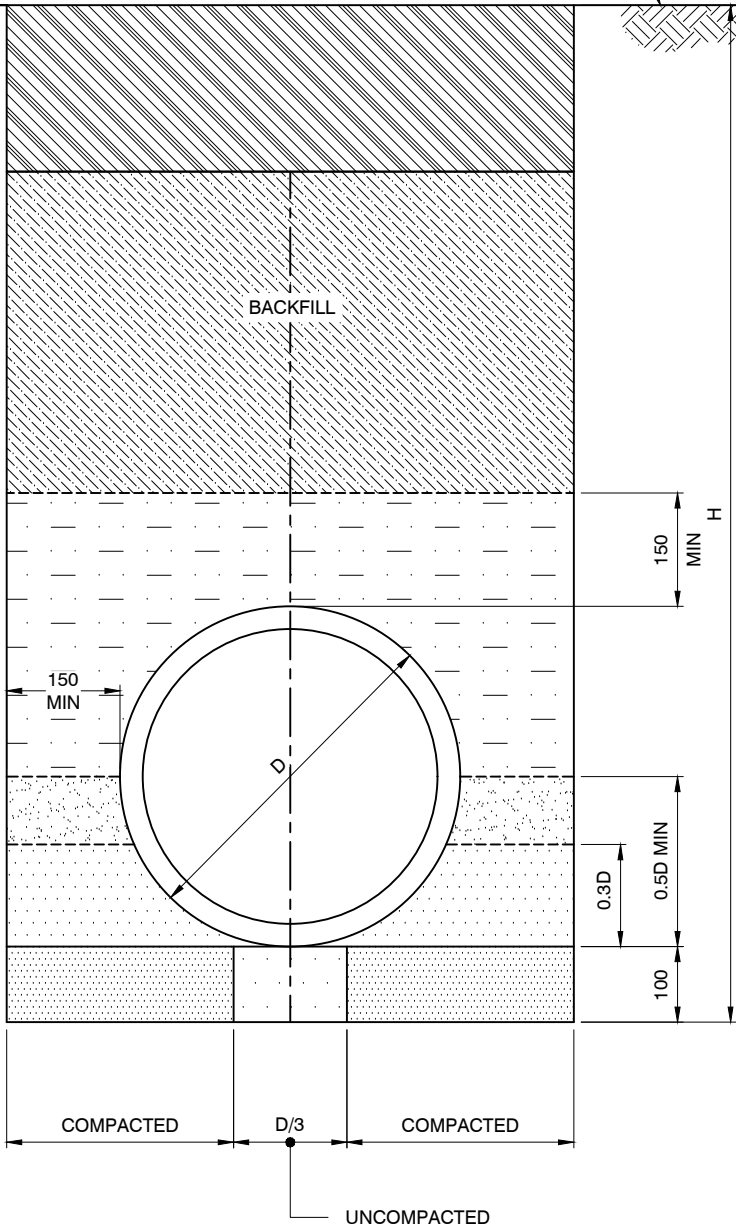

SECTION 1:10

- NOTES:
1. DRAINAGE PIPE TO BE MINIMUM 375Ø CLASS 4 REINFORCED CONCRETE PIPE.
 2. TRENCH BACKFILL DETAIL FOR DRAINAGE PIPE GREATER THAN 900 mm DIA SHALL BE REVIEWED AND APPROVED BY COUNCIL'S REPRESENTATIVE.
 3. ALL DIMENSIONS IN MILLIMETRES UNLESS OTHERWISE STATED.