


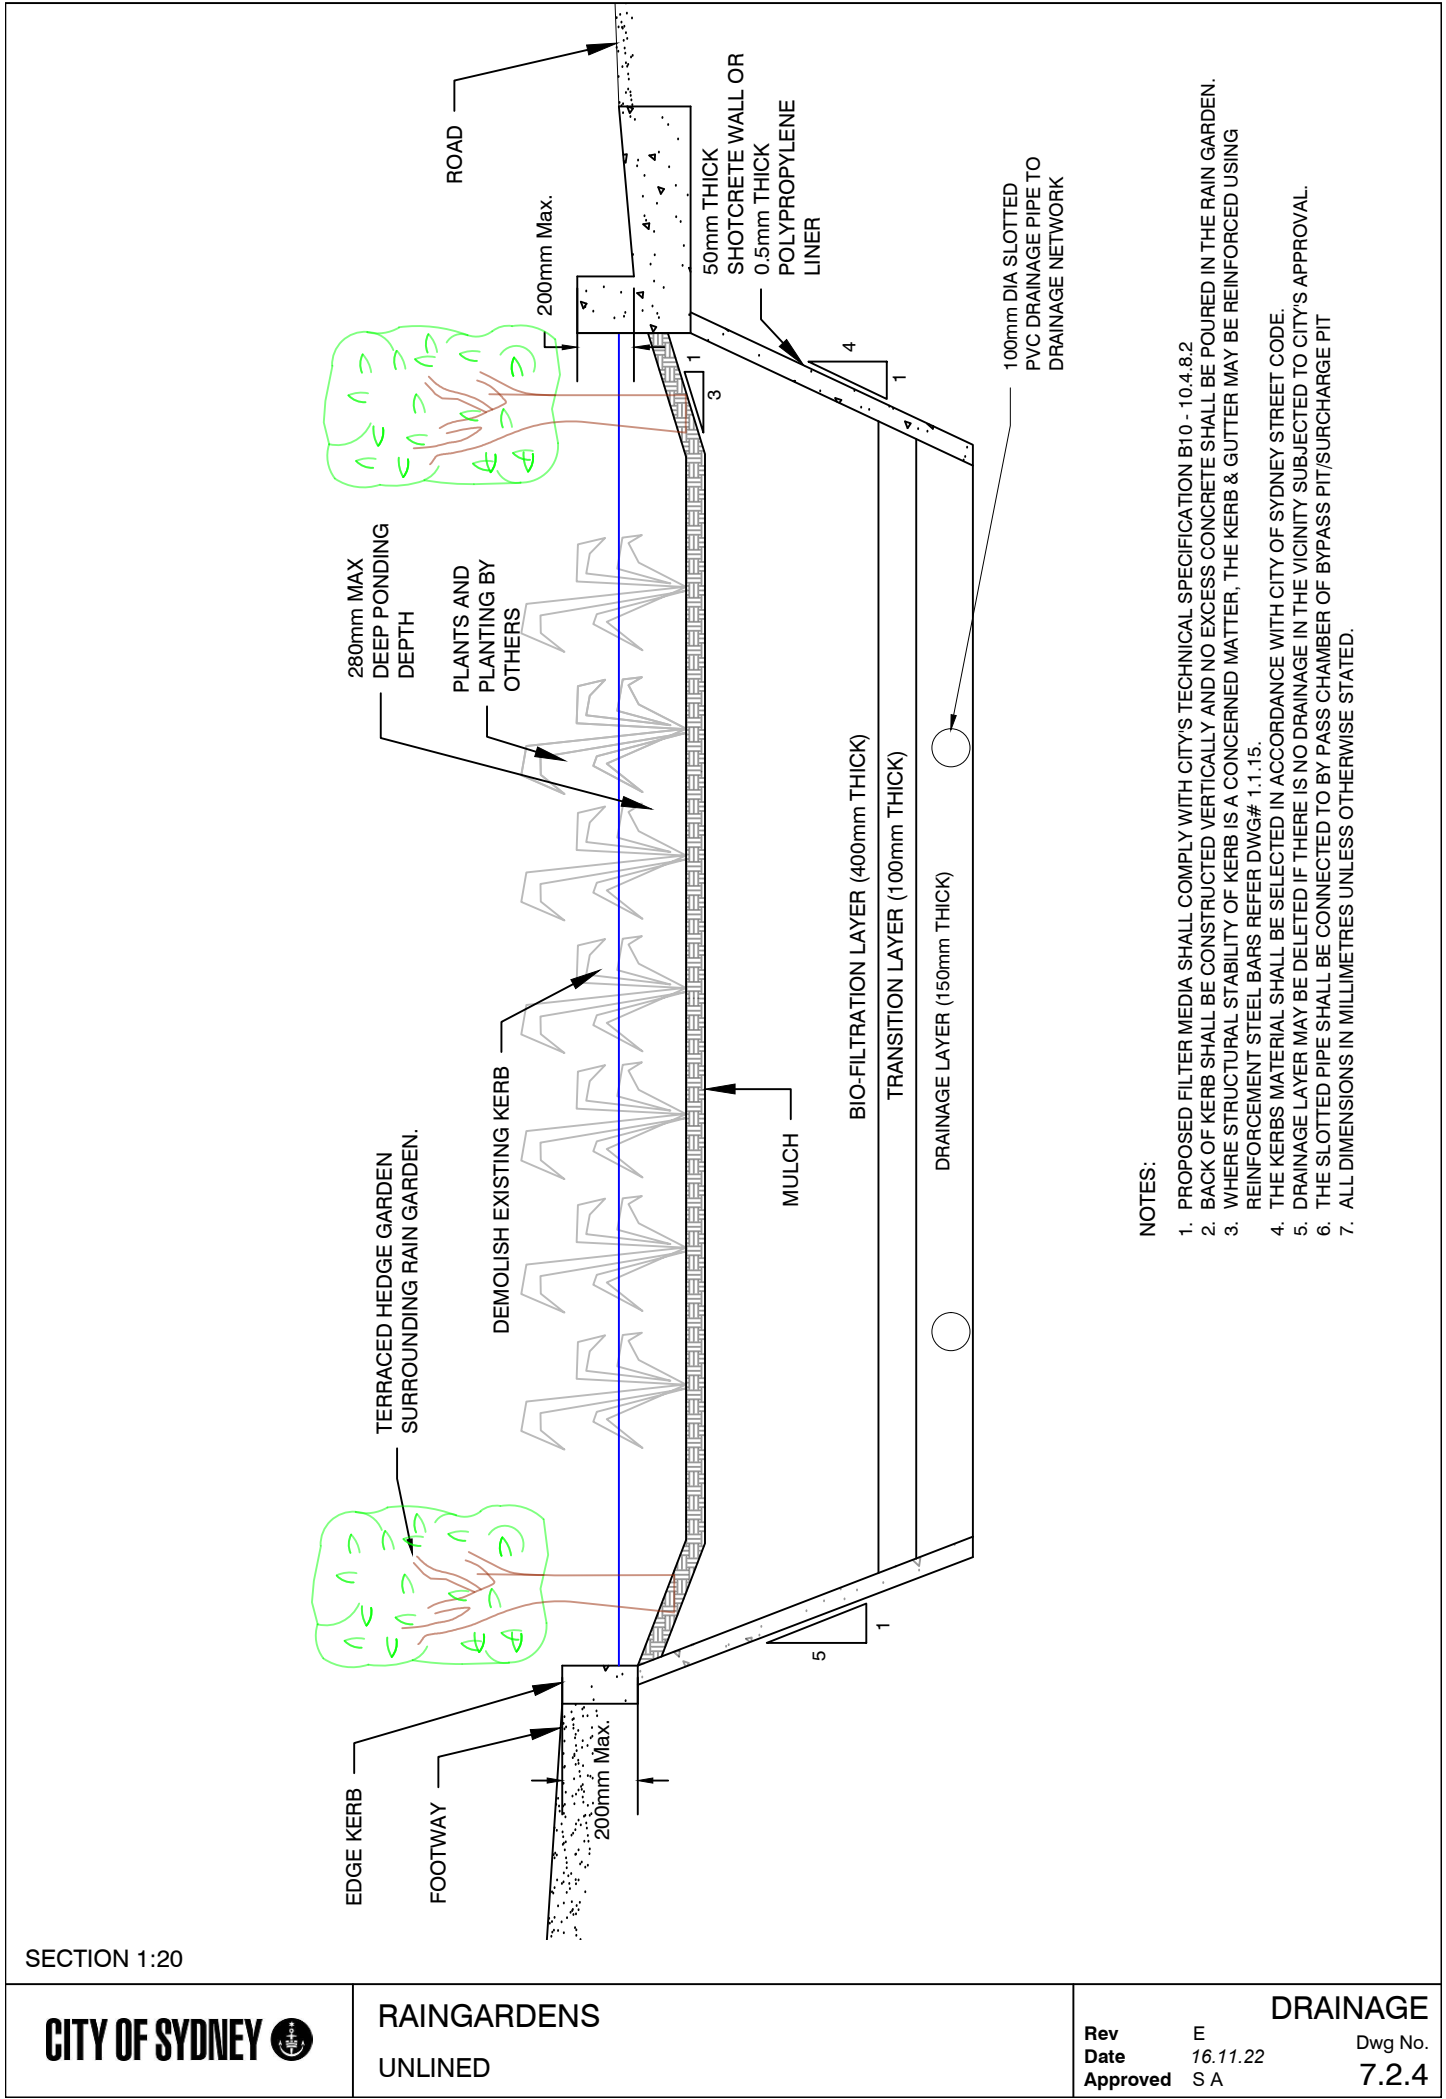

NOTES:

1. PROPOSED FILTER MEDIA SHALL COMPLY WITH CITY'S TECHNICAL SPECIFICATION B10 - 10.4.8.2
2. BACK OF KERB SHALL BE CONSTRUCTED VERTICALLY AND NO EXCESS CONCRETE SHALL BE POURED IN THE RAIN GARDEN.
3. WHERE STRUCTURAL STABILITY OF KERB IS A CONCERNED MATTER, THE KERB & GUTTER MAY BE REINFORCED USING REINFORCEMENT STEEL BARS REFER DWG# 1.1.15.
4. THE KERBS MATERIAL SHALL BE SELECTED IN ACCORDANCE WITH CITY OF SYDNEY STREET CODE.
5. DRAINAGE LAYER MAY BE DELETED IF THERE IS NO DRAINAGE IN THE VICINITY SUBJECTED TO CITY'S APPROVAL.
6. THE SLOTTED PIPE SHALL BE CONNECTED TO BY PASS CHAMBER OF BYPASS PIT/SURCHARGE PIT
7. ALL DIMENSIONS IN MILLIMETRES UNLESS OTHERWISE STATED.

SECTION 1:20