



PLAN

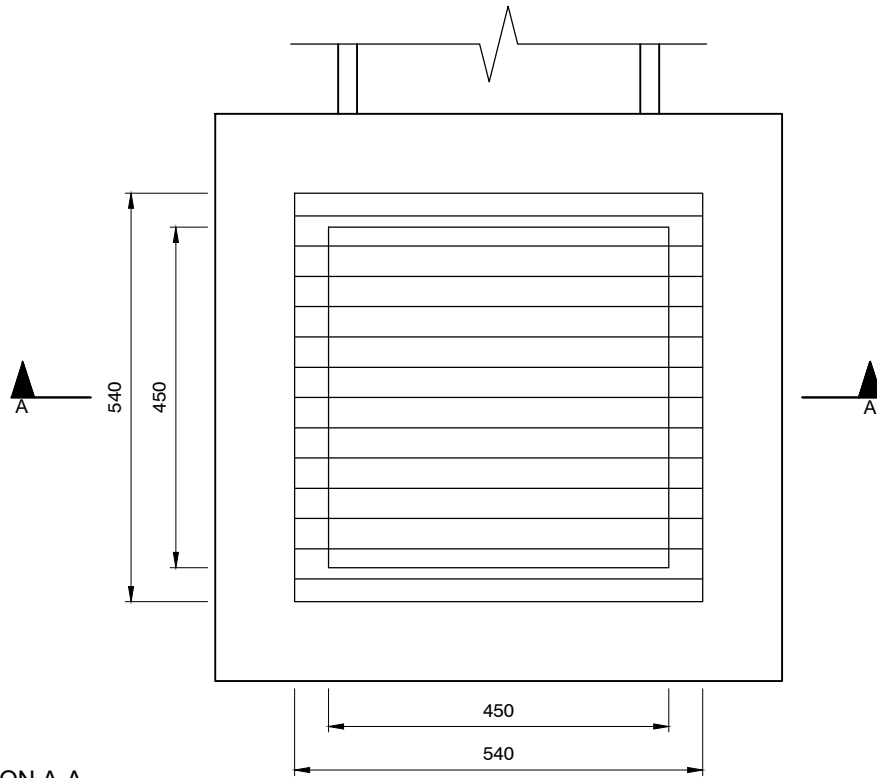

SECTION A-A

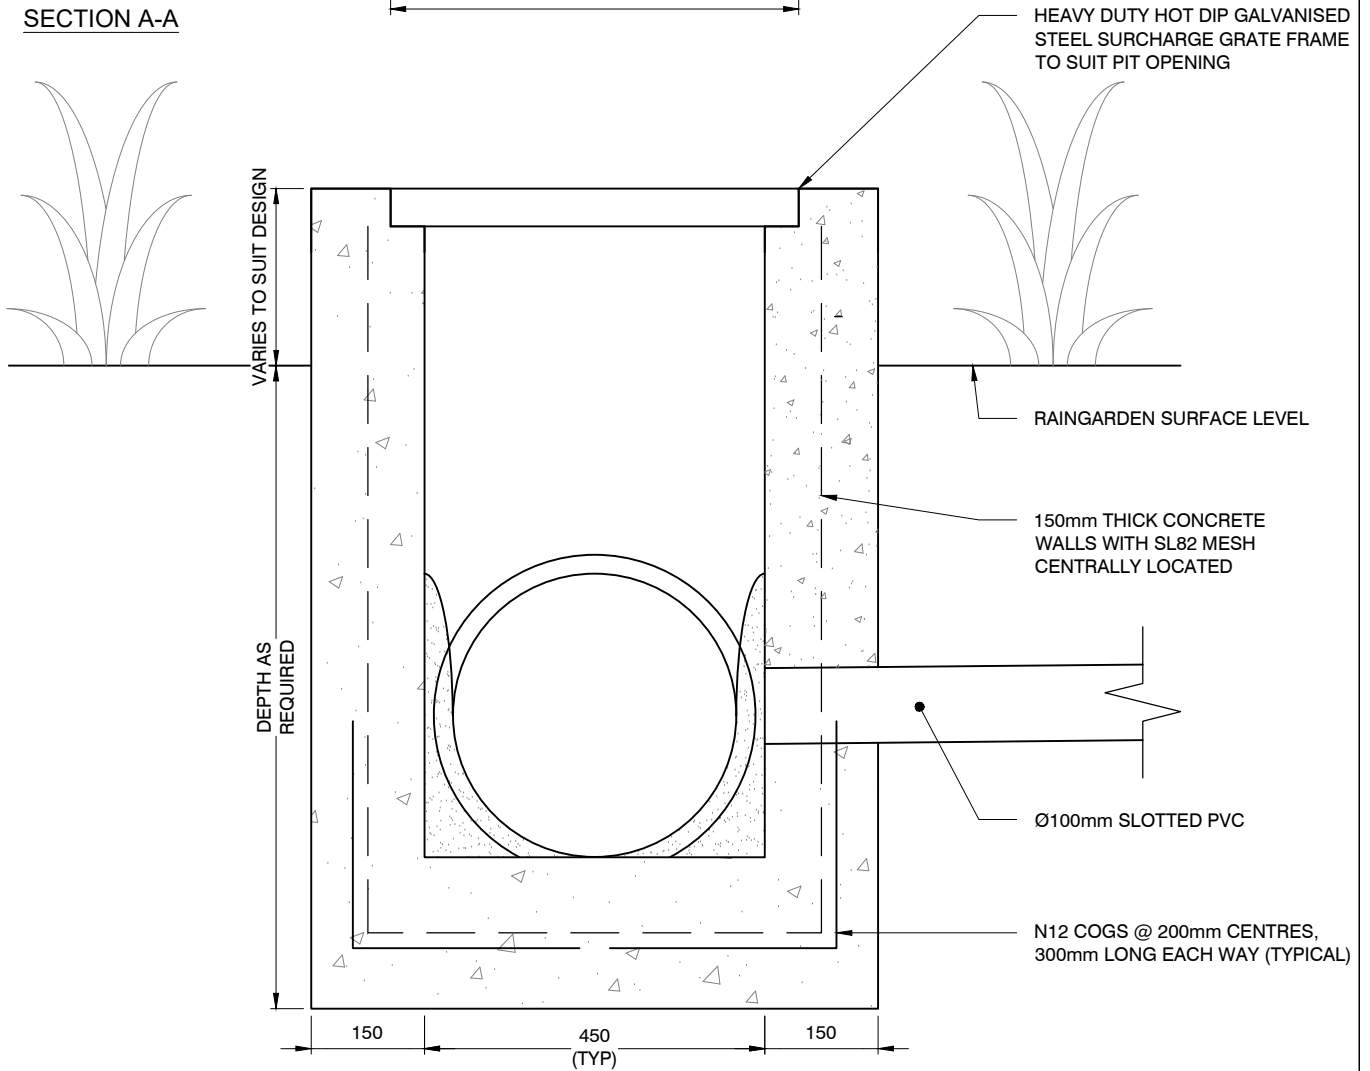

SCALE 1:10

NOTES:

1. ALL CONCRETE IS TO HAVE A MINIMUM STRENGTH OF 32 MPa.
2. PIT STRUCTURE TO BE 150mm THICK UNLESS NOTED OTHERWISE.
3. DRAINAGE PIPE TO BE MINIMUM 375Ø CLASS 4 REINFORCED CONCRETE PIPE
4. ALL DIMENSIONS IN MILLIMETRES UNLESS OTHERWISE STATED