


NOTES:



1. THE RAINGARDENS ARE PREFERRED TO BE TERRACED RAINGARDEN TO MAXIMISE THE PONDING VOLUME. REFER DRAWING 7.2.5.
2. THE RAINGARDEN & SURROUNDINGS AREAS SHALL BE DESIGNED IN ACCORDANCE WITH SYDNEY STREET TECHNICAL SPECIFICATION PART A4.
3. ALL DIMENSIONS IN MILLIMETRES UNLESS OTHERWISE STATED.

SECTION 1:20

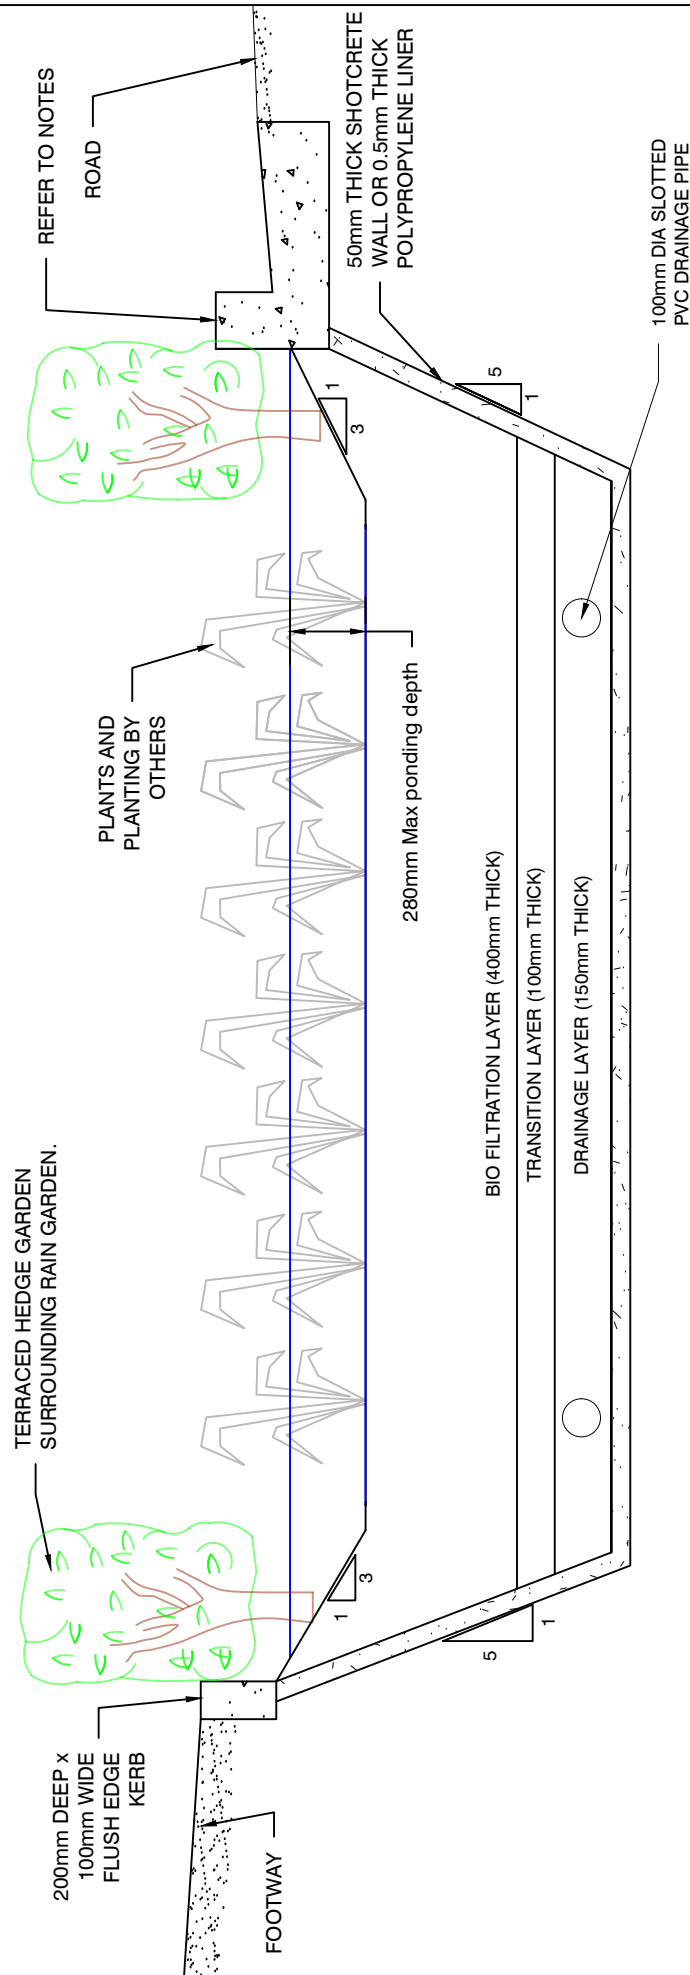


NOTES:

1. PROPOSED FILTER MEDIA SHALL COMPLY WITH CITY'S TECHNICAL SPECIFICATION B10 - 10.4.8.2
2. BACK OF KERB SHALL BE CONSTRUCTED VERTICALLY AND NO EXCESS CONCRETE SHALL BE POURED IN THE RAIN GARDEN.
3. WHERE STRUCTURAL STABILITY OF KERB IS A CONCERNED MATTER, THE KERB & GUTTER MAY BE REINFORCED USING REINFORCEMENT STEEL BARS REFER DWG# 1.1.15.
4. THE KERBS MATERIAL SHALL BE SELECTED IN ACCORDANCE WITH CITY OF SYDNEY STREET CODE.
5. ALL DIMENSIONS IN MILLIMETRES UNLESS OTHERWISE STATED.

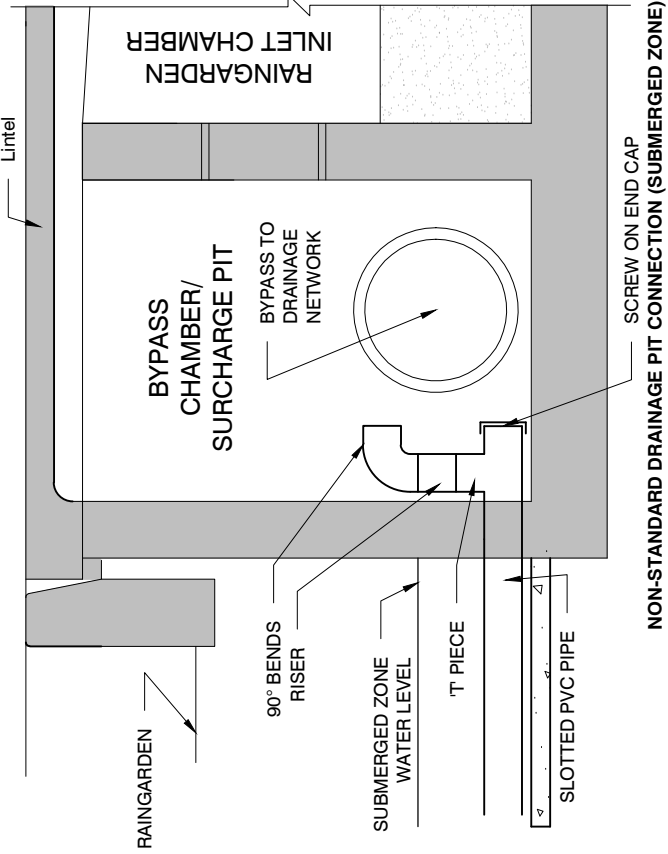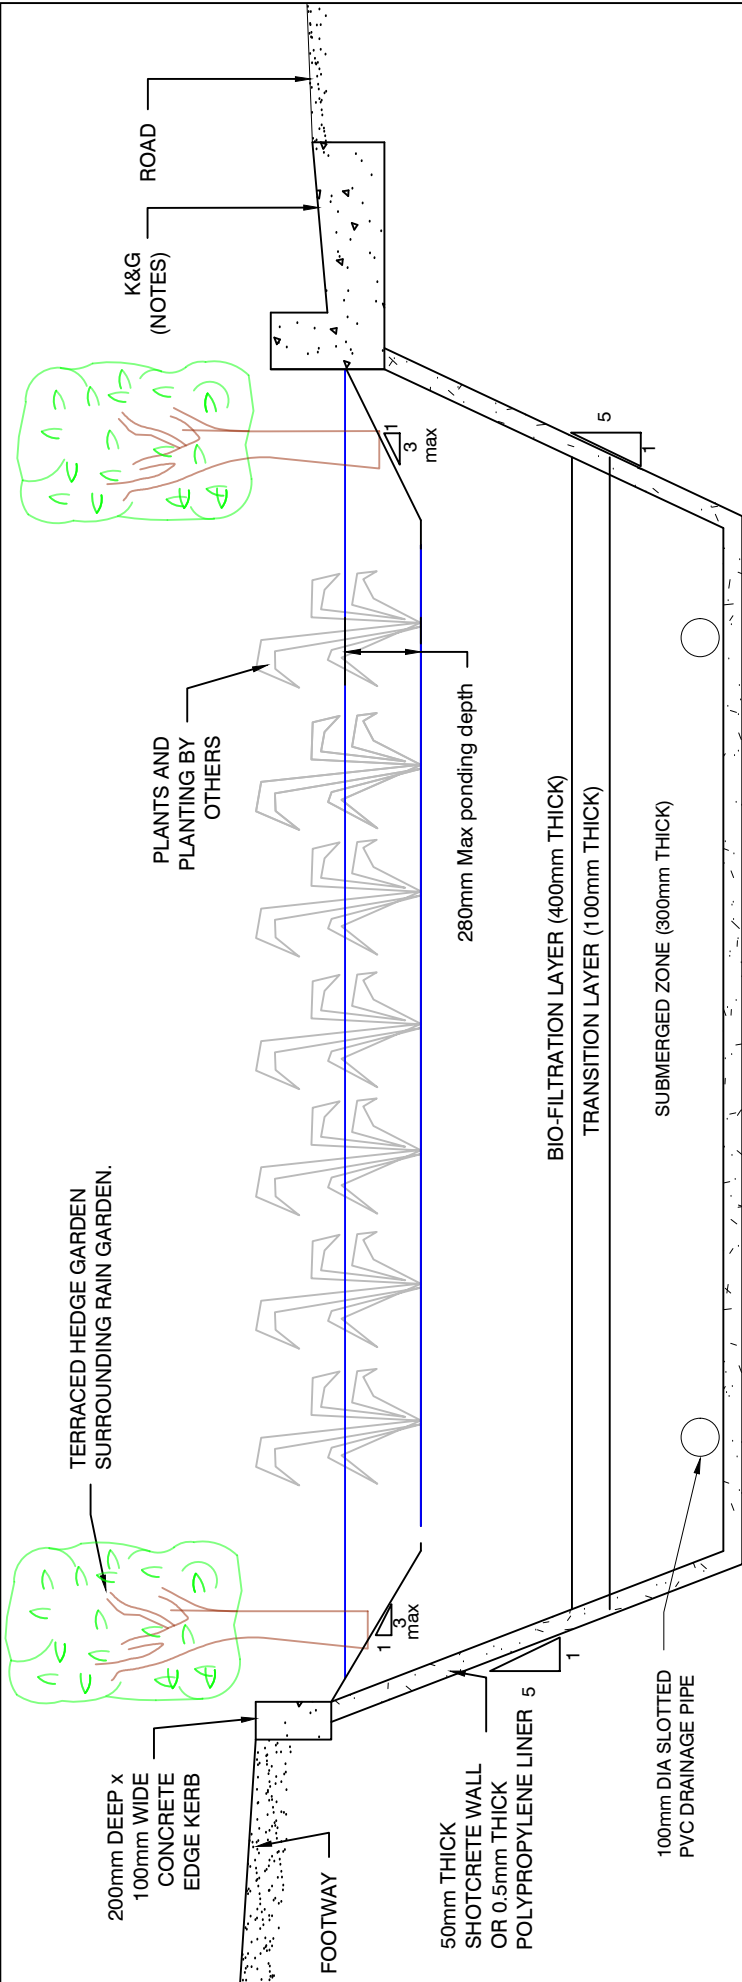




- NOTES:
1. PROPOSED FILTER MEDIA SHALL COMPLY WITH CITY'S TECHNICAL SPECIFICATION B10 - 10.4.8.2
 2. BACK OF KERB SHALL BE CONSTRUCTED VERTICALLY AND NO EXCESS CONCRETE SHALL BE POURED IN THE RAIN GARDEN.
 3. WHERE STRUCTURAL STABILITY OF KERB IS A CONCERNED MATTER, THE KERB & GUTTER MAY BE REINFORCED USING REINFORCEMENT STEEL BARS REFER DWG# 1.1.15.
 4. THE KERBS MATERIAL SHALL BE SELECTED IN ACCORDANCE WITH CITY OF SYDNEY STREET CODE.
 5. ALL DIMENSIONS IN MILLIMETRES UNLESS OTHERWISE STATED.

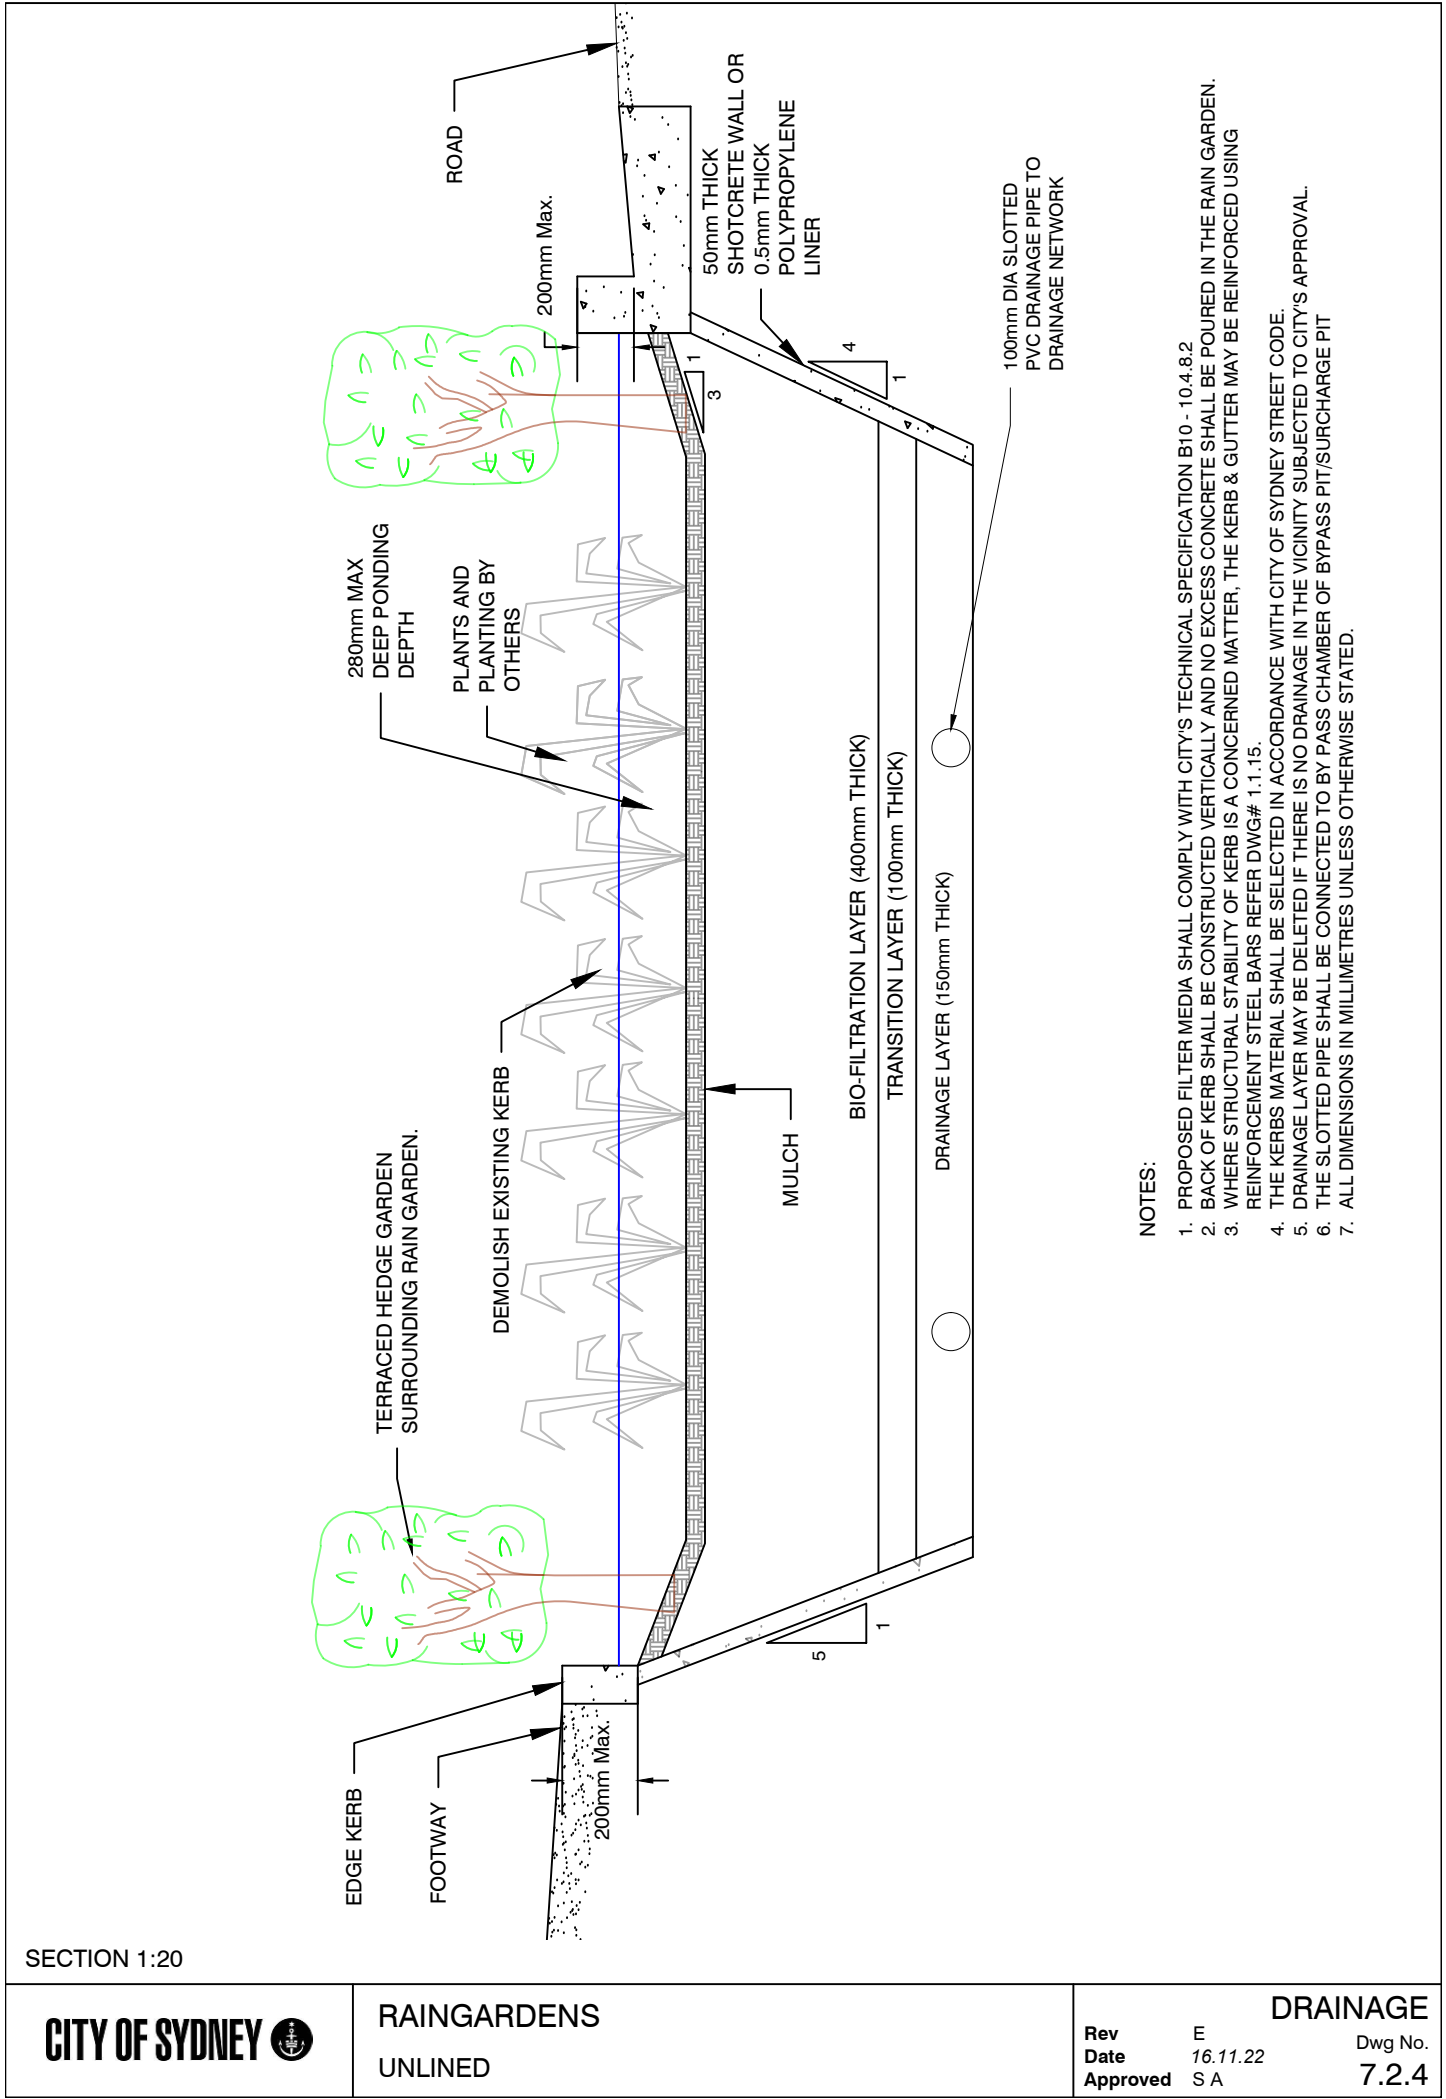

NOTES:

1. PROPOSED FILTER MEDIA SHALL COMPLY WITH CITY'S TECHNICAL SPECIFICATION B10 - 10.4.8.2
2. BACK OF KERB SHALL BE CONSTRUCTED VERTICALLY AND NO EXCESS CONCRETE SHALL BE POURED IN THE RAIN GARDEN.
3. WHERE STRUCTURAL STABILITY OF KERB IS A CONCERNED MATTER, THE KERB & GUTTER MAY BE REINFORCED USING REINFORCEMENT STEEL BARS REFER DWG# 1.1.15.
4. THE KERBS MATERIAL SHALL BE SELECTED IN ACCORDANCE WITH CITY OF SYDNEY STREET CODE.
5. DRAINAGE LAYER MAY BE DELETED IF THERE IS NO DRAINAGE IN THE VICINITY SUBJECTED TO CITY'S APPROVAL.
6. THE SLOTTED PIPE SHALL BE CONNECTED TO BY PASS CHAMBER OF BYPASS PIT/SURCHARGE PIT
7. ALL DIMENSIONS IN MILLIMETRES UNLESS OTHERWISE STATED.


SECTION 1:20

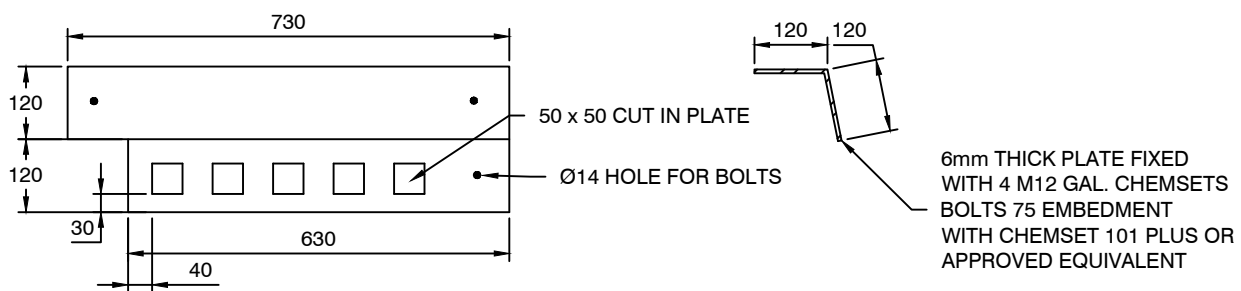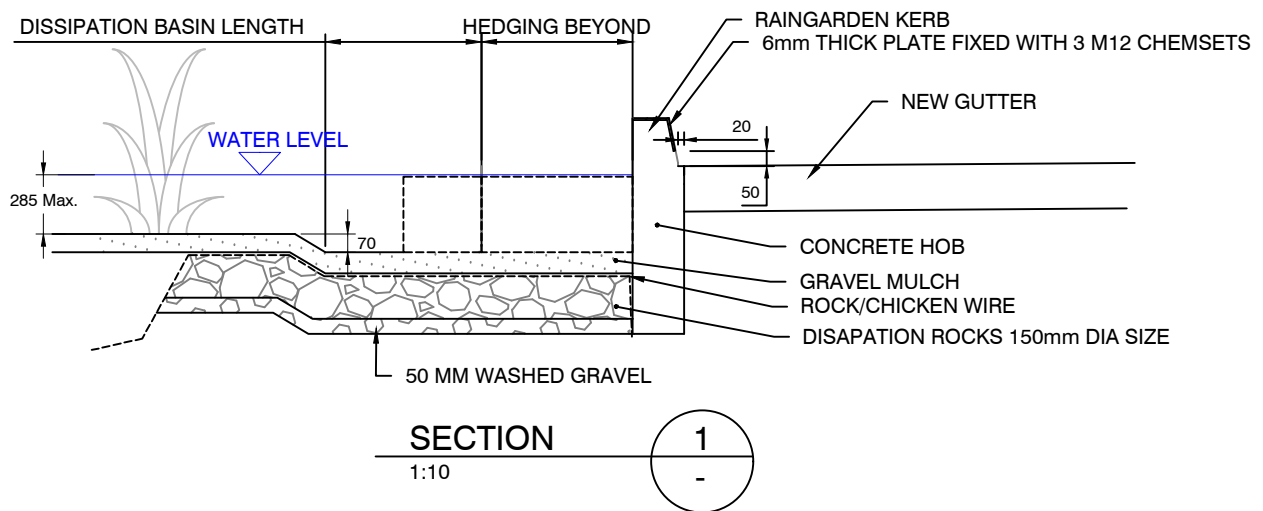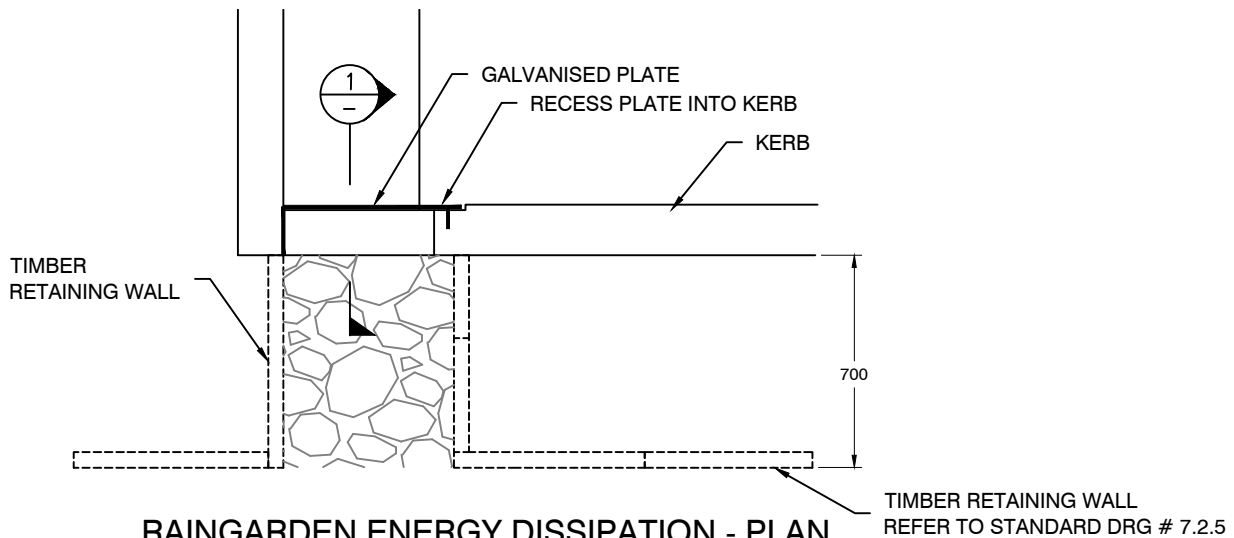


NOTES:

1. DISSIPATION BASIN LENGTH SHALL BE MINIMUM 400mm UNLESS NOTES OTHERWISE.
2. T - TERRACE GARDEN IS THE PREFERRED OPTION FOR MOST OF RAINGARDENS EXCEPT ROCK SWALES: IN WHICH CASE ENTRY STRUCTURE SHALL BE DESIGNED TO SUIT THE ROCK SWALE
3. THE PLATE SHALL BE RECESSED INTO THE KERB
4. ALL DIMENSIONS IN MILLIMETRES UNLESS OTHERWISE STATED

PLAN

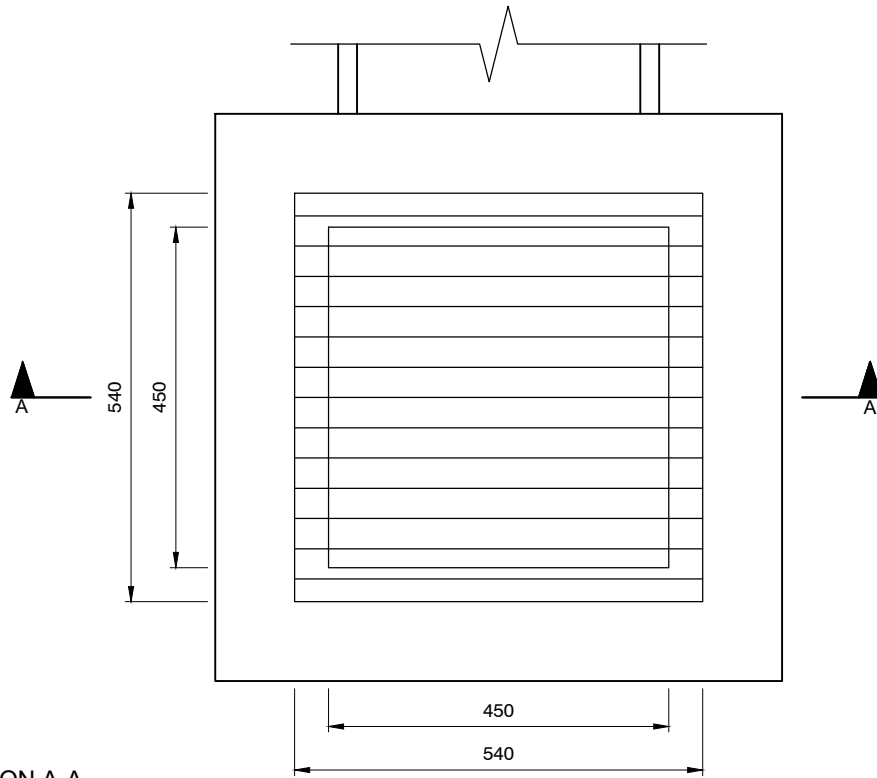


SECTION A-A

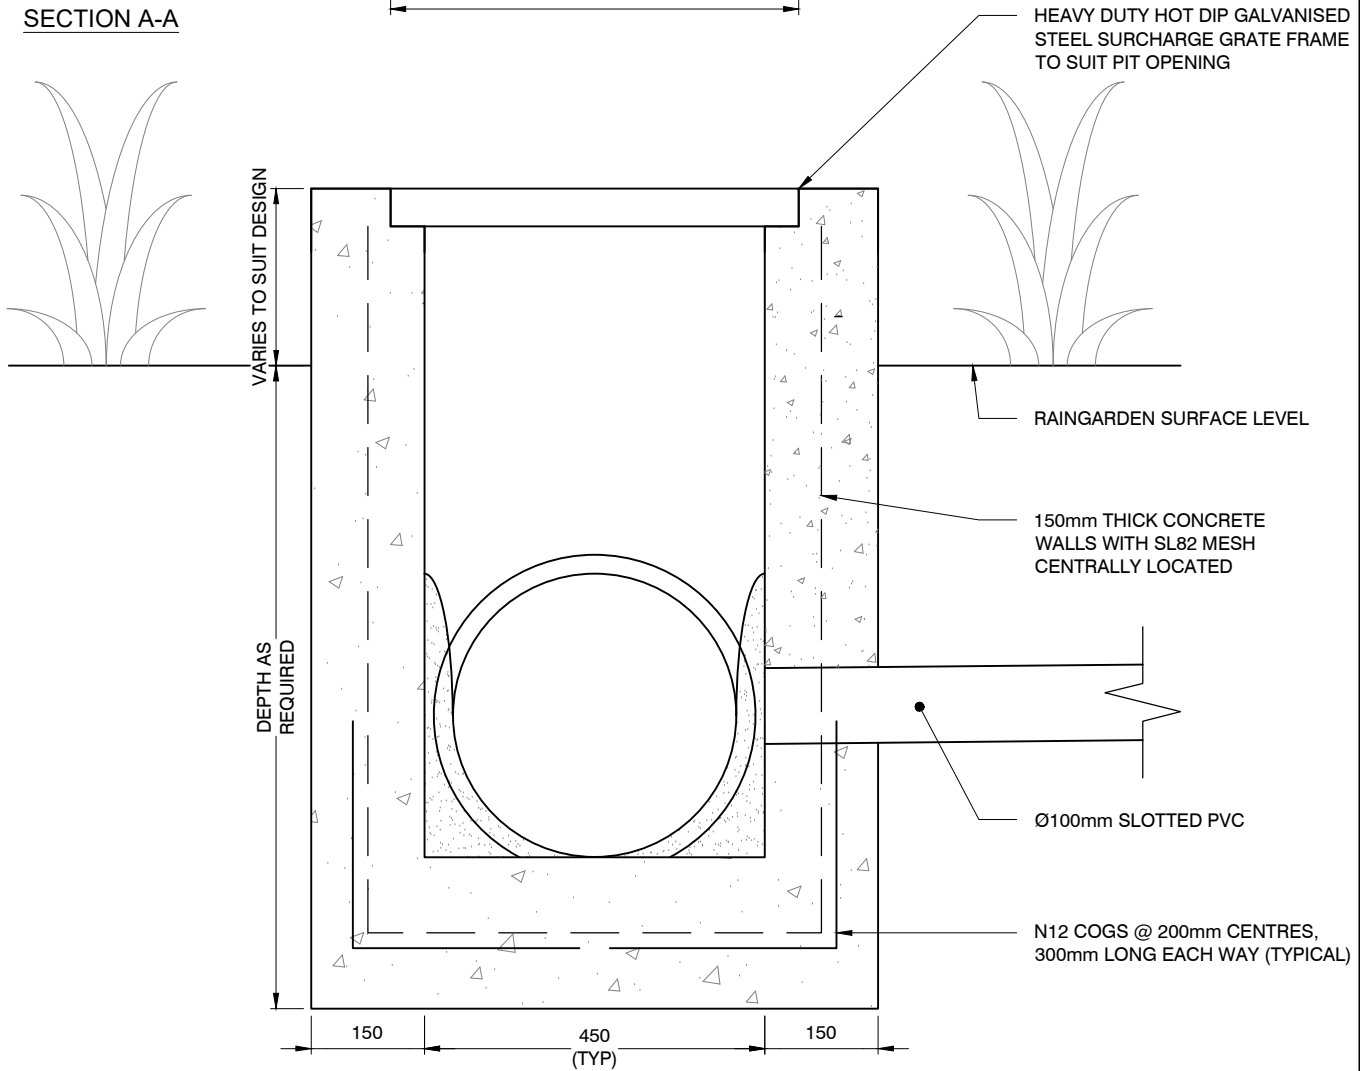



SCALE 1:10

NOTES:



1. ALL CONCRETE IS TO HAVE A MINIMUM STRENGTH OF 32 MPa.
2. PIT STRUCTURE TO BE 150mm THICK UNLESS NOTED OTHERWISE.
3. DRAINAGE PIPE TO BE MINIMUM 375Ø CLASS 4 REINFORCED CONCRETE PIPE
4. ALL DIMENSIONS IN MILLIMETRES UNLESS OTHERWISE STATED

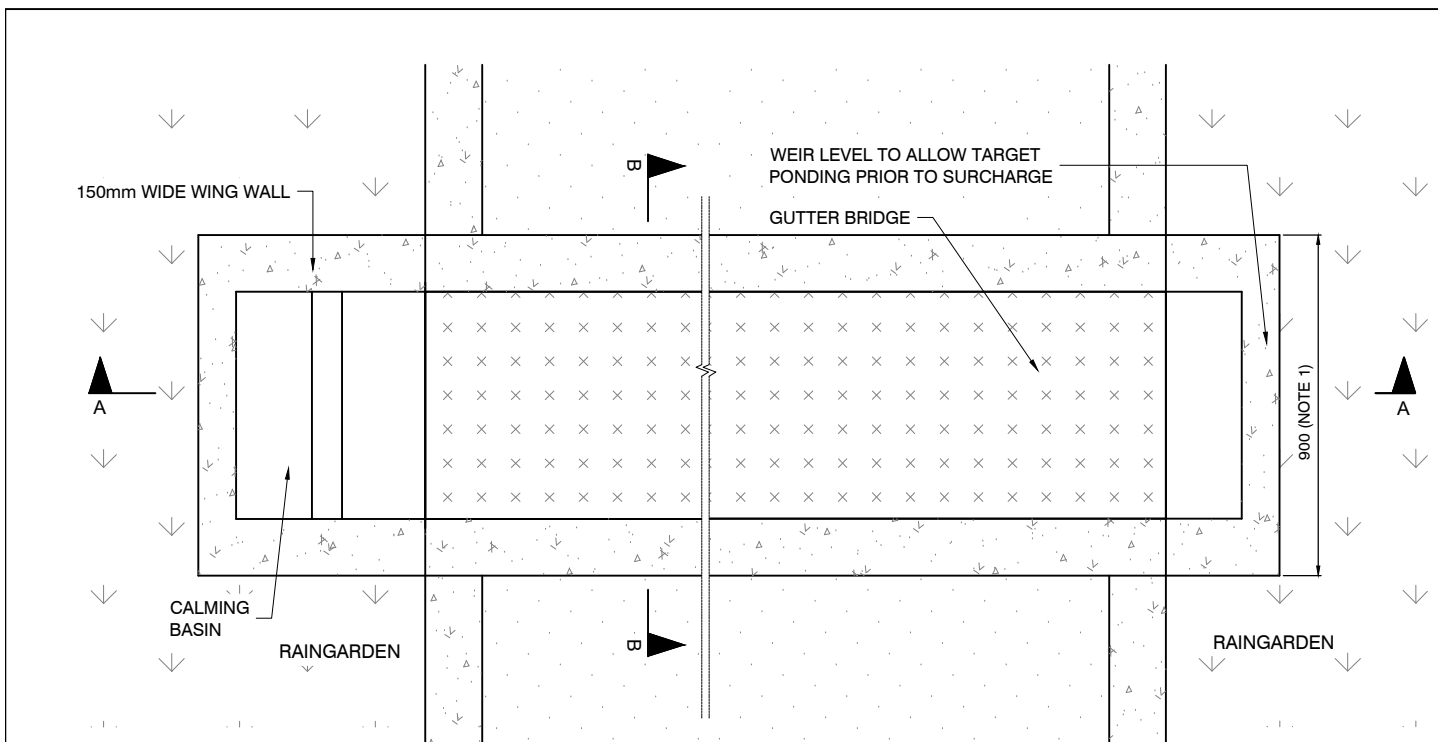

PLAN
1:20

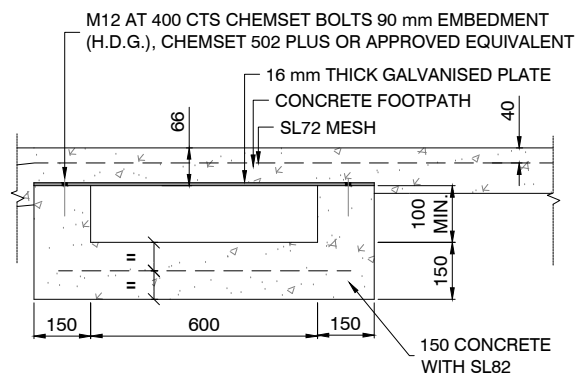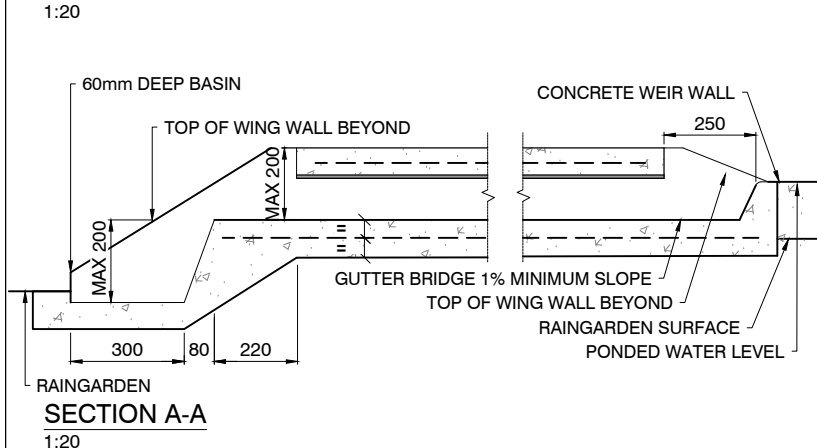

CONCRETE GUTTER BRIDGE

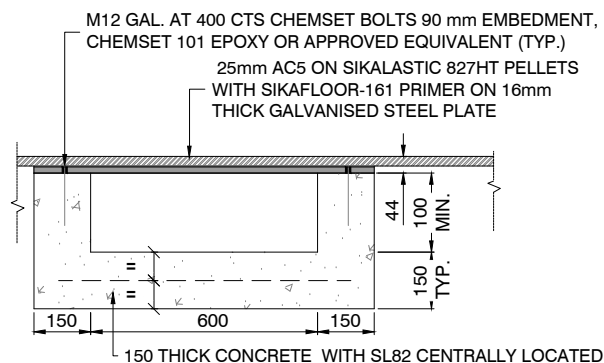
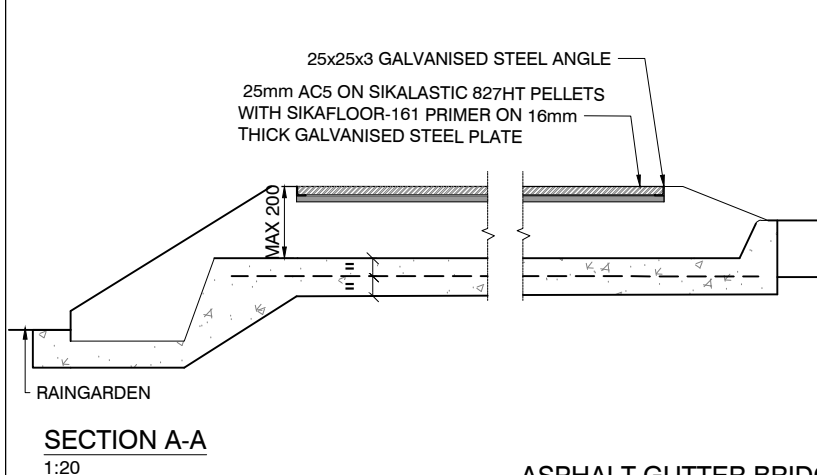


ASPHALT GUTTER BRIDGE

NOTES:

- GUTTER BRIDGE SHALL BE DESIGNED TO SUIT MINIMUM 5 YEARS ARI STORM. DESIGNER SHALL SUBMIT MAINTENANCE REGIME WITH ANY RAINGARDEN INCORPORATED IN DESIGN.
- USE OF BONDEK IS NOT ALLOWED FOR GUTTER BRIDGES.
- SIZE OF GUTTER BRIDGE SHALL BE DESIGNED TO SUIT THE ANTICIPATED FLOW RATES
- COMPRESSIVE STRENGTH OF CONCRETE AT 28 DAYS TO BE 32MPa.
- CONCRETE STRUCTURES & REINFORCEMENT TO COMPLY WITH AS 3600, AS 4671 & CoS TECHNICAL SPECIFICATIONS.
- ALL DIMENSIONS IN MILLIMETRES UNLESS OTHERWISE STATED

SMALL DISSIPATION ROCKS

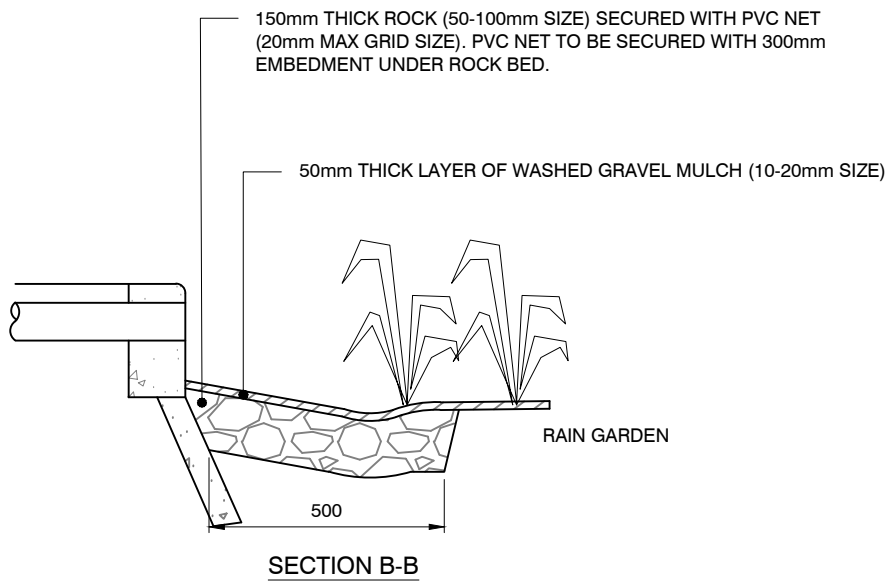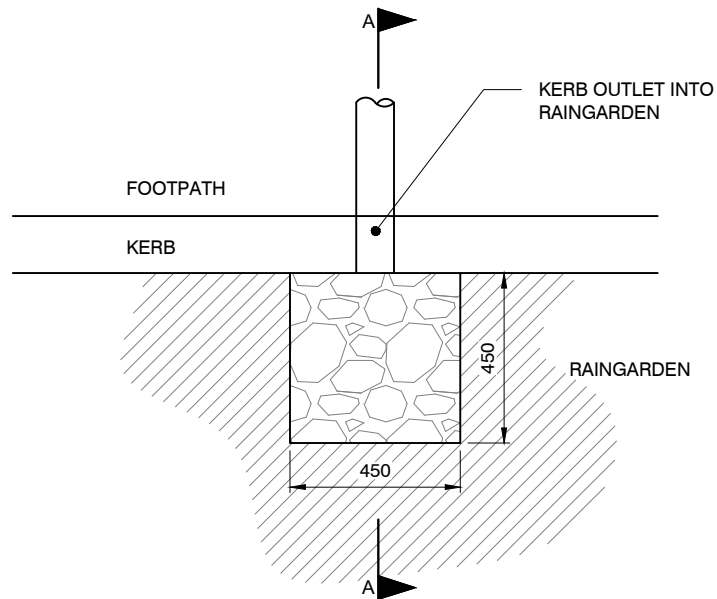


SCALE 1:20

NOTE: ALL DIMENSIONS IN MILLIMETRES UNLESS OTHERWISE STATED


Ø 100 HIGH END RISER

SECTION

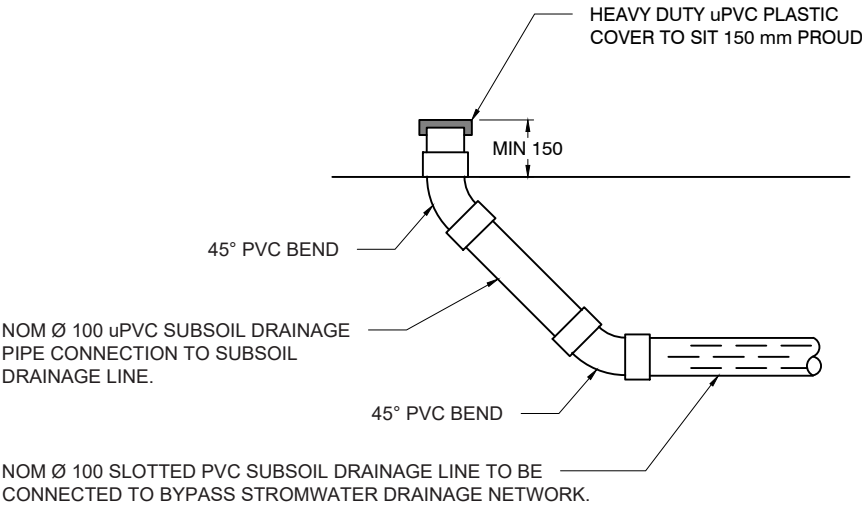


Ø 225 HIGH END RISER JUNCTION

PLAN

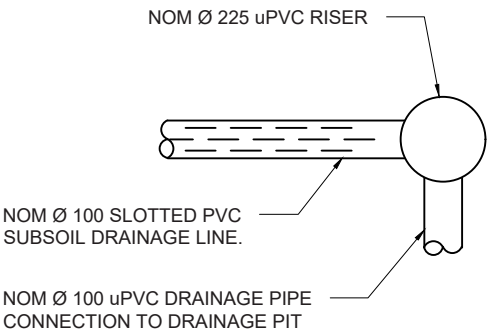






SECTION

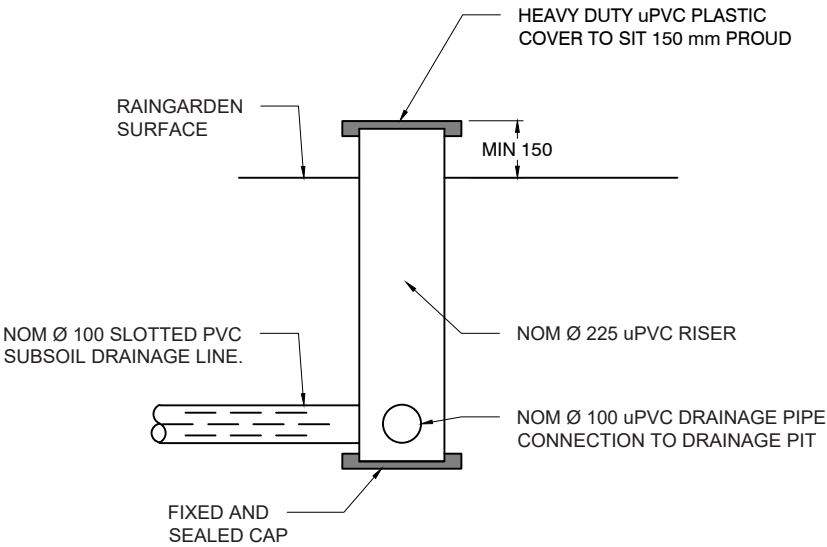

NOTES:





1. THE SUBSOIL DRAIN SHALL BE CONNECTED TO THE
 - BYPASS CHAMBER OF THE INLET PIT, OR;
 - BYPASS DRAINAGE PIT, OR;
 - RAINGARDEN SURCHARGE PIT.
2. ALL DIMENSIONS IN MILLIMETRES UNLESS OTHERWISE STATED.

SCALE 1:20

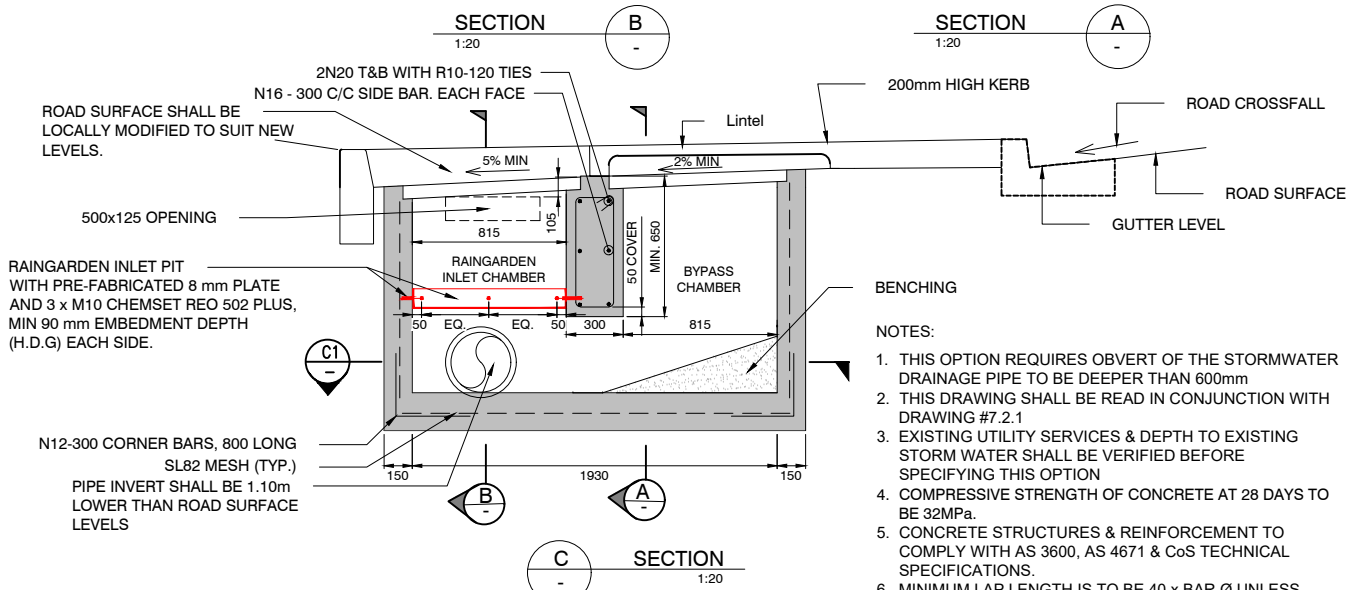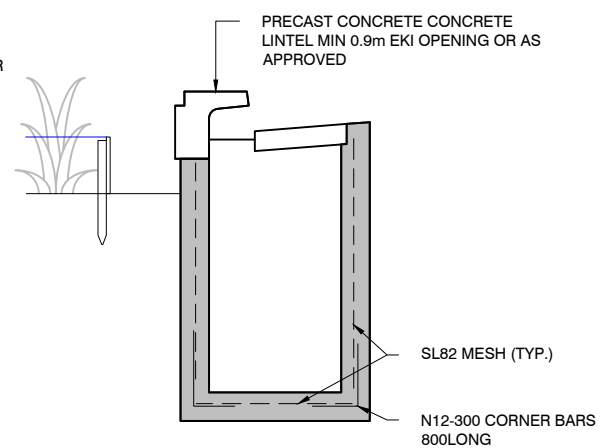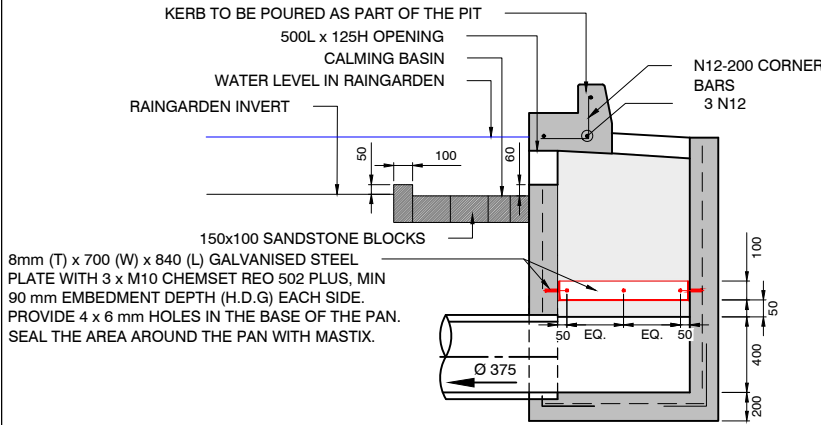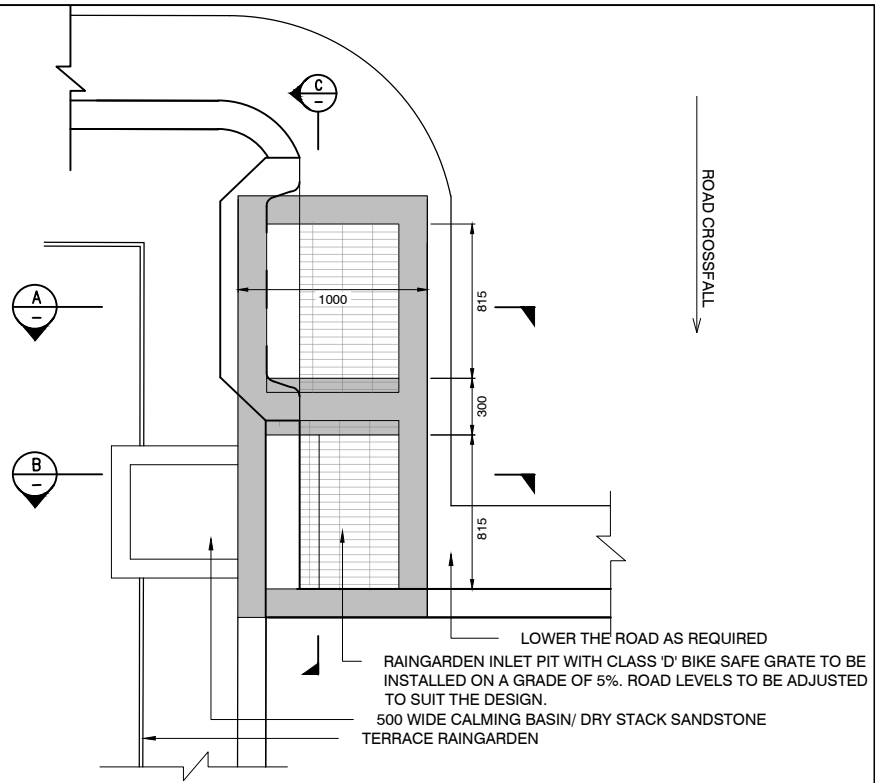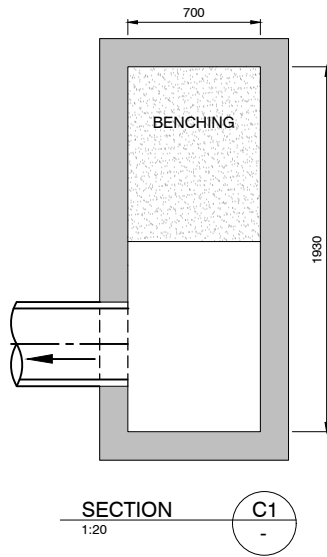


- NOTES:
1. THIS OPTION REQUIRES OBVERT OF THE STORMWATER DRAINAGE PIPE TO BE DEEPER THAN 600mm
 2. THIS DRAWING SHALL BE READ IN CONJUNCTION WITH DRAWING #7.2.1
 3. EXISTING UTILITY SERVICES & DEPTH TO EXISTING STORM WATER SHALL BE VERIFIED BEFORE SPECIFYING THIS OPTION
 4. COMPRESSIVE STRENGTH OF CONCRETE AT 28 DAYS TO BE 32MPa.
 5. CONCRETE STRUCTURES & REINFORCEMENT TO COMPLY WITH AS 3600, AS 4671 & CoS TECHNICAL SPECIFICATIONS.
 6. MINIMUM LAP LENGTH IS TO BE 40 x BAR Ø UNLESS NOTED OTHERWISE.
 7. ALL DIMENSIONS IN MILLIMETRES UNLESS OTHERWISE STATED

SCALE 1:40

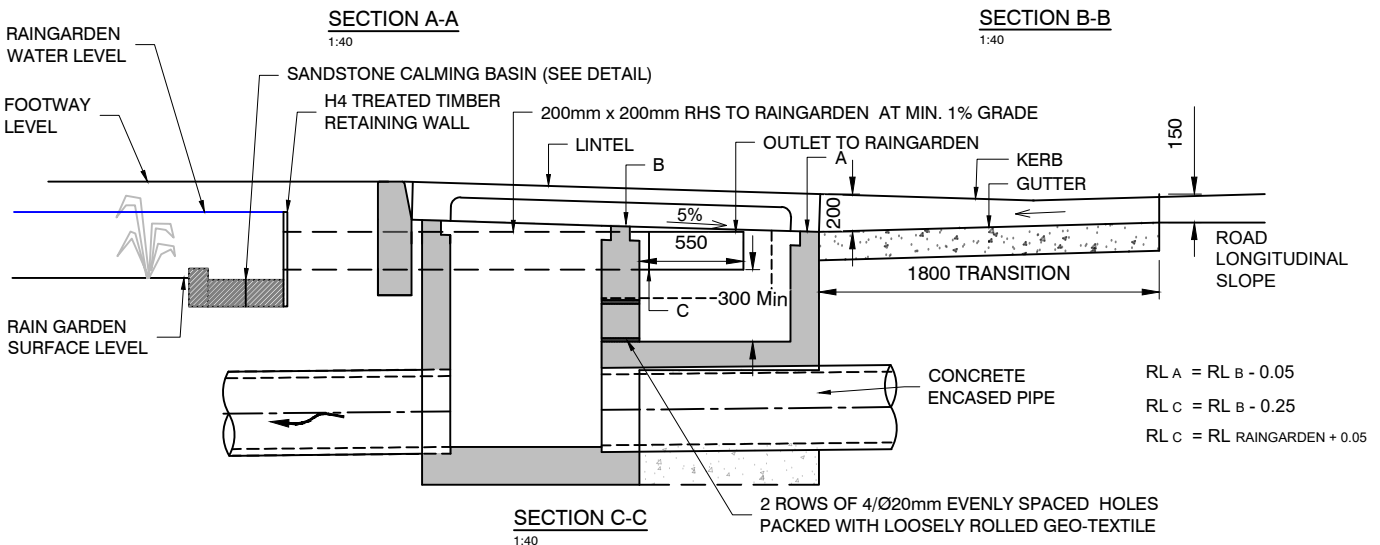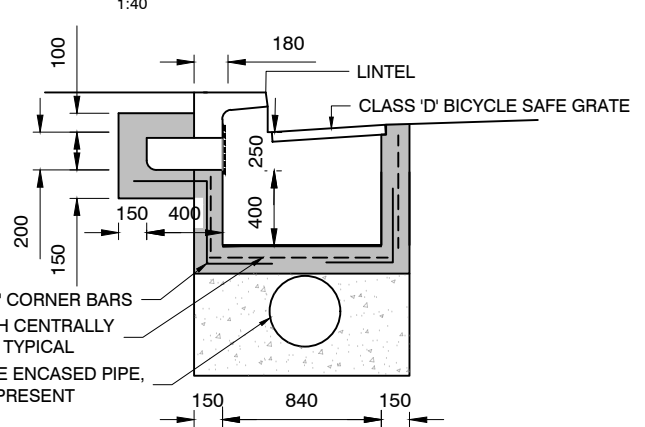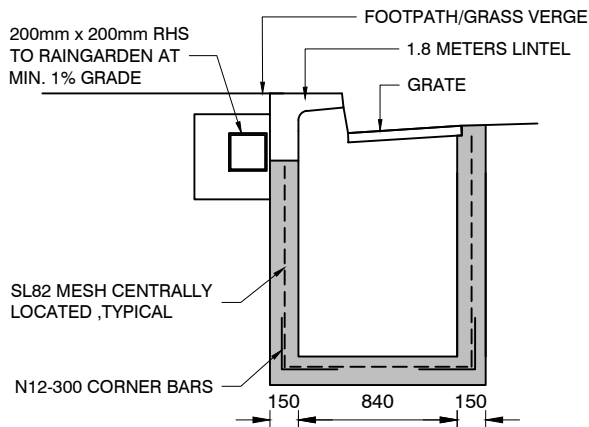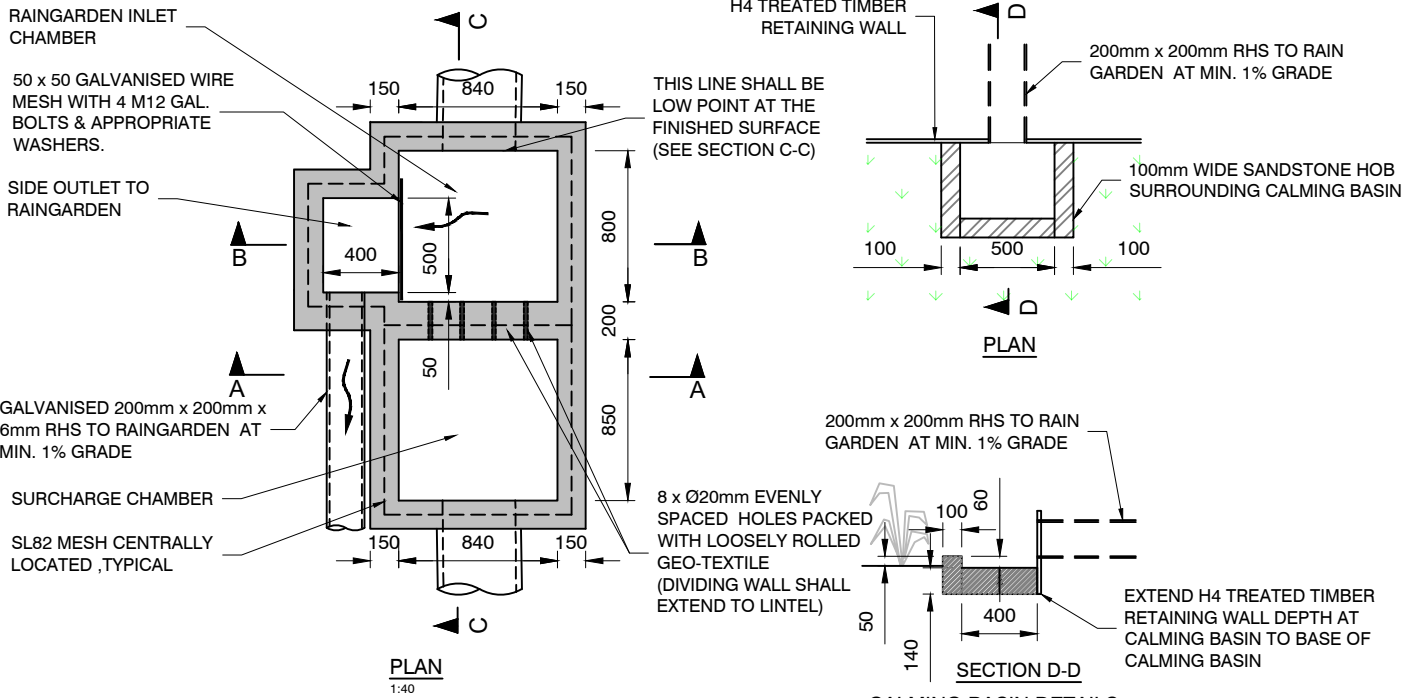

NOTES:


1. THIS DRAWING SHALL BE READ IN CONJUNCTION WITH DRAWING #7.2.1
2. THIS OPTION REQUIRES OBVERT OF THE STORMWATER DRAINAGE PIPE TO BE DEEPER THAN 700 mm.
3. SIZE OF THE BYPASS SHALL BE ADJUSTED TO SUIT THE CATCHMENT SIZE.
4. ALL DIMENSIONS IN MILLIMETRES UNLESS OTHERWISE STATED

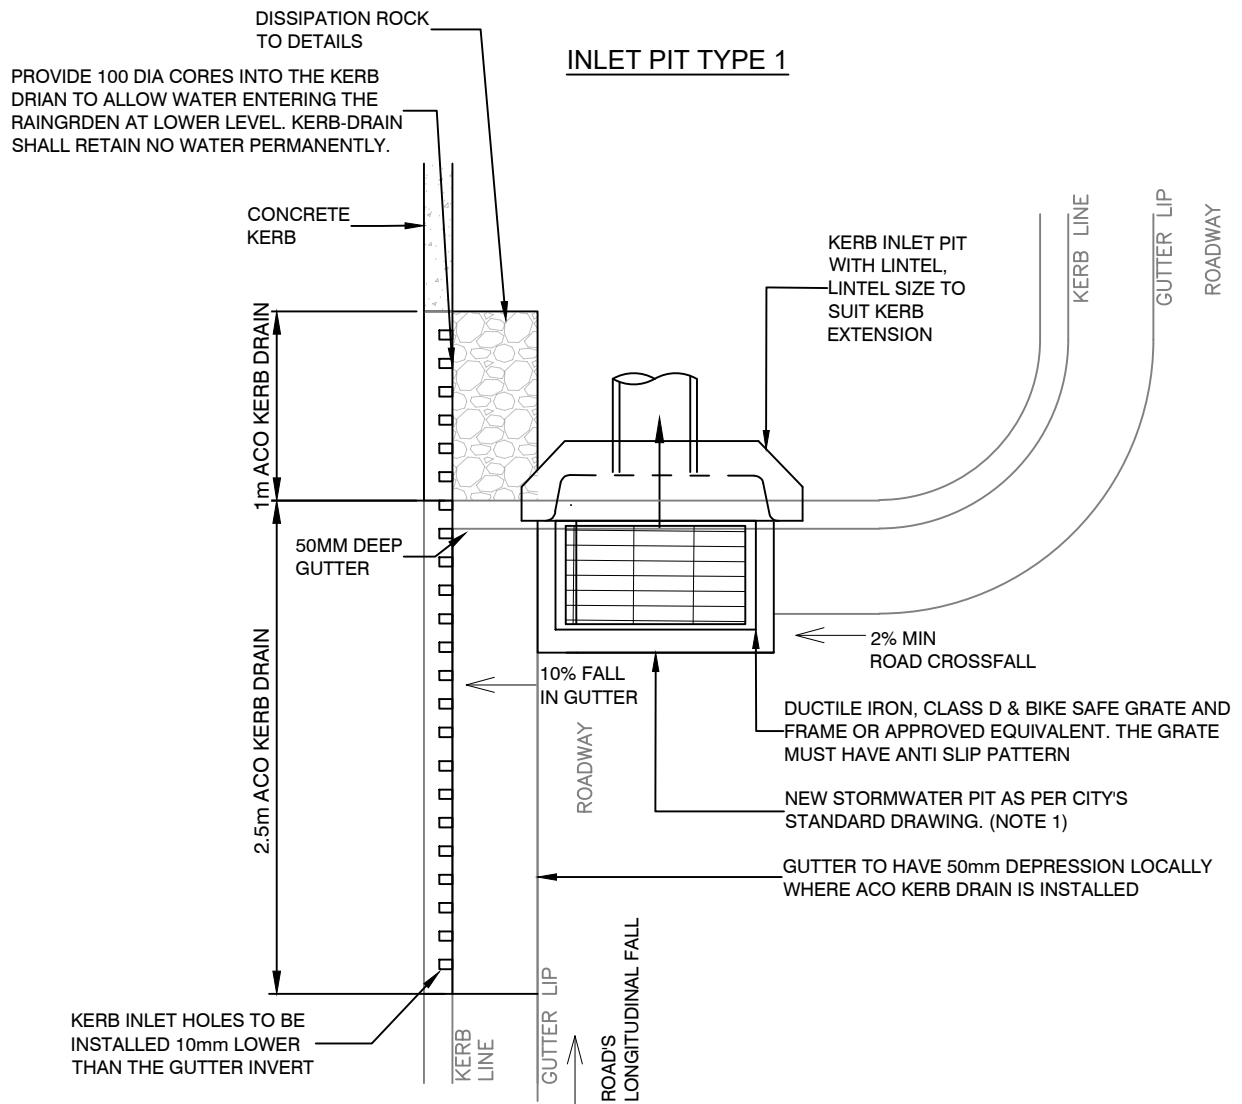

PLAN
1:40


NOTES:

1. STORMWATER PIT SHALL BE CONSTRUCTED AS PER CITY'S STANDARD DRAWINGS. THE PIT SHALL BE CAREFULLY SELECTED TO SUIT SYDNEY STREET CODE & STANDARD SPEC. FROM DRAWINGS #7.1.1 TO 7.1.6.
2. THE ACO KERB DRAIN OR APPROVED EQUIVALENT SHALL BE USED FOR RANGARDEN ENTRY PIT.
3. THIS DETAIL IS WELL SUITED FOR THE AREAS WHERE
 - (i) NO GRASS VERGE EXISTS
 - (ii) THE DRAINAGE PIPES ARE SHALLOWER THAN 1.20m.
4. ALL DIMENSIONS IN MILLIMETRES UNLESS OTHERWISE STATED.

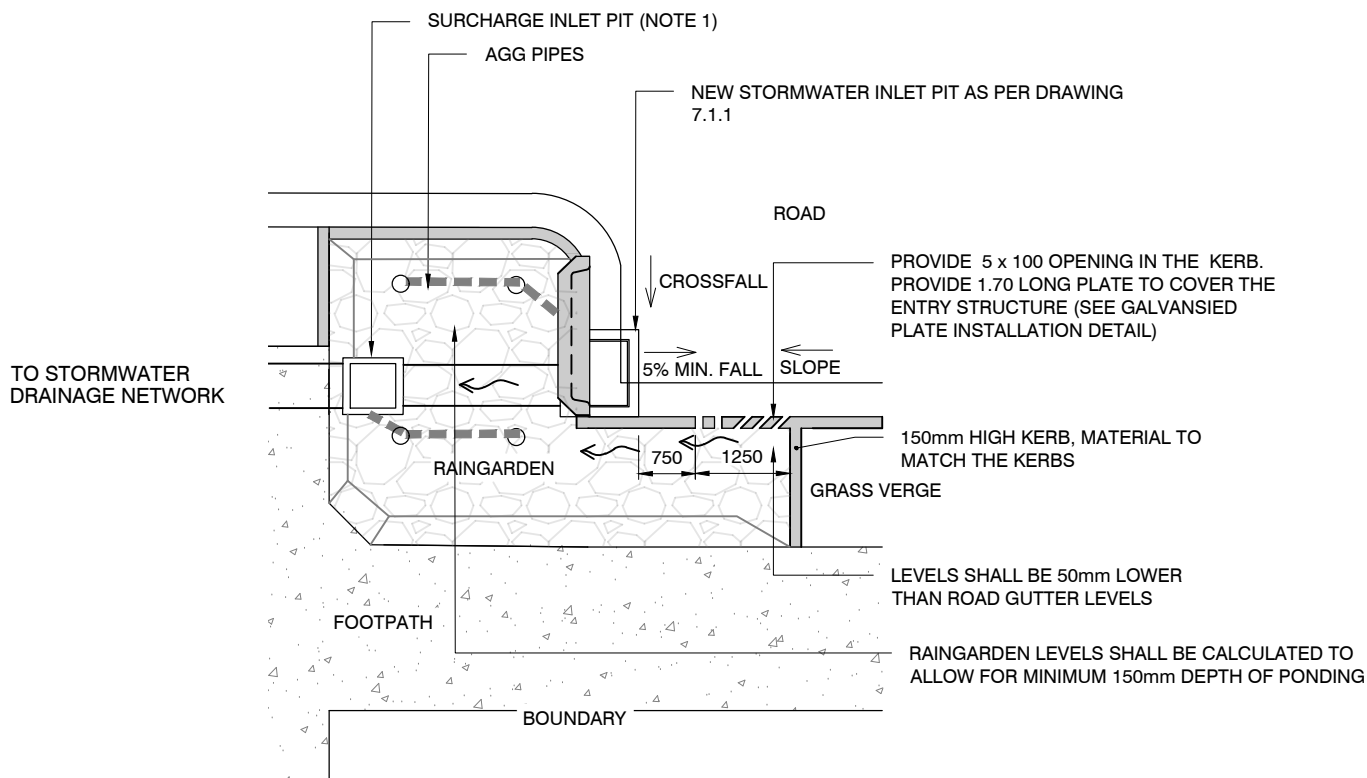

PLAN

1:100

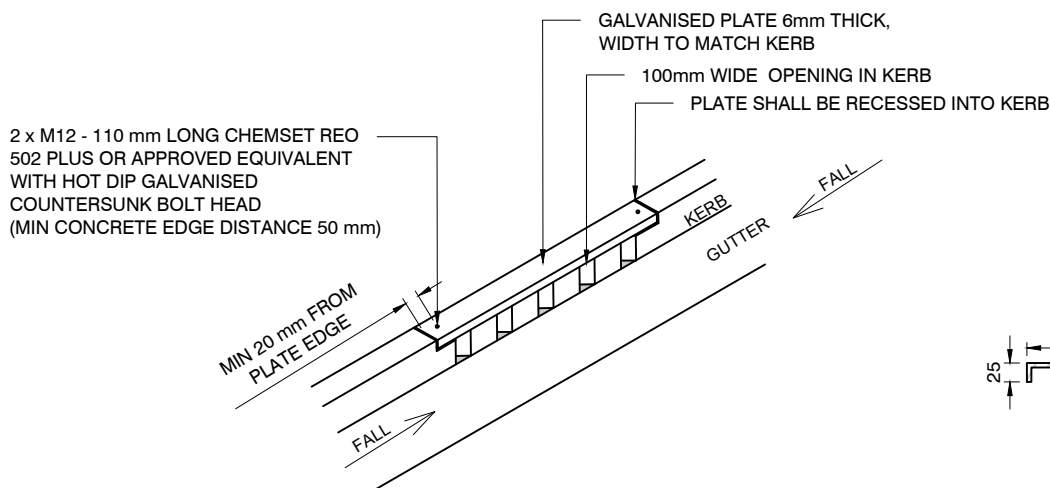

GALVANISED PLATE INSTALLATION DETAIL

1:50

GALVANISED PLATE DETAIL

1:10

NOTES:

1. RAINGARDEN SHALL BE DESIGNED IN ACCORDANCE WITH SYDNEY STREET TECHNICAL SPECIFICATION PART A4.
2. SURCHARGE PIT MAY BE DELETED UPON APPROVAL. REFER SYDNEY STREET TECHNICAL SPECIFICATION PART A4.
3. THIS OPTION BEST SUITS SMALLER CATCHMENTS WHERE:
 - (i) FOOTPATH HAS A GRASS VERGE.
 - (ii) INVERTS OF THE EXISTING DRAINAGE PIPES ARE SHALLOWER THAN 1.2m.
4. THE DRAINAGE PIT SHALL BE CONSTRUCTED IN ACCORDANCE WITH DRAWINGS #7.1.1 TO #7.1.6.
5. ALL DIMENSIONS IN MILLIMETRES UNLESS OTHERWISE STATED