


NOTES:

1. OBTAIN APPROVAL FROM AUTHORITY FOR COVER REALIGNMENT.
2. CLEAN PIT LID WITH WIRE BRUSH AND THEN WITH SOFT BRUSH TO REMOVE RUST FROM LID.
3. MOISTEN PAVER AND LID TO AID HYDRATION OF MORTAR MIX.
4. USE CEMENT MORTAR WITH FORTIFYING COMPOUND (ARDEX OR APPROVED EQUIVALENT) AS JOINTING MATERIAL.
5. USE A RICHER MIX eg. 1:1 CEMENT:SAND THINNER (2-5mm) JOINTS AND 1:2.5 CEMENT:SAND MIX FOR THICKER (12-15mm) JOINT.
6. PIT LID INFILLS TO HAVE APPROX. 3mm GAP ON SIDES SO AS TO NOT TOUCH THE LID.
7. GAPS ON SIDES SHOULD BE GROUTED WITH RICH CEMENT SAND MIX WITH FORTIFYING COMPOUND.
8. TO ENSURE THE SERVICE PIT IS STILL ACCESSIBLE AND FIT FOR USE THE RELEVANT AUTHORITY IS TO PROVIDE SIGN OFF / APPROVAL.

PLAN 1:50

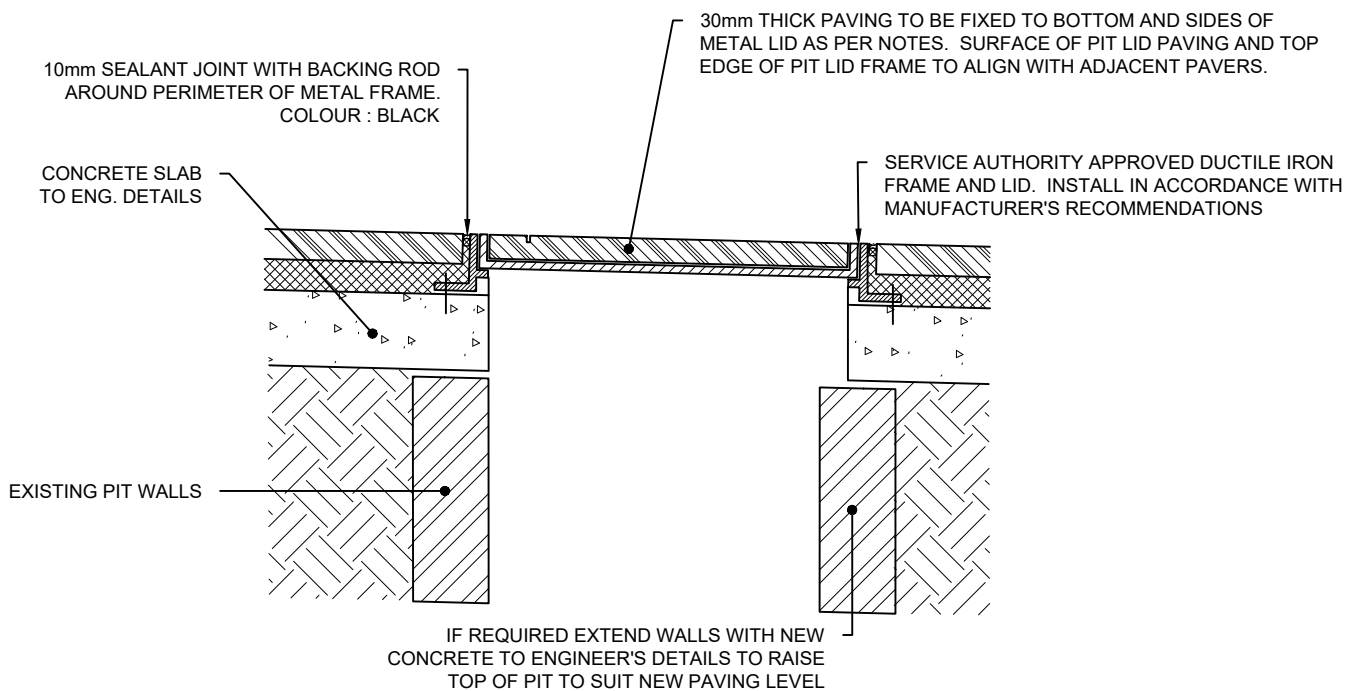

SECTION 1:10

NOTE: ALL DIMENSIONS IN MILLIMETRES UNLESS OTHERWISE STATED