



PLAN

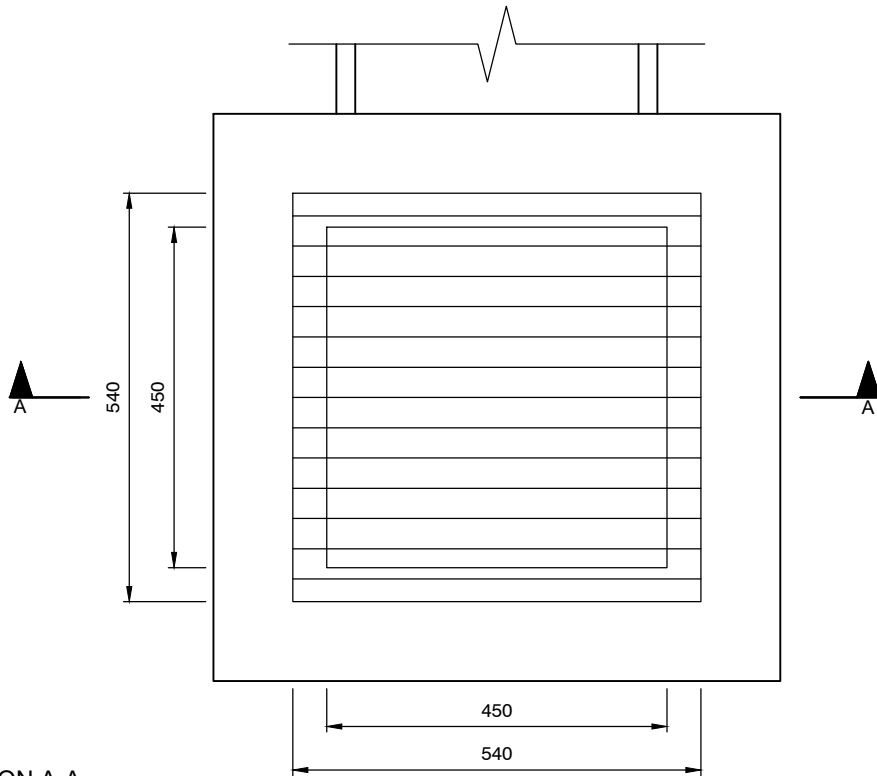

SECTION A-A

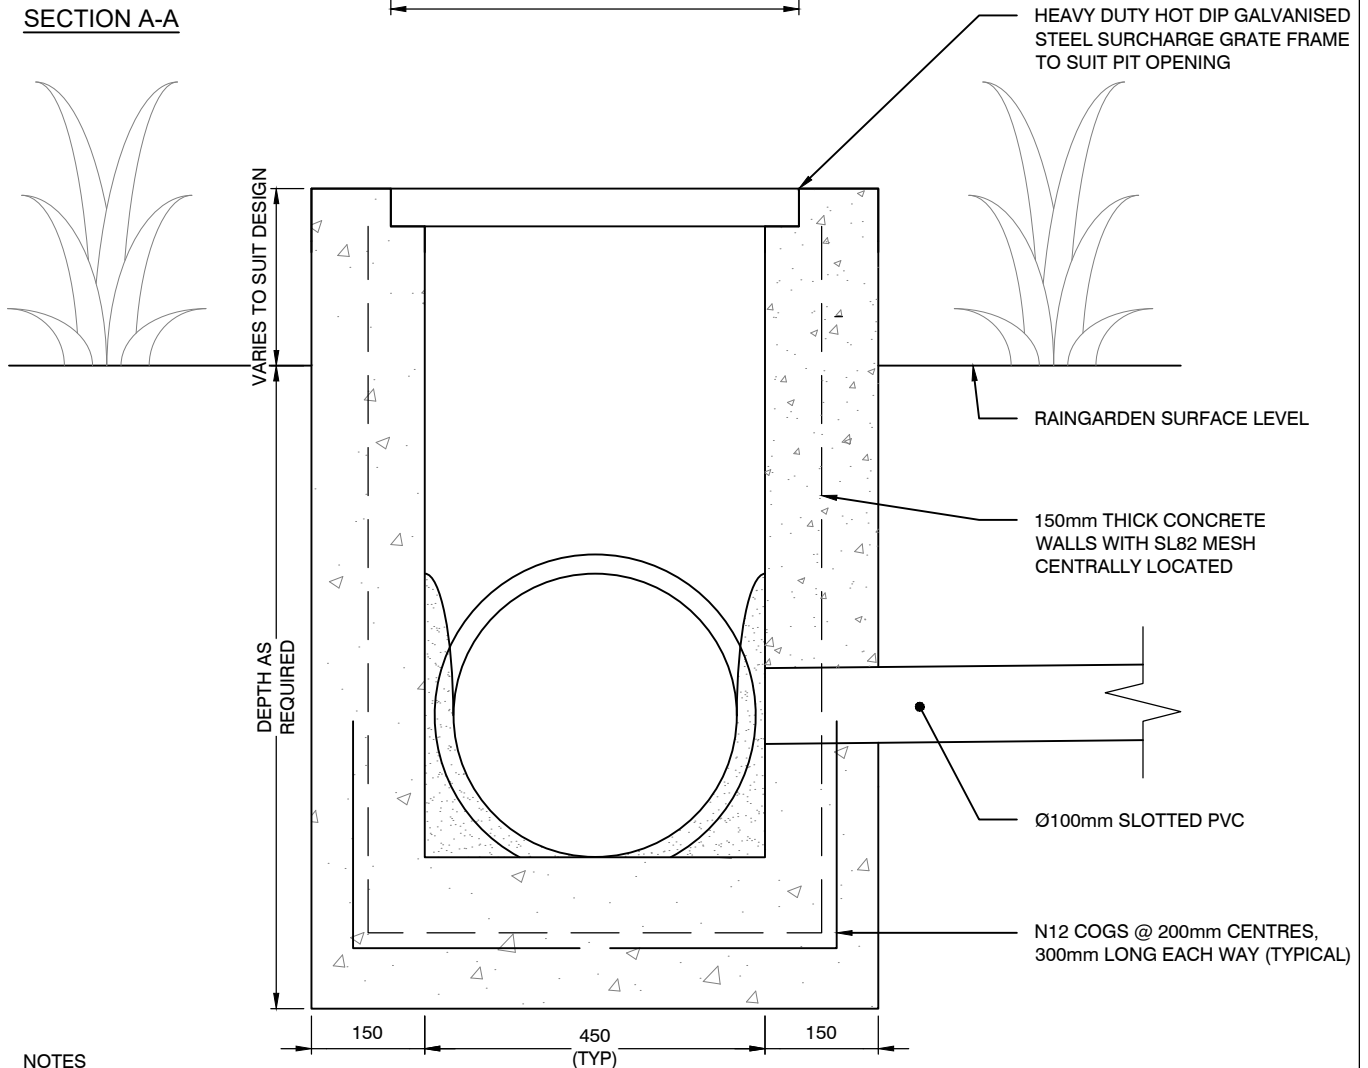

NOTES

1. ALL CONCRETE IS TO HAVE A MINIMUM STRENGTH OF 32 MPa.
2. PIT STRUCTURE TO BE 150mm THICK UNLESS NOTED OTHERWISE.
3. DRAINAGE PIPE TO BE MINIMUM 375Ø CLASS 4 REINFORCED CONCRETE PIPE

SCALE 1:10

NOTE: ALL DIMENSIONS IN MILLIMETRES UNLESS OTHERWISE STATED